

ATTACHMENT NO. 1 TO AEP:NRC:0894

TECHNICAL SPECIFICATION CHANGE DESCRIPTIONS

Change No. 1

Unit No. 1; Page 3/4 4-27; Figure 3.4-2
Page 3/4 4-28; Figure 3.4-3
Page B 3/4 4-6; Section 3/4 4.9
Page B 3/4 4-11; Section 3/4 4.9, 4.10

Unit No. 2; Page 3/4 4-25; Figure 3.4-2
Page 3/4 4-26; Figure 3.4-3
Page B 3/4 4-6; Section 3/4 4.9

Figures 3.4-2 and Figure 3.4-3 are the heatup and cooldown curves for Unit Nos. 1 and 2. These curves are composite curves prepared based upon the most limiting value of the predicted adjusted reference temperature at the end of 12 EFY. The revisions to the curves reflect the analyses done as a result of the capsule (Y) testing by Southwest Research Institute. The assumptions and limitations used in the development of the curves are noted in the revised bases for both Units.

The bases for Pressure/Temperature limits were re-written to reflect the current analyses. Also, the Unit No. 1 bases was revised to read similarly to the Unit No. 2 writeup for consistency.

The proposed change may result in an additional limitation, restriction or control not presently included in the Technical Specifications and constitutes a change to conform to changes in the federal regulations. We believe that the results of the change are clearly within all acceptable criteria since they are the direct result of an evaluation using methods acceptable to the NRC. As such, the proposed changes are found not to involve a significant hazards consideration.

8502210036 850214
PDR ADCK 05000315
P PDR

ATTACHMENT NO. 2

TO

AEP:NRC:0894

REACTOR COOLANT SYSTEM

BASES

3/4.4.9 PRESSURE/TEMPERATURE LIMITS

All components in the Reactor Coolant System are designed to withstand the effects of cyclic loads due to system temperature and pressure changes. These cyclic loads are introduced by normal load transients, reactor trips, and startup and shutdown operations. The various categories of load cycles used for design purposes are provided in Section 4.1.4 of the FSAR. During startup and shutdown, the rates of temperature and pressure changes are limited so that the maximum specified heatup and cooldown rates are consistent with the design assumptions and satisfy the stress limits for cyclic operation.

An ID or OD one-quarter thickness surface flaw is postulated at the location in the vessel which is found to be the limiting case. There are several factors which influence the postulated location. The thermal induced bending stress during heatup is compressive on the inner surface while tensile on the outer surface of the vessel wall. During cooldown the bending stress profile is reversed. In addition, the material toughness is dependent upon irradiation and temperature and therefore the fluence profile through the reactor vessel wall, the rate of heatup and also the rate of cooldown influence the postulated flaw location.

The heatup limit curve, Figure 3.4-2, is a composite curve which was prepared by determining the most conservative case, with either the inside or outside wall controlling, for any heatup rate up to 60°F per hour. The cooldown limit curves of Figure 3.4-3 are composite curves which were prepared based upon the same type analysis with the exception that the controlling location is always the inside wall where the cooldown thermal gradients tend to produce tensile stresses while producing compressive stresses at the outside wall. The heatup and cooldown curves were prepared based upon the most limiting value of the predicted adjusted reference temperature at the end of 12 EFPY.

The reactor vessel materials have been tested to determine their initial RT_{NDT} ; the results of these tests are shown in Table B 3/4.4-1. Reactor operation and resultant fast neutron ($E > 1$ Mev) irradiation will cause an increase in the RT_{NDT} . Therefore, an adjusted reference temperature, based upon the fluence and copper content of the material in question, can be predicted using Figures B 3/4.4-1 and B 3/4.4-2. The heatup and cooldown limit curves of Figures 3.4-2 and 3.4-3 include predicted adjustments for this shift in RT_{NDT} at the end of 12 EFPY, as well as adjustments for possible errors in the pressure and temperature sensing instruments.

REACTOR COOLANT SYSTEM

BASES

The actual shift in RT_{NDT} of the vessel material will be established periodically during operation by removing and evaluating, in accordance with ASTM E185-73, reactor vessel material irradiation surveillance specimens installed near the inside wall of the reactor vessel in the core area. Since the neutron spectra at the irradiation samples and vessel inside radius are essentially identical, the measured transition shift for a sample can be applied with confidence to the adjacent section of the reactor vessel. The heatup and cooldown curves must be recalculated when the ΔRT_{NDT} determined from the surveillance capsule is different from the calculated ΔRT_{NDT} for the equivalent capsule radiation exposure.

The pressure-temperature limit lines shown on Figure 3.4-2 for reactor criticality and for inservice leak and hydrostatic testing have been provided to assure compliance with the minimum temperature requirements of Appendix G to 10 CFR 50.

The number of reactor vessel irradiation surveillance specimens and the frequencies for removing and testing these specimens are provided in Table 4.4-5 to assure compliance with the requirements of Appendix H to 10 CFR Part 50.

The limitations imposed on pressurizer heatup and cooldown and spray water temperature differential are provided to assure that the pressurizer is operated within the design criteria assumed for the fatigue analysis performed in accordance with the ASME Code requirements.

The OPERABILITY of two PORVs, one PORV and the RHR safety valve, or an RCS vent opening of greater than or equal to 2 square inches ensures that the RCS will be protected from pressure transients which could exceed the limits of Appendix G to 10 CFR Part 50 when one or more of the RCS cold legs are less than or equal to 188°F. Either PORV or RHR safety valve has adequate relieving capability to protect the RCS from overpressurization when the transient is limited to either (1) the start of an idle RCP with the secondary water temperature of the steam generator less than or equal to 50°F above the RCS cold leg temperatures or (2) the start of a charging pump and its injection into a water solid RCS.

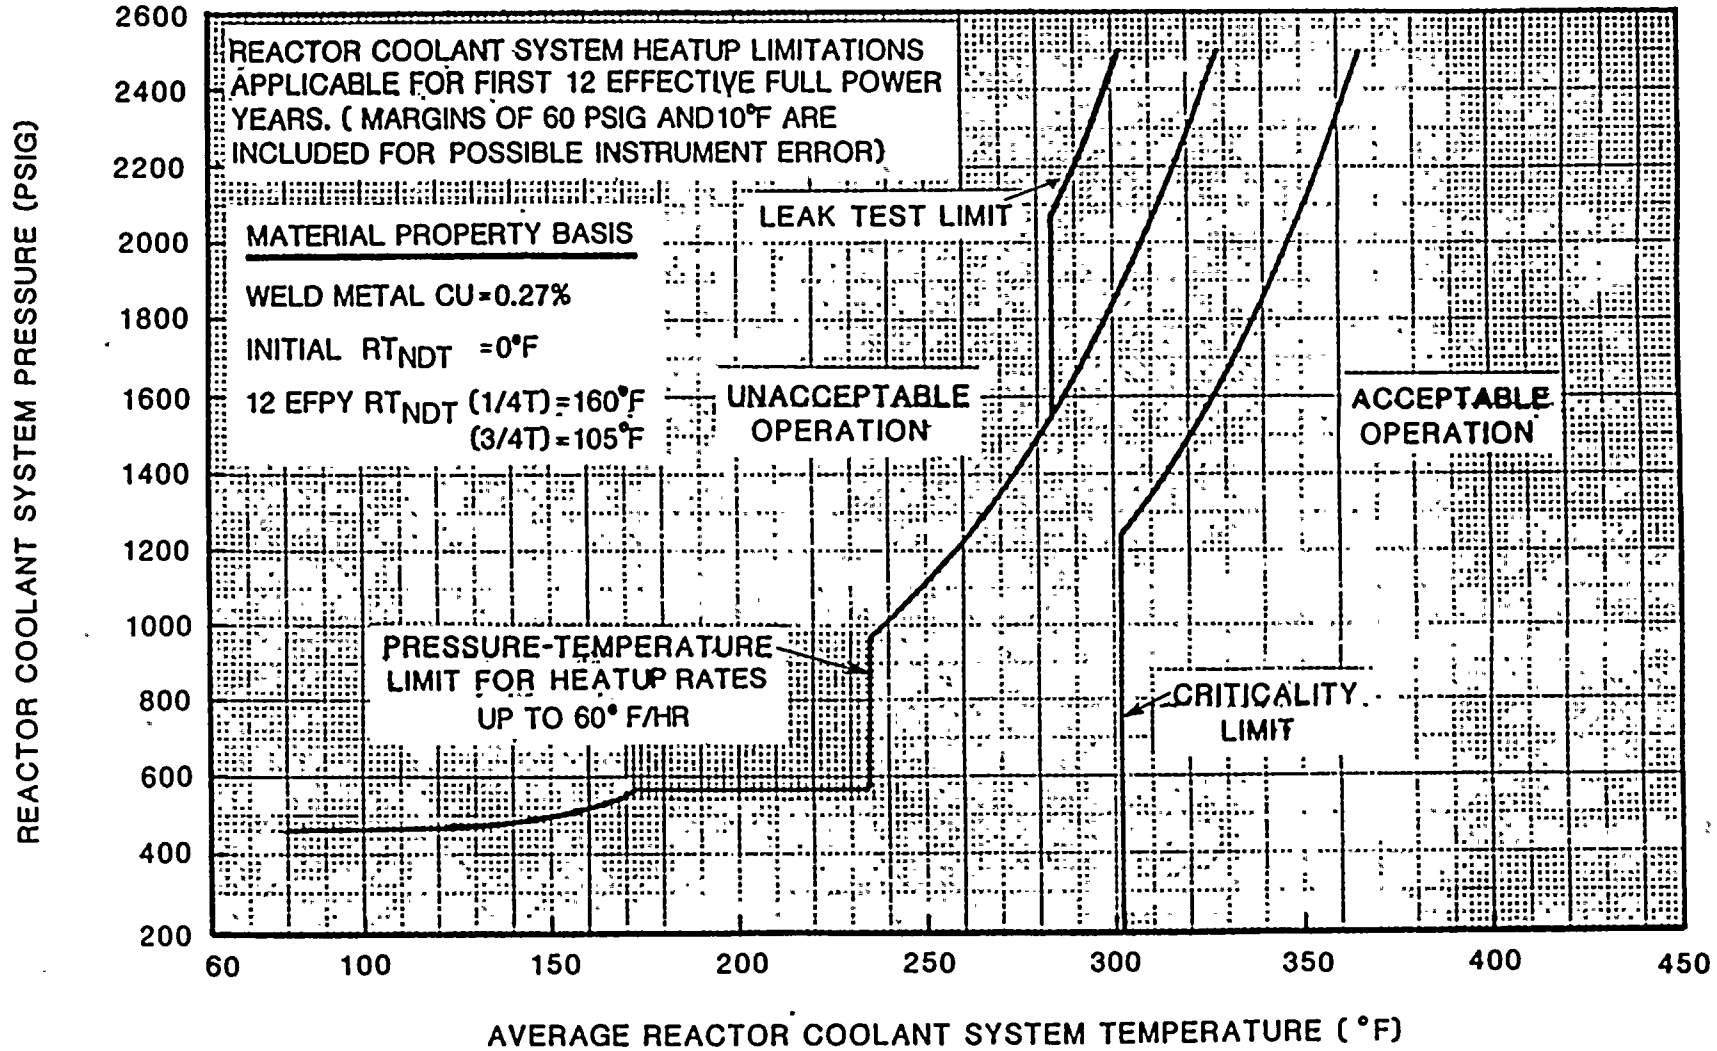


FIGURE 3.4-2

REACTOR COOLANT SYSTEM PRESSURE-TEMPERATURE LIMITS VERSUS 60°F/HOUR RATE
 CRITICALITY LIMIT AND HYDROSTATIC TEST LIMIT

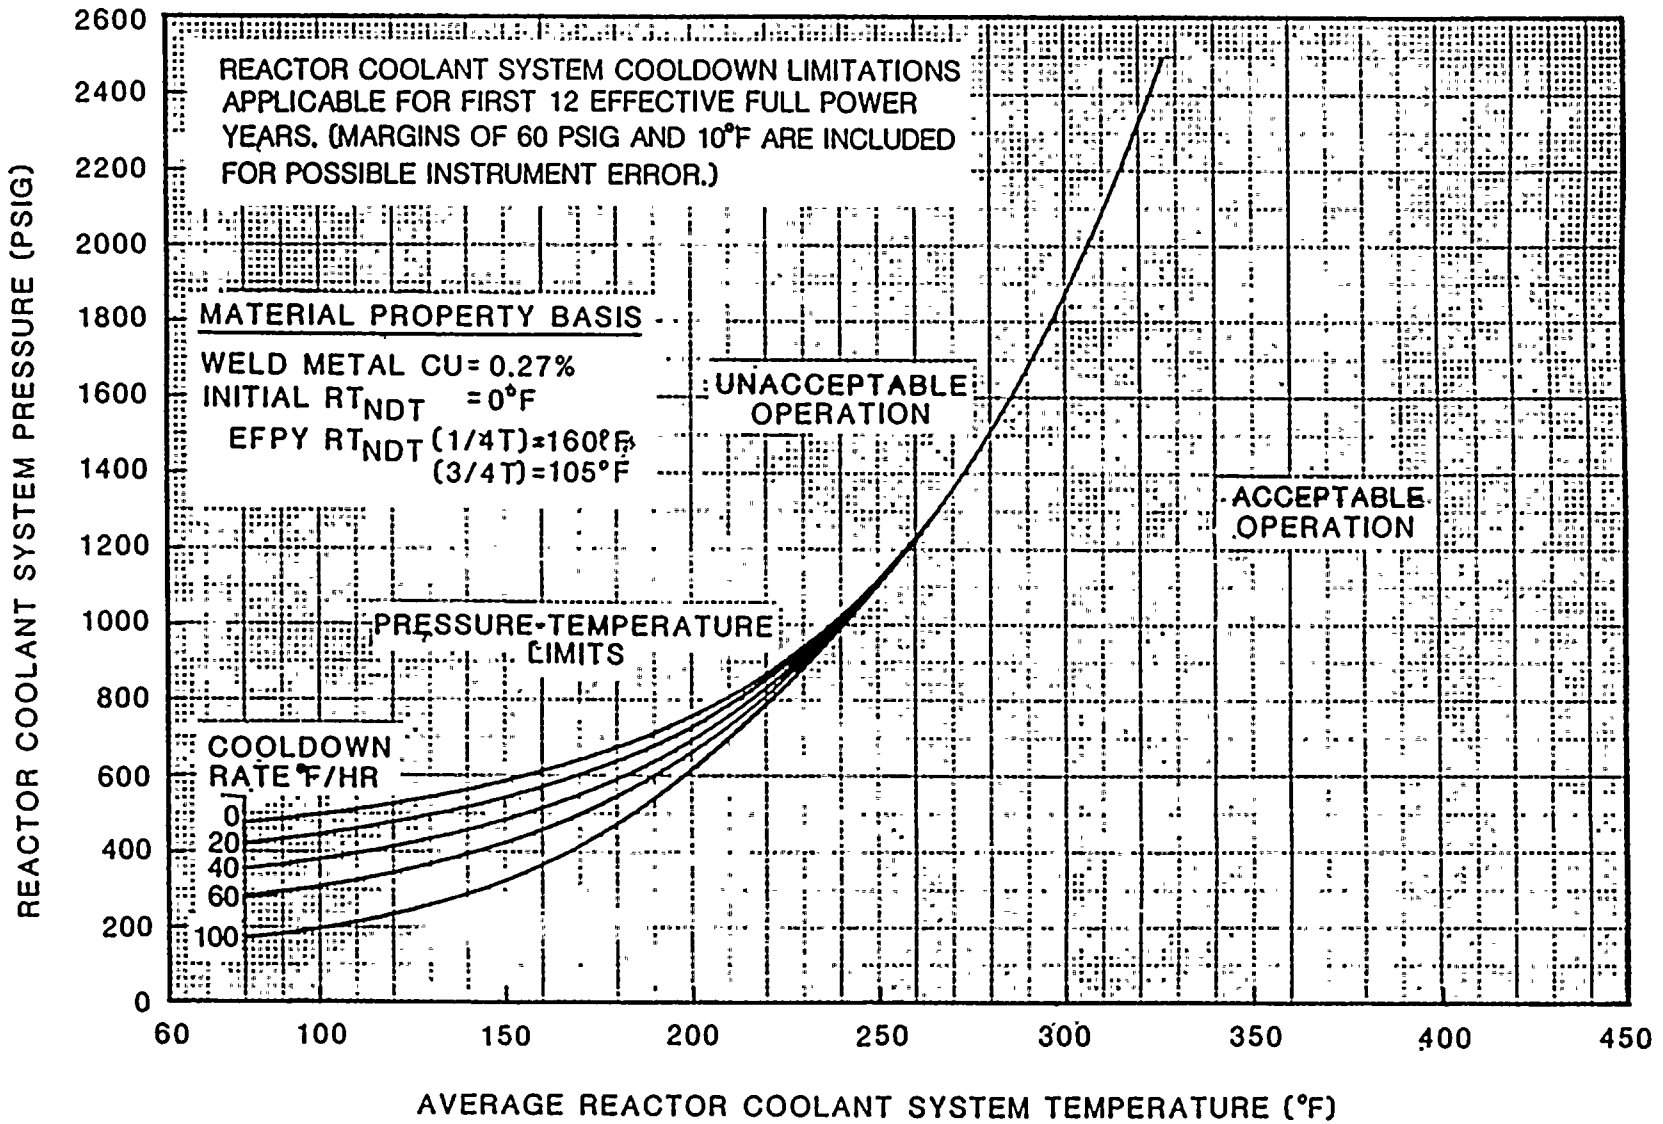


FIGURE 3.4-3

REACTOR COOLANT SYSTEM PRESSURE-TEMPERATURE LIMITS VERSUS COOLDOWN RATES

REACTOR COOLANT SYSTEM

BASES

3/4.4.9 PRESSURE/TEMPERATURE LIMITS

All components in the Reactor Coolant System are designed to withstand the effects of cyclic loads due to system temperature and pressure changes. These cyclic loads are introduced by normal load transients, reactor trips, and startup and shutdown operations. The various categories of load cycles used for design purposes are provided in Section 4.1.4 of the FSAR. During startup and shutdown, the rates of temperature and pressure changes are limited so that the maximum specified heatup and cooldown rates are consistent with the design assumptions and satisfy the stress limits for cyclic operation.

An ID or OD one-quarter thickness surface flaw is postulated at the location in the vessel which is found to be the limiting case. There are several factors which influence the postulated location. The thermal induced bending stress during heatup is compressive on the inner surface while tensile on the outer surface of the vessel wall. During cooldown the bending stress profile is reversed. In addition, the material toughness is dependent upon irradiation and temperature and therefore the fluence profile through the reactor vessel wall, the rate of heatup and also the rate of cooldown influence the postulated flaw location.

The heatup limit curve, Figure 3.4-2, is a composite curve which was prepared by determining the most conservative case, with either the inside or outside wall controlling, for any heatup rate up to 100°F per hour. The cooldown limit curves of Figure 3.4-3 are composite curves which were prepared based upon the same type analysis with the exception that the controlling location is always the inside wall where the cooldown thermal gradients tend to produce tensile stresses while producing compressive stresses at the outside wall. The heatup and cooldown curves were prepared based upon the most limiting value of the predicted adjusted reference temperature at the end of 12 EFPY.

The reactor vessel materials have been tested to determine their initial RT_{NDT} ; the results of these tests are shown in Table B 3/4.4-1. Reactor operation and resultant fast neutron ($E > 1$ Mev) irradiation will cause an increase in the RT_{NDT} . Therefore, an adjusted reference temperature, based upon the fluence and copper content of the material in question, can be predicted using Figures B 3/4.4-1 and B 3/4.4-2. The heatup and cooldown limit curves of Figures 3.4-2 and 3.4-3 include predicted adjustments for this shift in RT_{NDT} at the end of 12 EFPY, as well as adjustments for possible errors in the RT_{NDT} pressure and temperature sensing instruments.

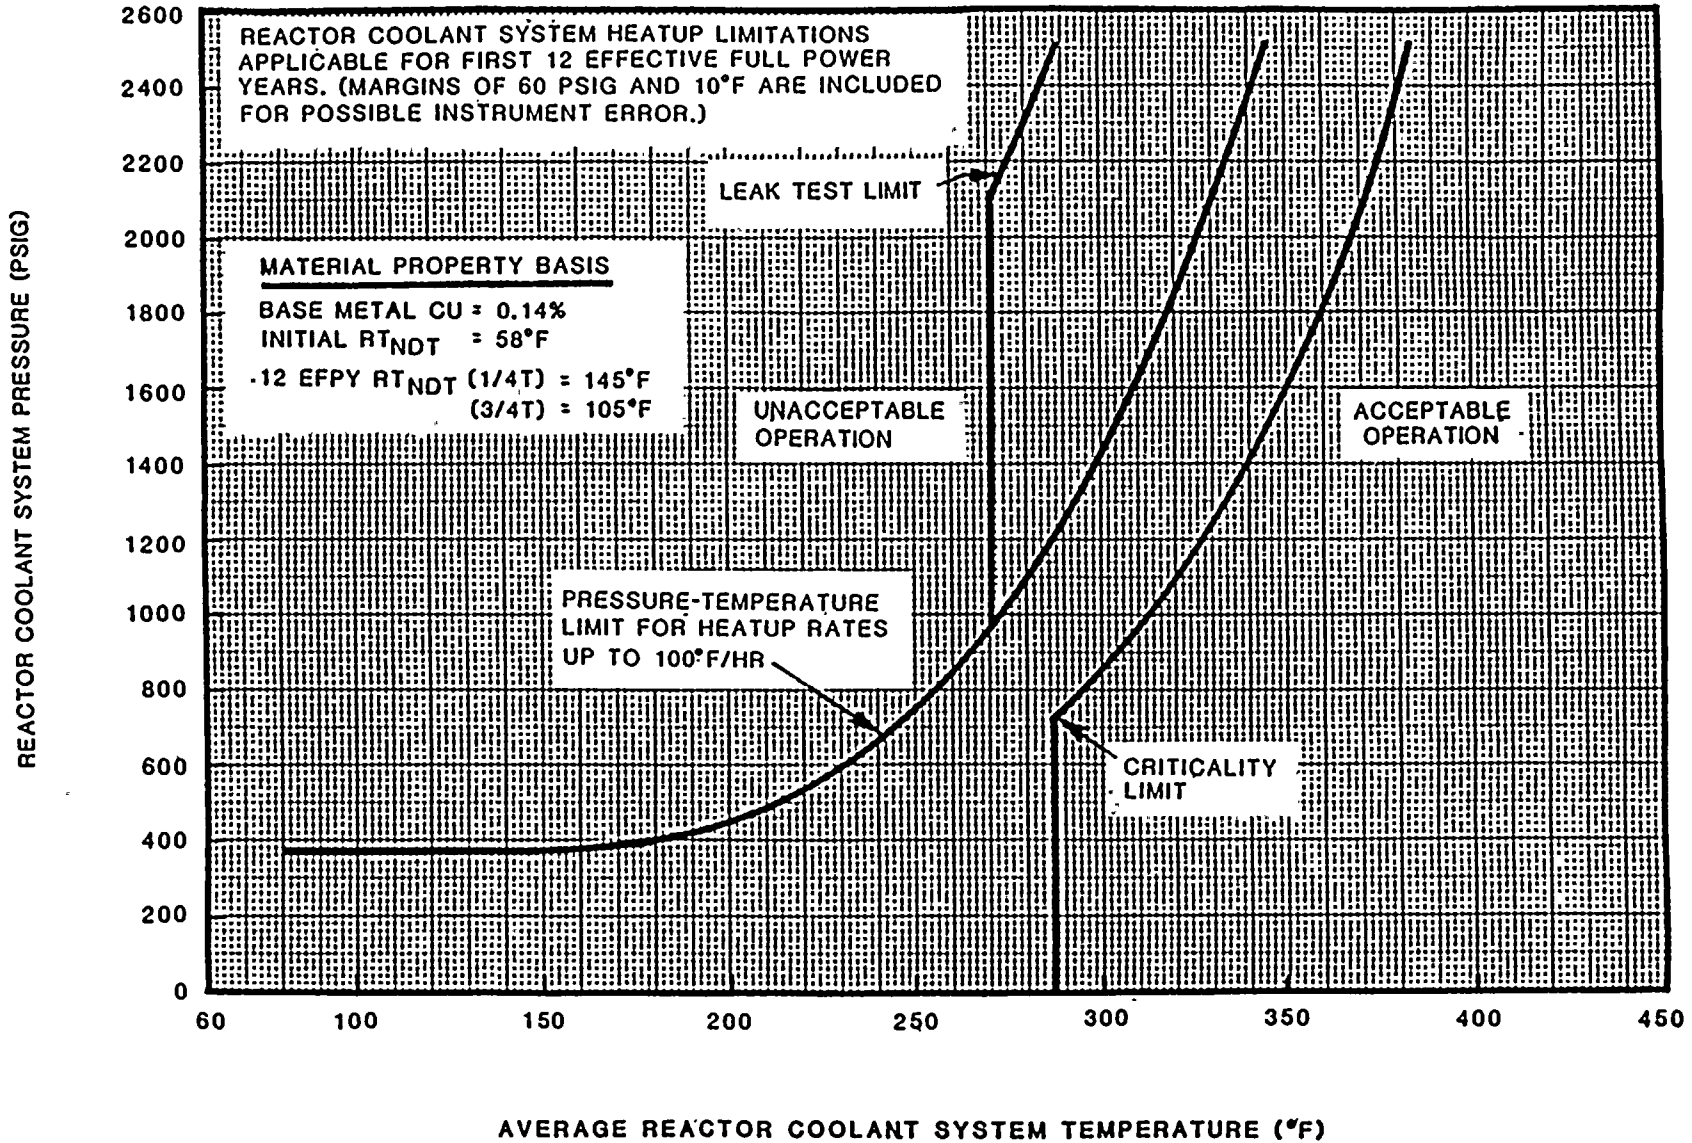


FIGURE 3.4-2

REACTOR COOLANT SYSTEM PRESSURE-TEMPERATURE LIMITS VERSUS 100°F/HR RATE,
 CRITICALITY LIMIT AND HYDROSTATIC TEST LIMIT

REACTOR COOLANT SYSTEM PRESSURE (PSIG)

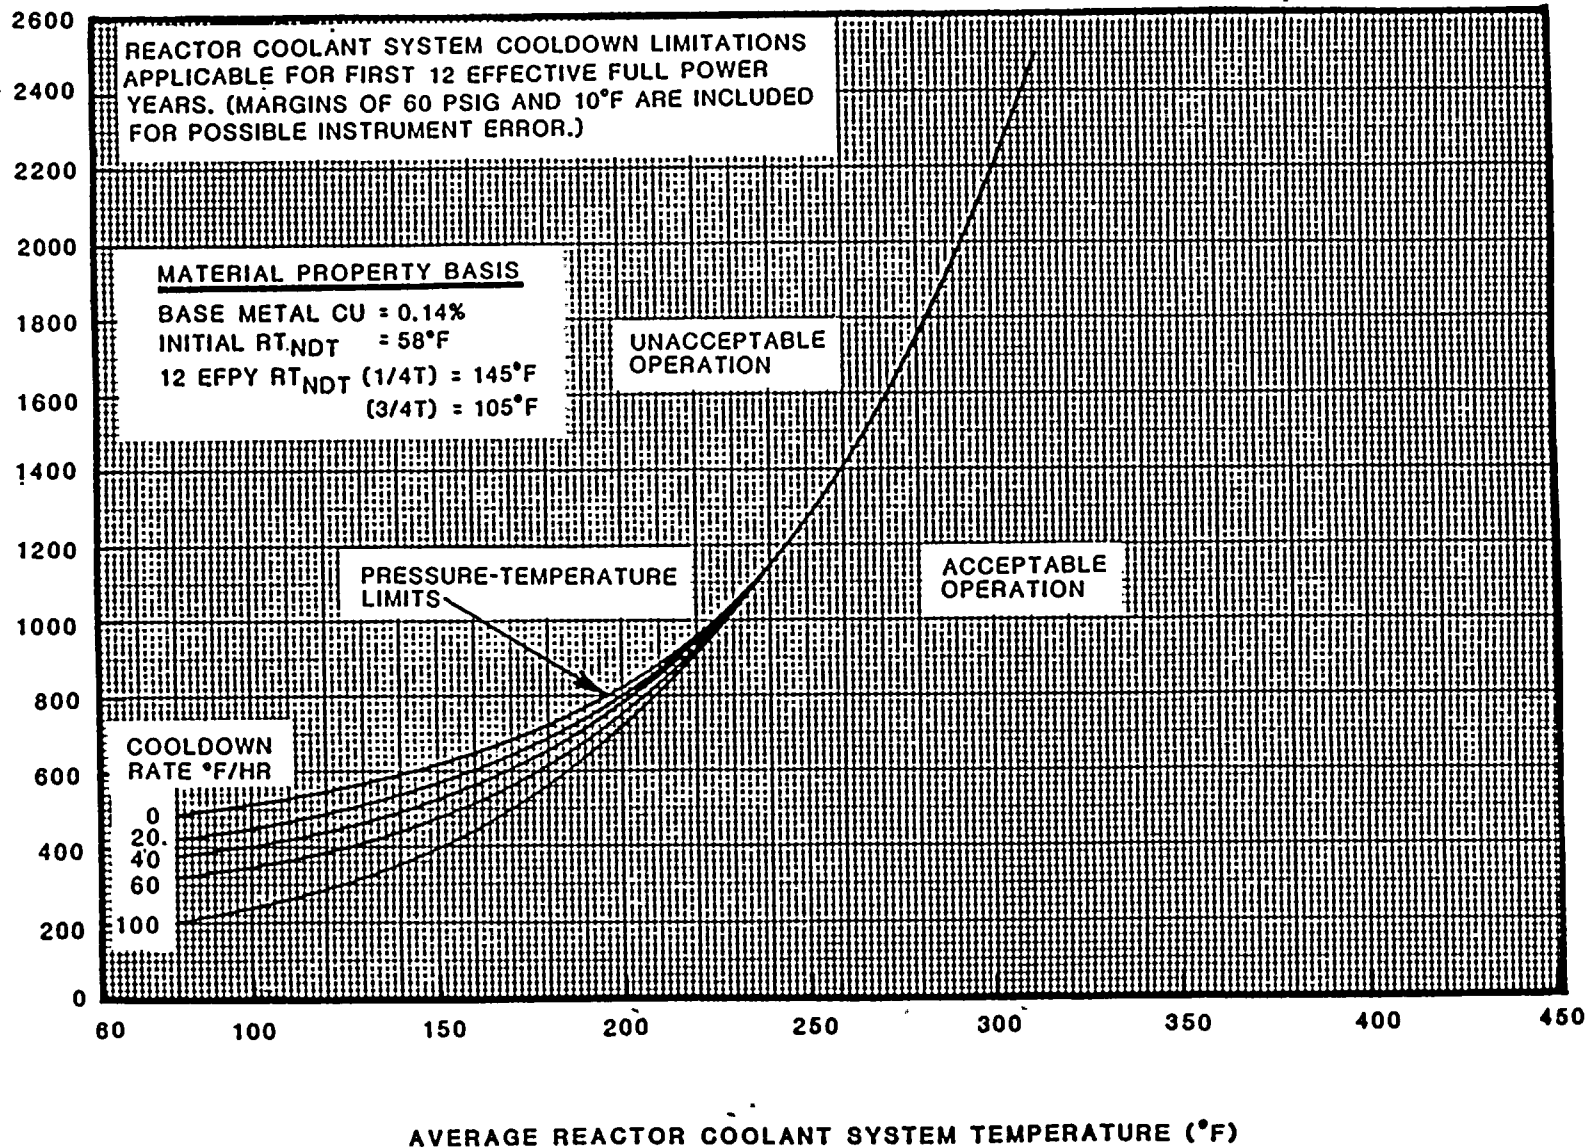


FIGURE 3.4-3

REACTOR COOLANT SYSTEM PRESSURE-TEMPERATURE LIMITS VERSUS COOLDOWN RATES

ATTACHMENT NO. 3

TO

AEP:NRC:0894

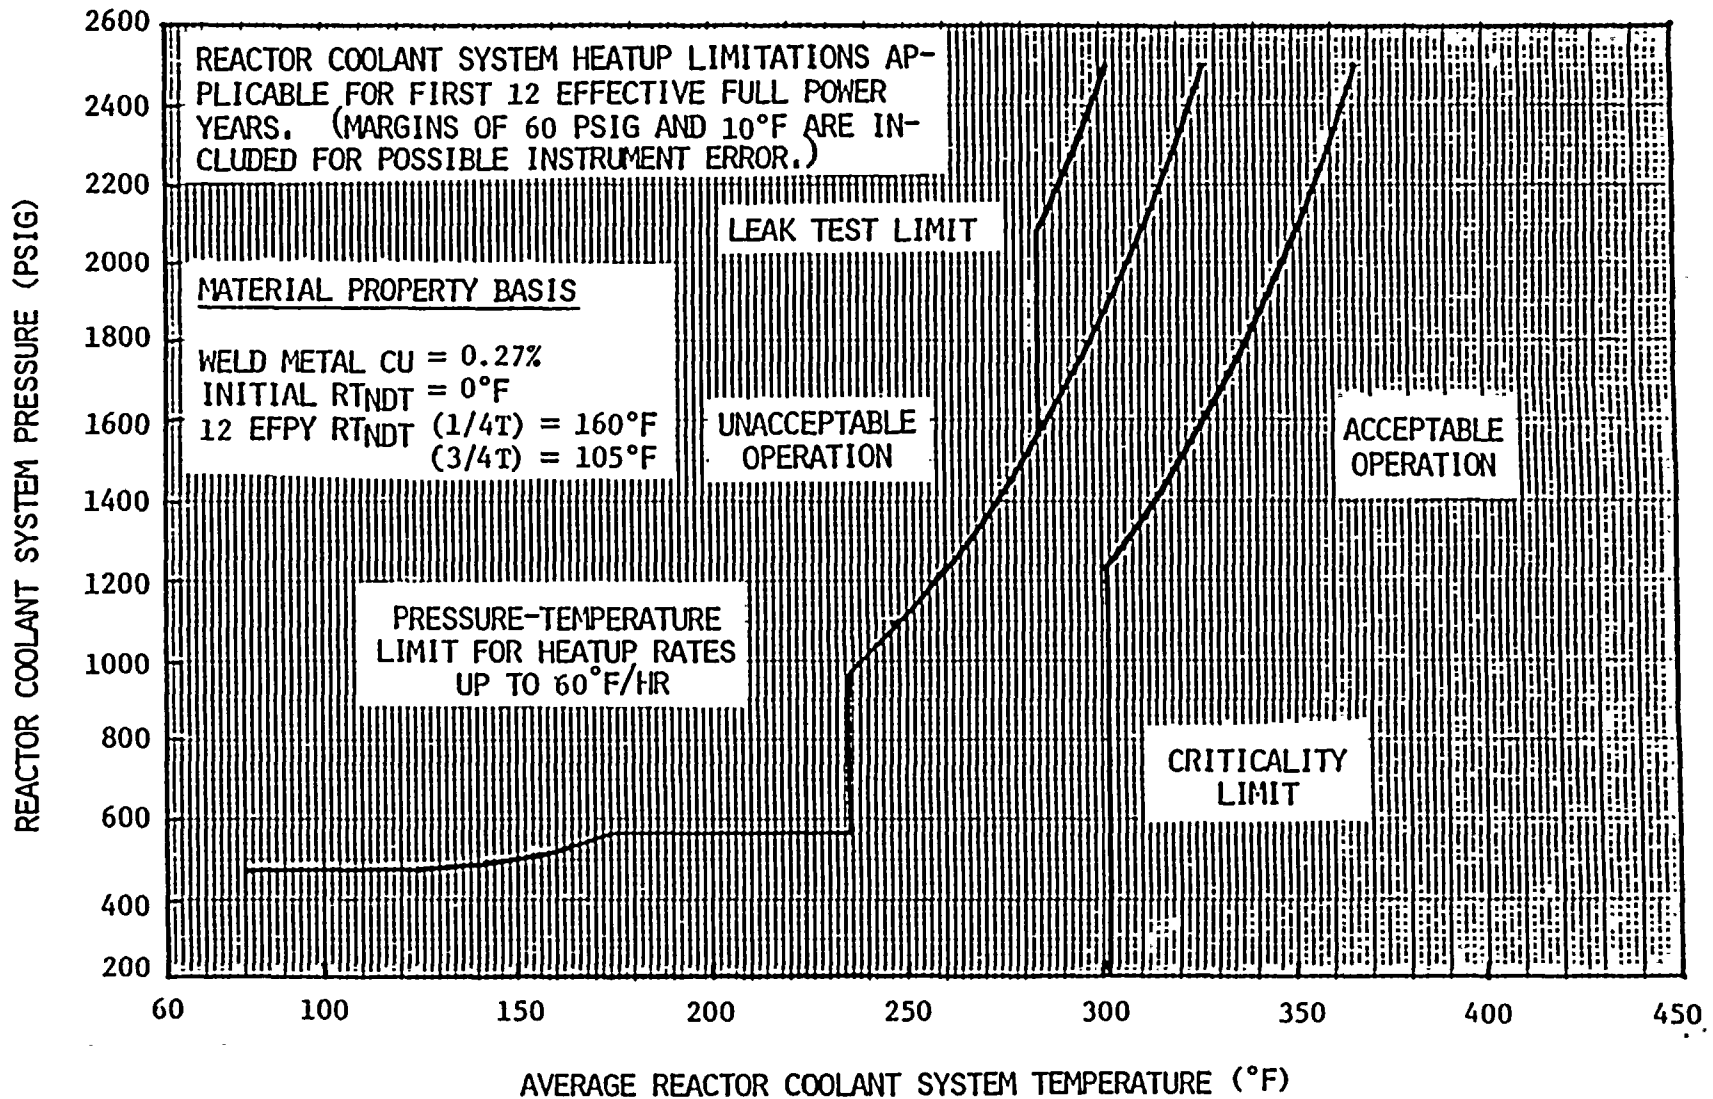


FIGURE 1. PROPOSED MODIFICATION TO DONALD C. COOK UNIT NO. 1 REACTOR COOLANT SYSTEM PRESSURE-TEMPERATURE LIMITS VERSUS 60°F/HOUR RATE CRITICALITY LIMIT AND HYDROSTATIC TEST LIMIT, 12 EPFY, FOR FRACTURE CONTROL AT STRUCTURAL DISCONTINUITIES

SOUTHWEST RESEARCH INSTITUTE

POST OFFICE DRAWER 28510 • 6270 CULEBRA ROAD • SAN ANTONIO, TEXAS, USA 78284 • (512) 684 5111 • TELEX 76-7357

File P.V. Material Surveillance
Department of Materials Sciences
June 12, 1984

Mr. John R. Jensen
Mechanical Engineering Department
American Electric Power Service Corporation
1 Riverside Plaza
Columbus, Ohio 43215

Subject: Heatup P-T Limits for up to 12 EFPY Operation,
D. C. Cook Unit No. 1

Reference: Letter of May 30, 1984, E. B. Norris to J. R. Jensen

Dear John:

Enclosed is a revised Figure 1 for placement in the referenced letter. Although the 10°F allowance for instrument error had been included in the analysis described in the referenced letter, the -60 psi instrument error had not. Therefore, I lowered the horizontal line from 625 psi to 565 psi.

I decided not to change Figure 2 of the referenced letter because the Figure 1 approach is acceptable and gives the plant operations more leeway. In addition, any lower bound curve which I might draw, such as the dotted line in Figure 2, is strictly arbitrary.

Also enclosed are copies of the computer printouts which we used in the construction of the 12 EFPY P-T limit curves. I have noted where the closure flange region limits impact on the normal values.

Should you have any questions, please do not hesitate to contact me.

Sincerely,



E. B. Norris
Staff Engineer

EBN:klc
Enclosures

cc: C. E. Lautzenheiser, SwRI



SAN ANTONIO, TEXAS
WITH OFFICES IN HOUSTON, TEXAS, AND WASHINGTON, D. C.