


2998-G-078
SH 168

NO	DATE	DESCRIPTION	BY	CH	APPROVED
3	7/24/95		CLC	JS	AJZ
4	8-5-96	W2-SLV-34-002: REDRAWN	GM		993

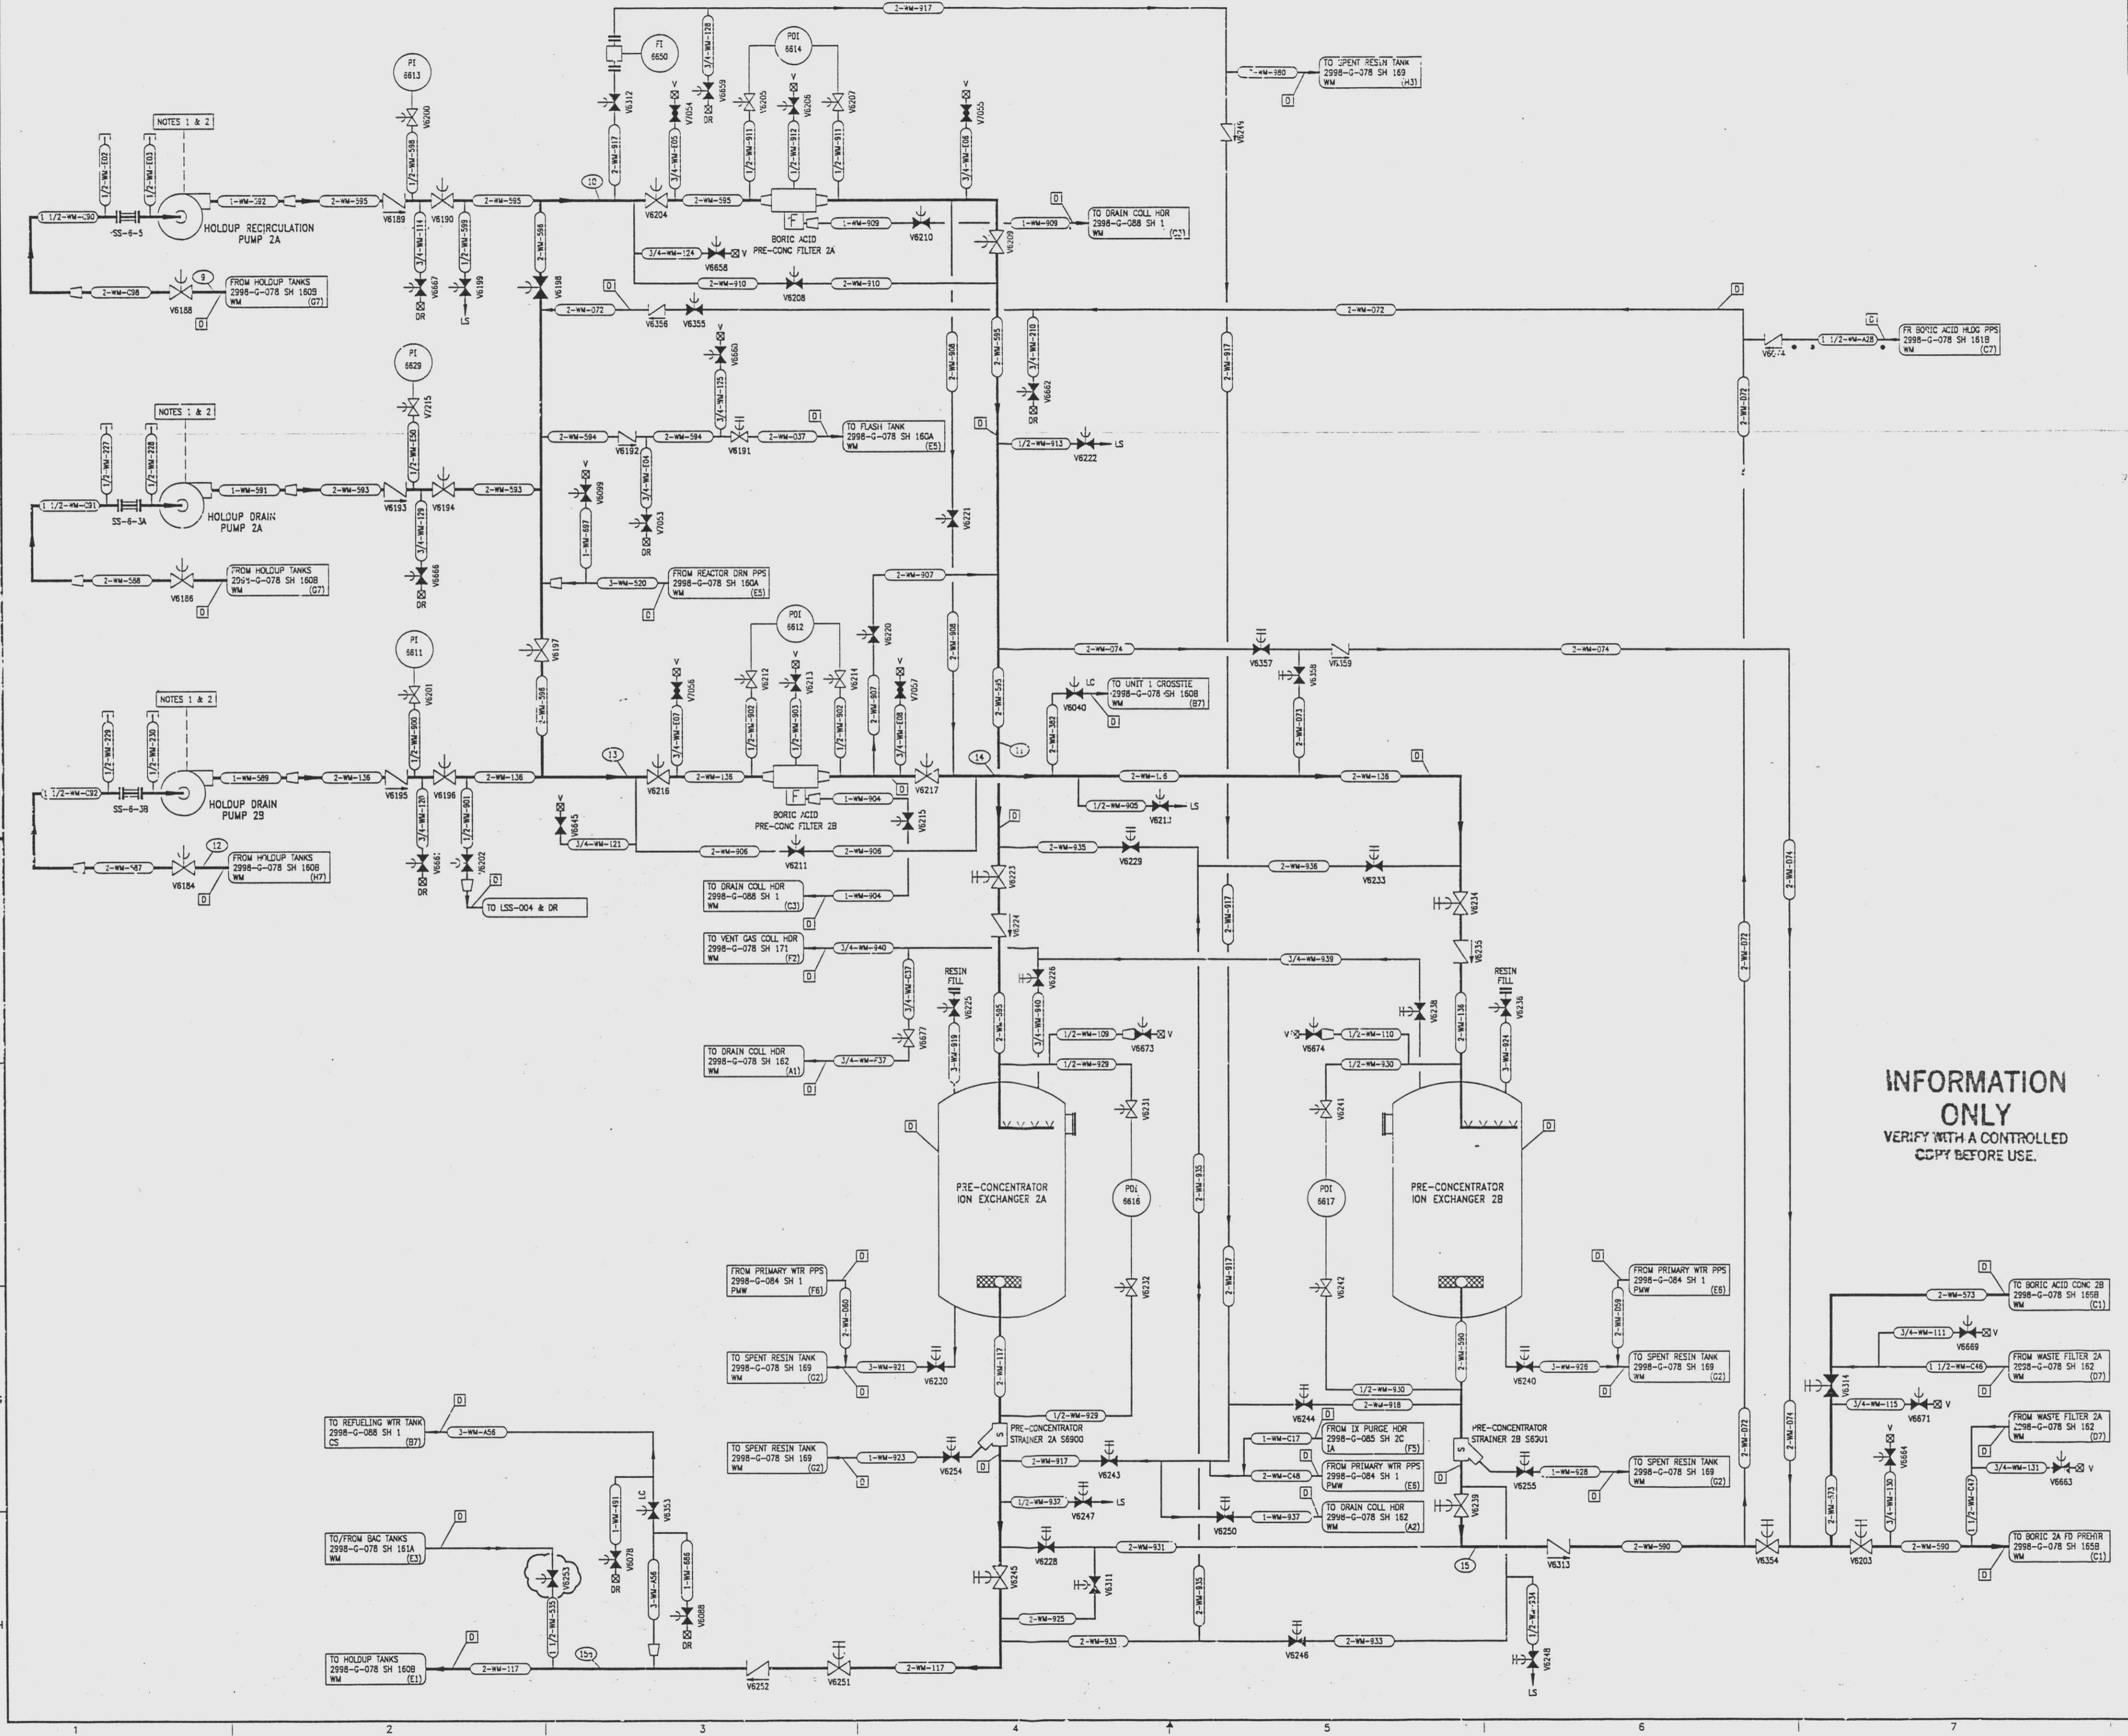

DRAWING NUMBER
2998-G-078
SH 168

DRAWING NUMBER
2998-G-078
SH 168

DRAWING NUMBER
2998-G-078
SH 168

- NOTES
1. HOLDUP PUMPS STOP ON HOLDUP TANK LOW LEVEL.
 2. HOLDUP PUMPS STOP & START ON BORIC ACID CONCENTRATORS LEVEL SIGNAL.
 3. LOCAL ALARMS ARE GROUPED ON SEVERAL LOCAL PANELS. EACH PANEL HAS AN ANNUNCIATOR ON THE CONTROL ROOM PANEL.

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-004
VALVE OPERATIONAL NUMBER INDEX	2998-B-051/A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

NOTE:
THIS DRAWING IS MADE FROM REV. 2
OF DRAWING 2998-G-078 SH 168

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENTS: FSAR FIGURE 11.2-2

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1983 - 890 Mwe EXTENSION - UNIT 2
FLOW DIAGRAM
WASTE MANAGEMENT SYSTEM

SCALE: NONE	APPROVAL	DATE
DRW: MCH		2998-G-078
CHK: E. SLATT		SHEET
CH: P. BERGSON		168

9906040-dal-121

APERTURE CARD