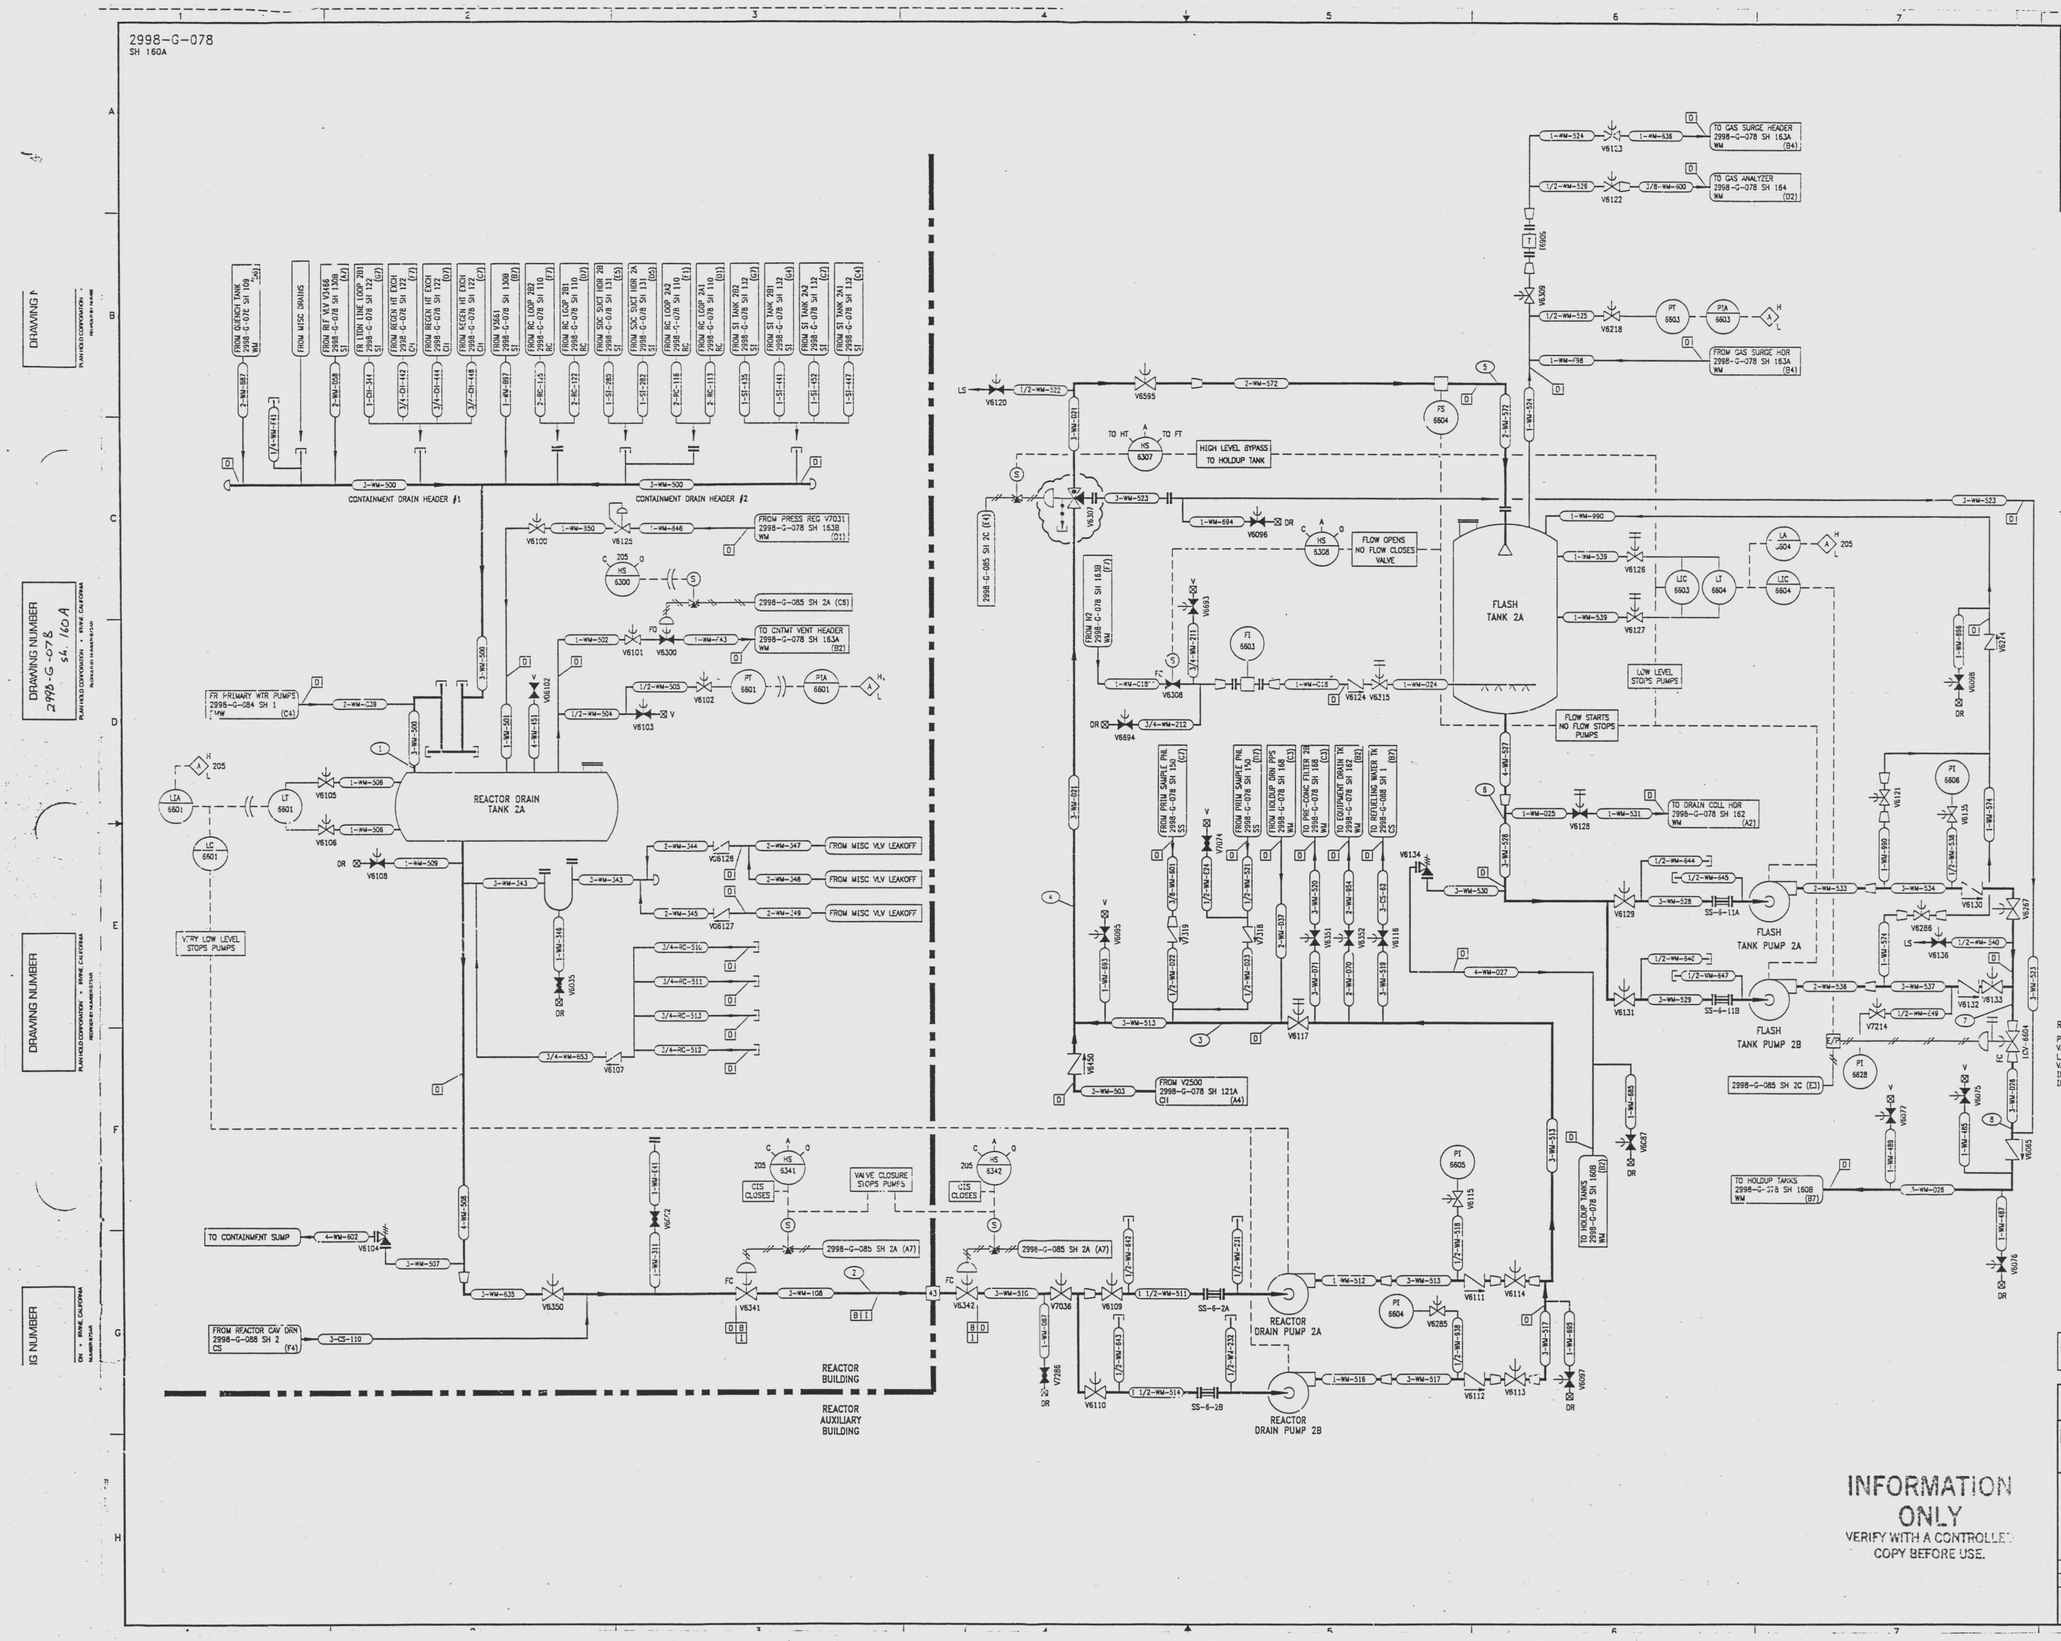

REVISIONS

NO	DATE	DESCRIPTION	BY	CH	APPROVED
3	7/24/95	DCR-SLM-94-057: REDRAWN	BB	DWC/HS	JJZ
4	12/21/95	PC/M 161-295: DEL. (E-3,F-3) CONTINUATIONS	GM	HS	TWS
5	8/8/96	CRN 96037-6035: DEL. (G2,E5 & C4) LC/LO	GM	HS	JJZ
6	11/9/96	CRN 96037-6493: REV. (C4) STEM LEAK OFF CAP	GM	PDB	

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-B-057A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

NOTE:
THIS DRAWING IS MADE FROM REV. 2 OF DRAWING 2998-G-078 SH 160

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENTS: FSAR FIGURE 11.2-1

NUCLEAR SAFETY RELATED IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1983 - 890 MWe EXTENSION - UNIT 2
FLOW DIAGRAM
WASTE MANAGEMENT SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC

SCALE: NONE	APPROVAL	DATE:
DN: MECH		2998-G-078
DR: B BLUM		SHEET 160A 6
CH: CUNNINGHAM		

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.

9906040221-108

APERTURE CARD