


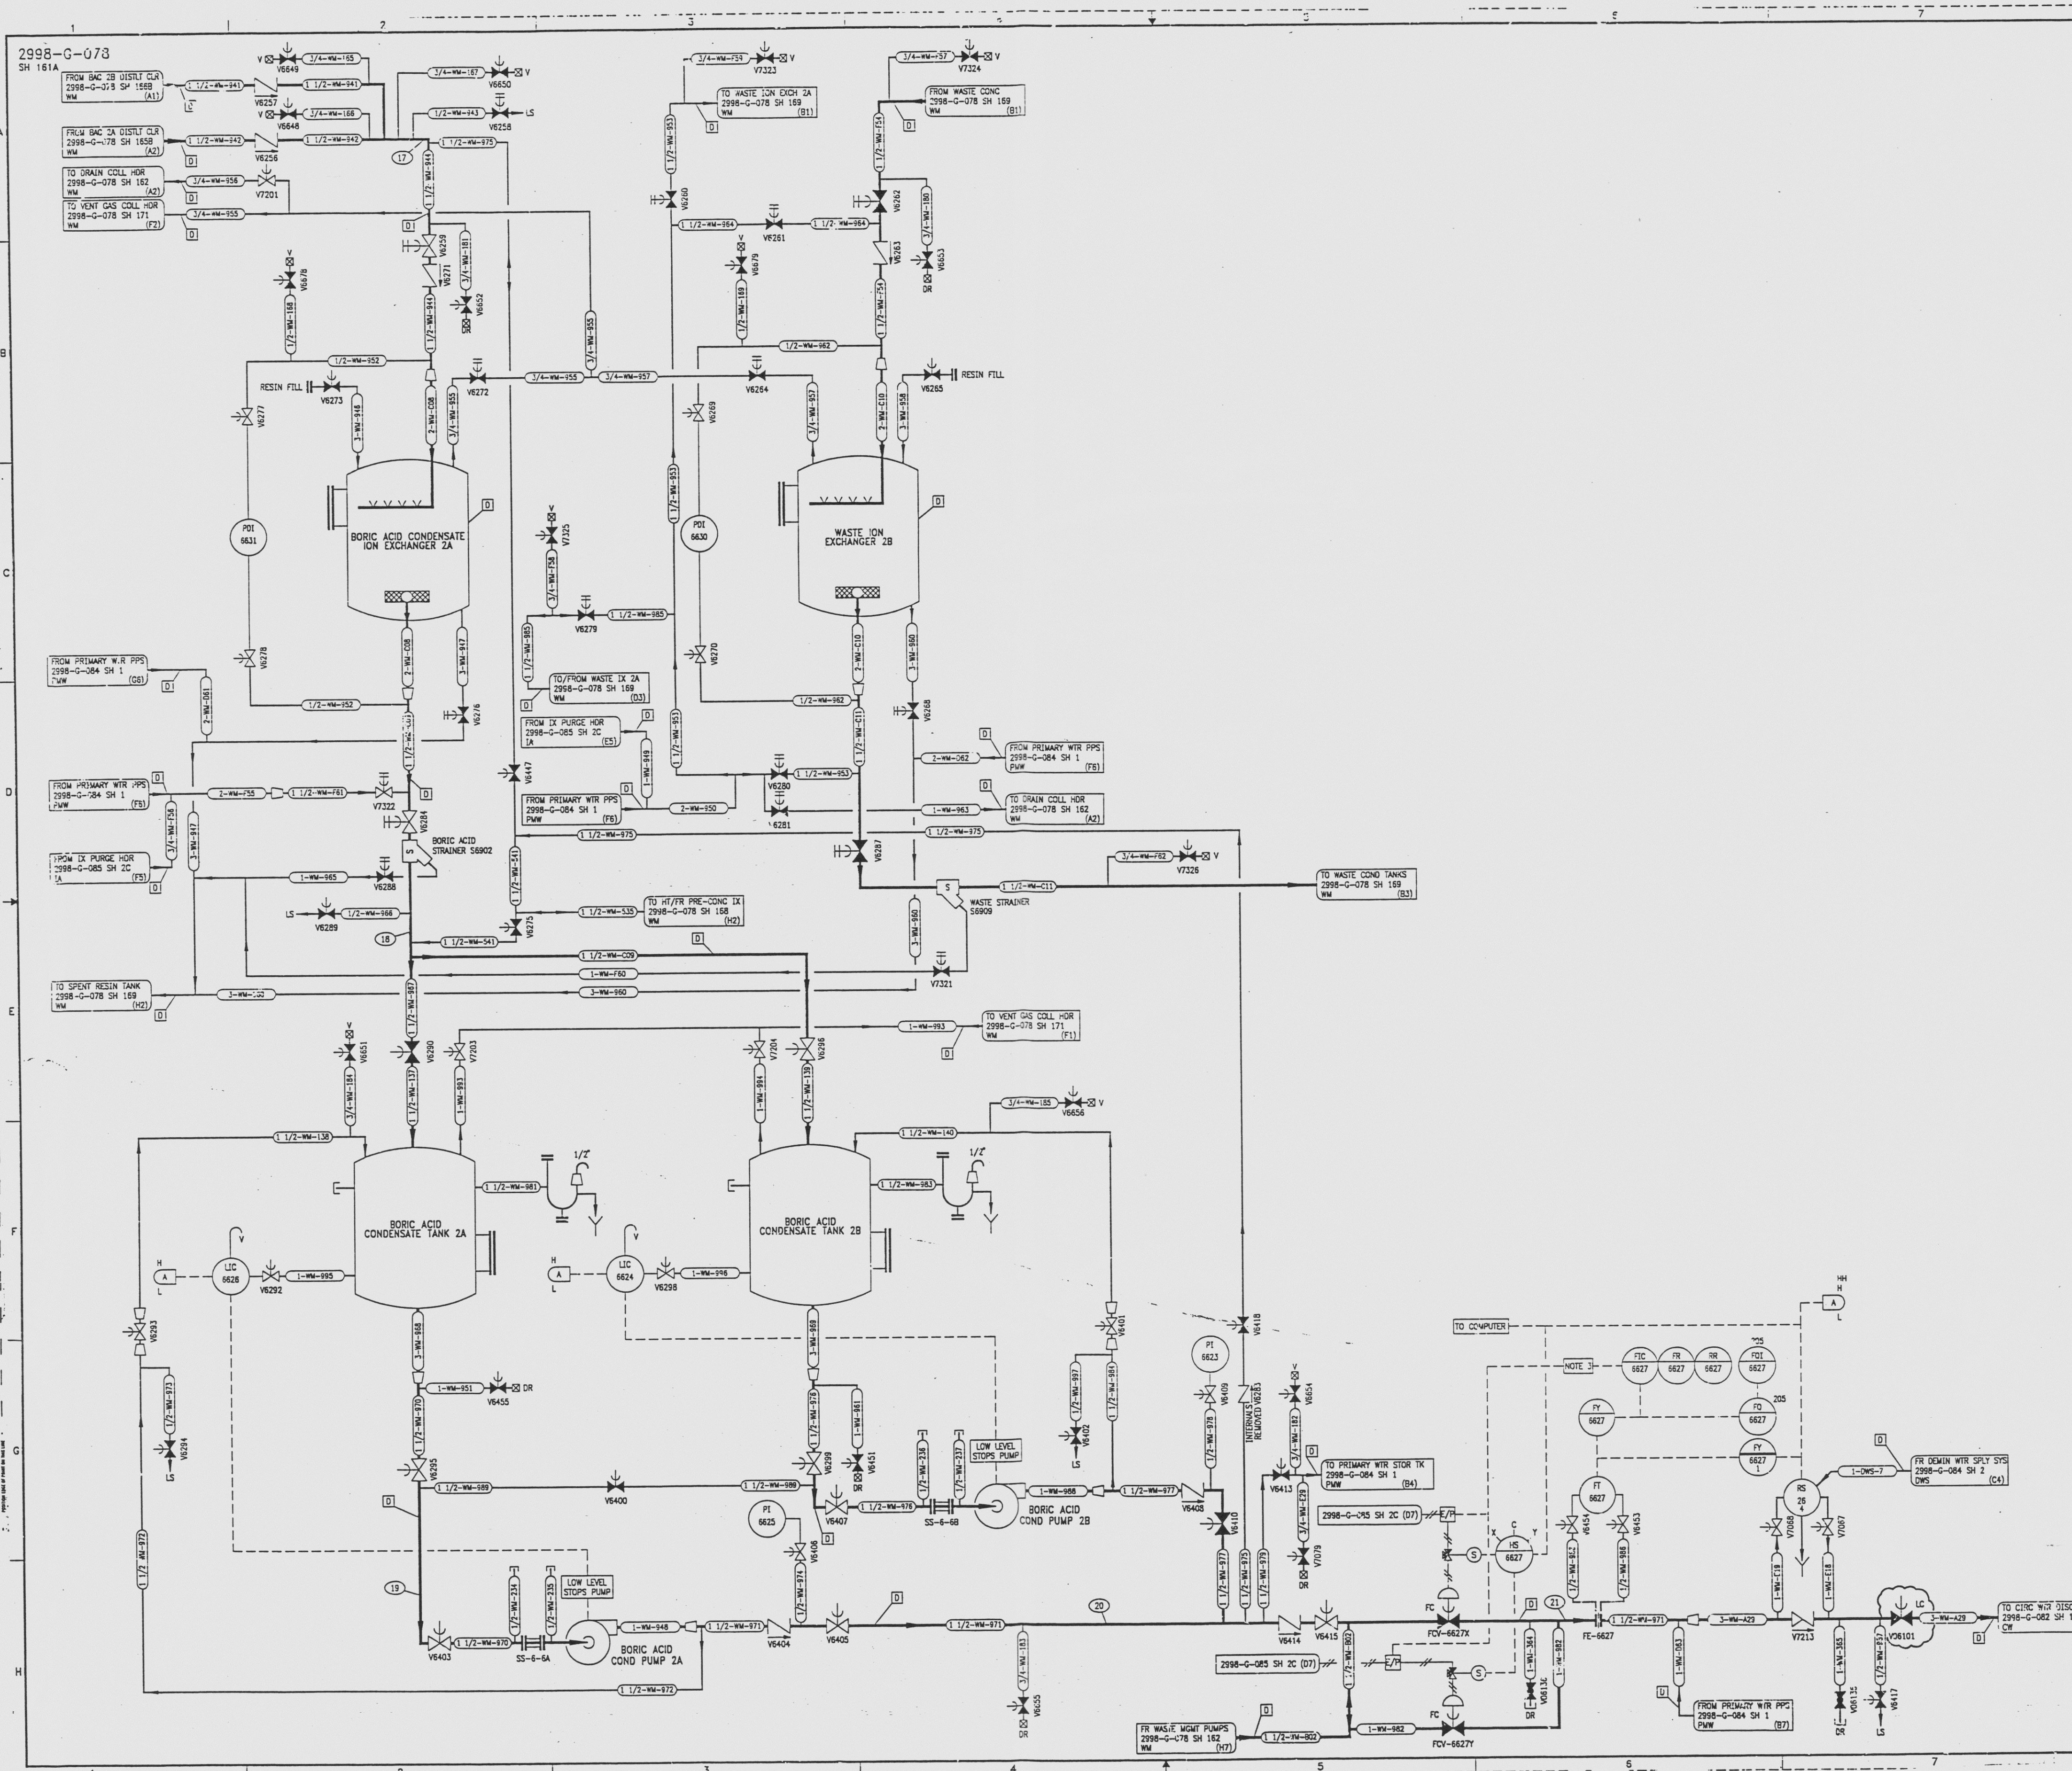

| REVISIONS |         |             |     |    |
|-----------|---------|-------------|-----|----|
| NO        | DATE    | DESCRIPTION | BY  | CH |
| 8         | 7/24/95 | DESCRIPTION | JGD | HS |
| 9         | 8/8/96  | DESCRIPTION | CM  | HS |
| 10        | 10-4-96 | DESCRIPTION | WZ  | HS |

NOTES

- LOCAL ALARMS ARE GROUPED ON A LOCAL PANEL. THE LOCAL PANEL HAS AN ANNUNCIATOR IN THE CONTROL ROOM.
- BORIC ACID CONDENSATE PUMPS STOP ON PRIMARY WATER STORAGE TANK HIGH LEVEL.
- VALVES FCV-5627X AND FCV-5627Y CLOSE ON HIGH RADIATION.

REFERENCE DRAWINGS

| PIPING, VALVES & INSTRUMENT SYMBOLS | 2998-G-078 SH 100 |
|-------------------------------------|-------------------|
| VALVE LIST                          | 2998-G-051        |
| LINE LIST                           | 2998-G-052        |
| VALVE OPERATIONAL NUMBER INDEX      | 2998-G-057A       |
| INSTRUMENT INSTALLATION DETAILS     | 2998-G-231        |
| INSTRUMENT LIST                     | 2998-G-2700       |

INFORMATION ONLY  
VERIFY WITH A CONTROLLED COPY BEFORE USE.

NOTE: THIS DRAWING IS MADE FROM REV. 7 OF DRAWING 2998-G-078 SH 151

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 11.2-5

FLORIDA POWER & LIGHT COMPANY  
ST LUCIE PLANT  
1983 - 850 MW EXTENSION - UNIT 2  
FLOW DIAGRAM  
WASTE MANAGEMENT SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.

| SCALE: NONE | APPROVAL | DATE       |
|-------------|----------|------------|
| CHK: J. GEE |          | 2998-G-078 |
| CHK: J. GEE |          | 1983       |
| CHK: J. GEE |          | 151        |

9906040221-110

E APERTURE CARD