


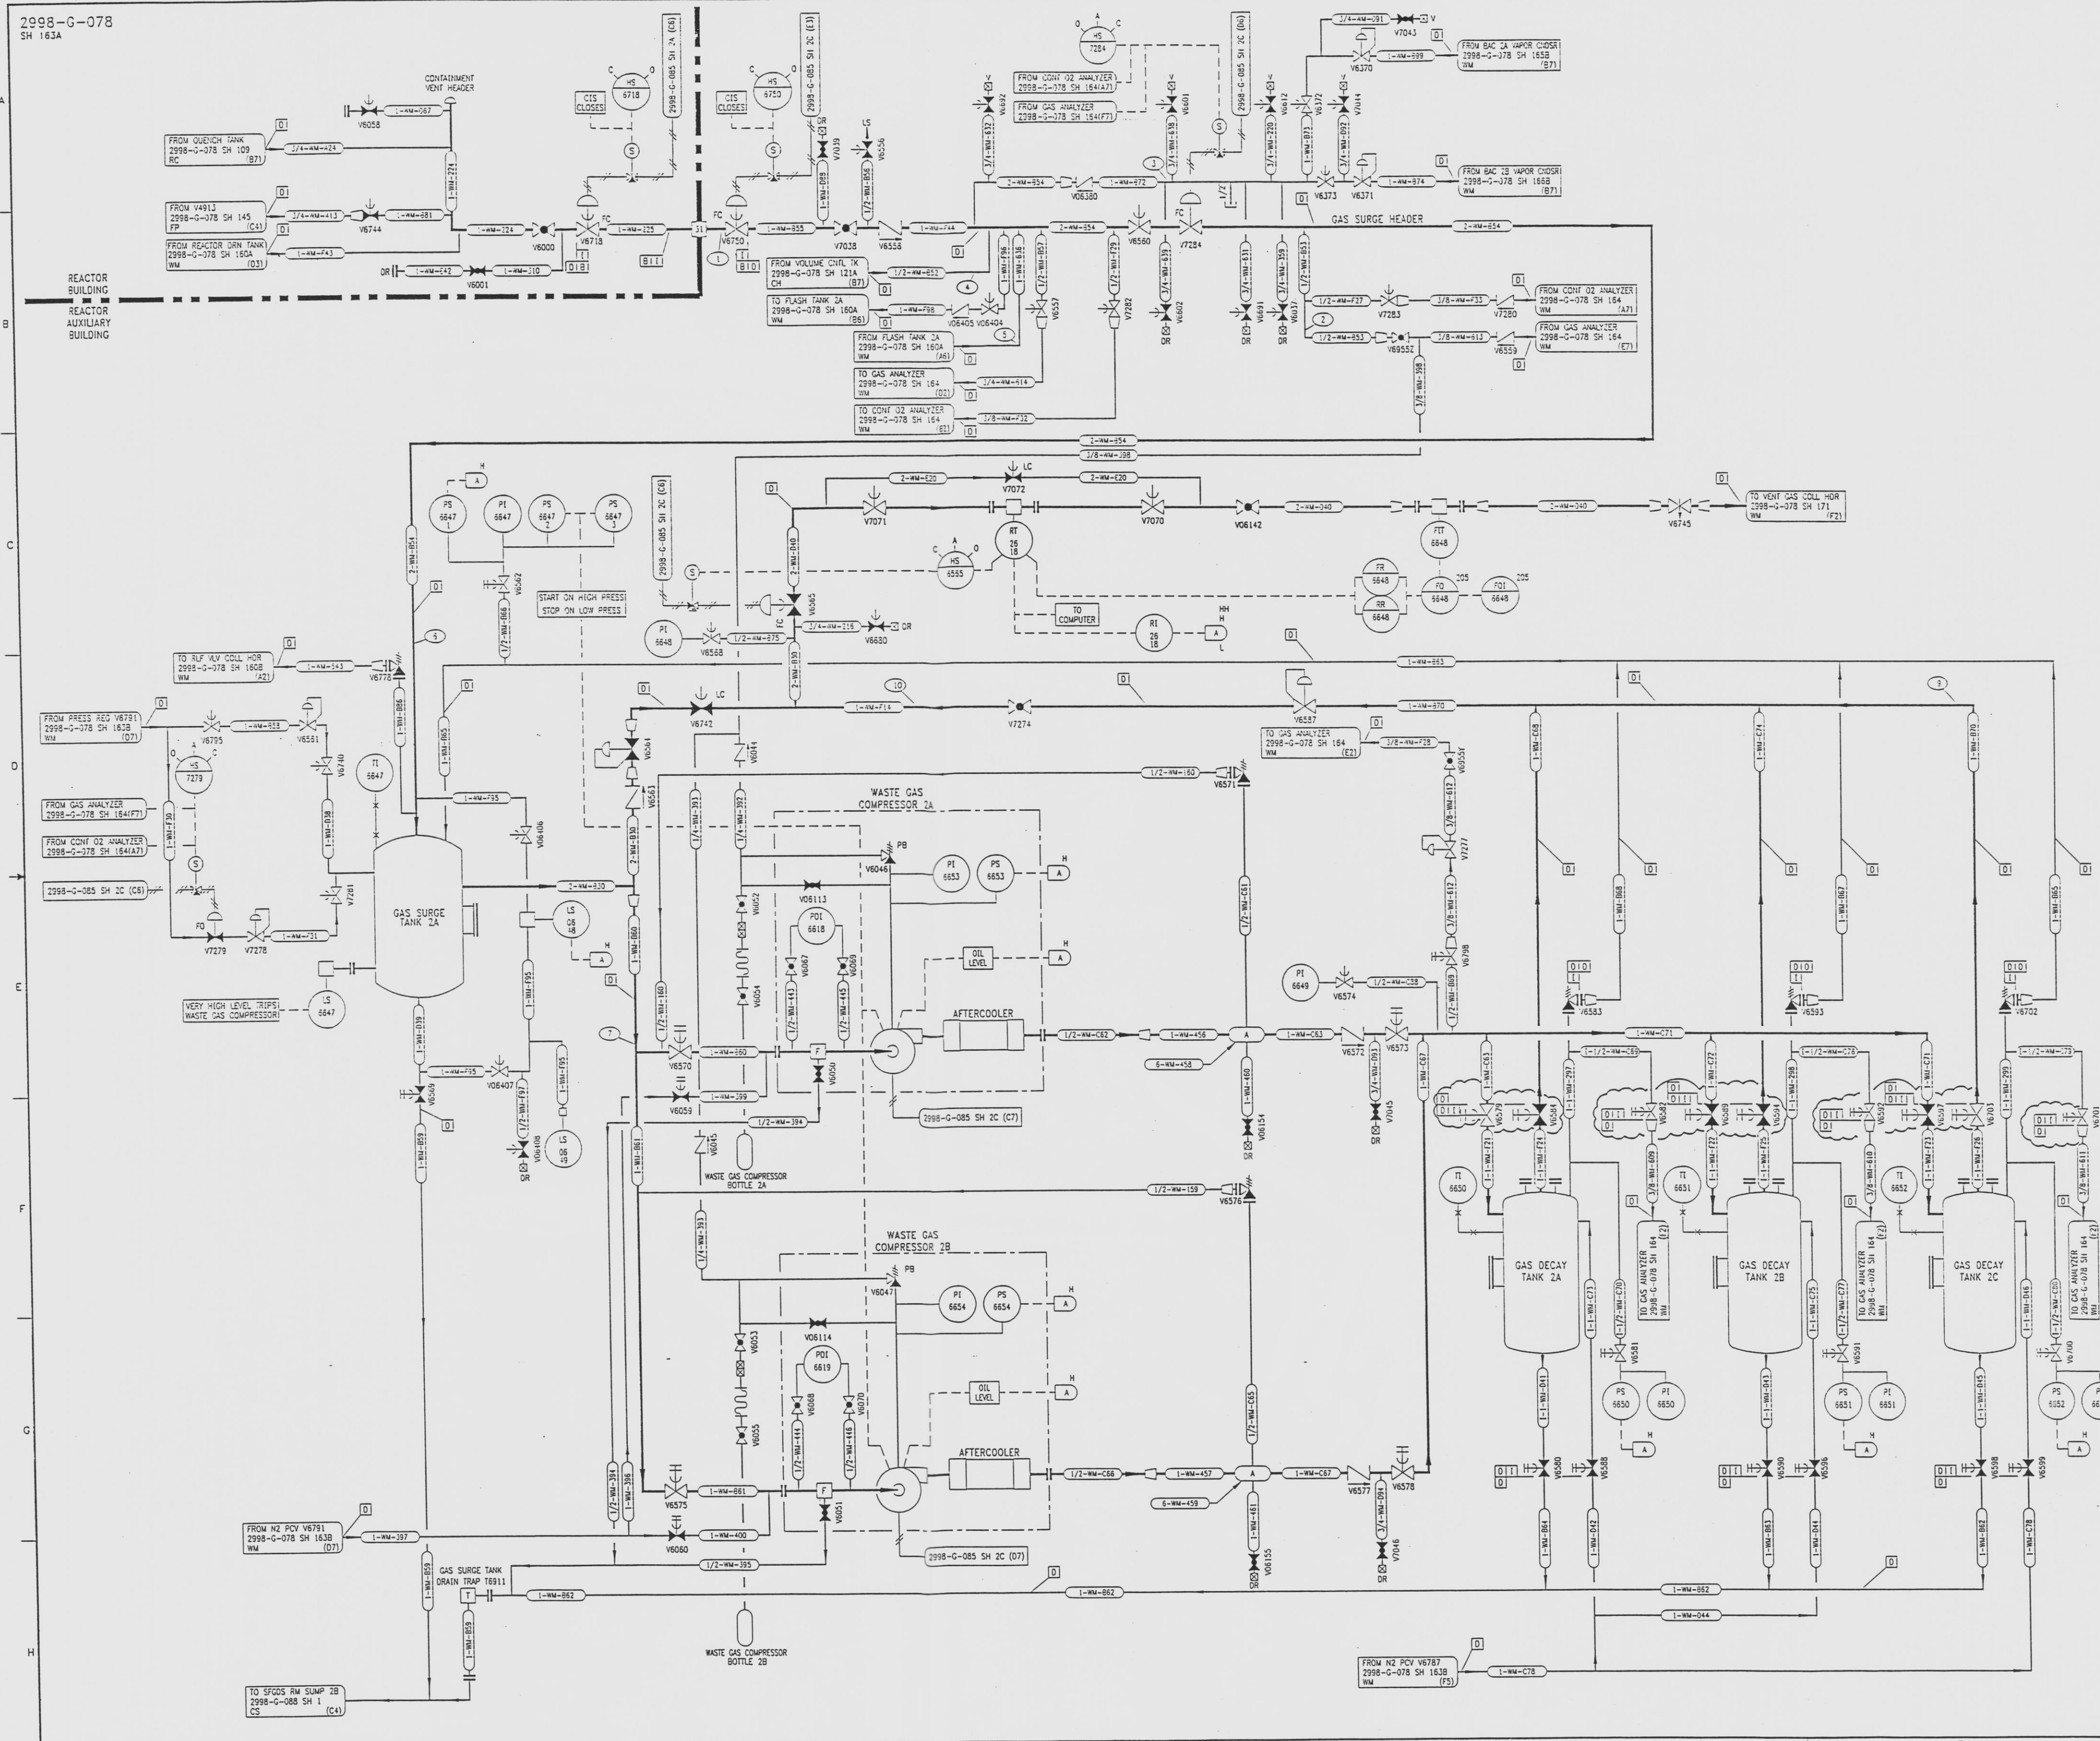


REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
11	7/24/95	DESCRIPTION	JCC	JJZ
12	8/8/96	DESCRIPTION	HUF	JJZ
13	10/4/96	DESCRIPTION	MZ	JJZ
14	9/24/97	DESCRIPTION	DM	VR
15	2/16/98	DESCRIPTION	DM	JJZ

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.

NOTE: LOCAL ALARMS ARE GROUPED ON SEVERAL LOCAL PANELS. EACH LOCAL PANEL HAS AN ANNUNCIATOR IN THE CONTROL ROOM.

REFERENCE DRAWINGS
PIPE VALVE & INSTRUMENT SYMBOLS 2998-G-078 SH 100
VALVE LIST 2998-G-078 SH 101
LINE LIST 2998-G-078 SH 102
WASTE OPERATIONAL NUMBER INDEX 2998-G-078 SH 103
INSTRUMENT INSTALLATION DETAILS 2998-G-078 SH 104
INSTRUMENT LIST 2998-G-078 SH 105

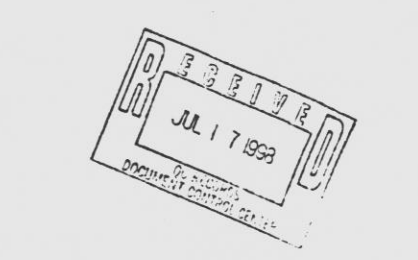

NOTE: THIS DRAWING IS MADE FROM REV. 10 OF DRAWING 2998-G-078 SH 163.

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 11.3-1			
NUCLEAR SAFETY RELATED - IN PART ONLY			
FLORIDA POWER & LIGHT COMPANY ST. LUCIE PLANT 1983 - 890 MW EXTENSION - UNIT 2 FLOW DIAGRAM WASTE MANAGEMENT SYSTEM			
RAYTHEON ENGINEERS & CONSTRUCTORS, INC.			
SCALE: NONE	APPROVAL	DATE	
DR: MECH		2998-G-078	
DR: JCC		SHEET	
DR: CHENNINGHAM		163A	

9906040221 - 112

