


2998-G-078
SH 1618

REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
B	7-24-85			
2998-G-078 SH 1618				

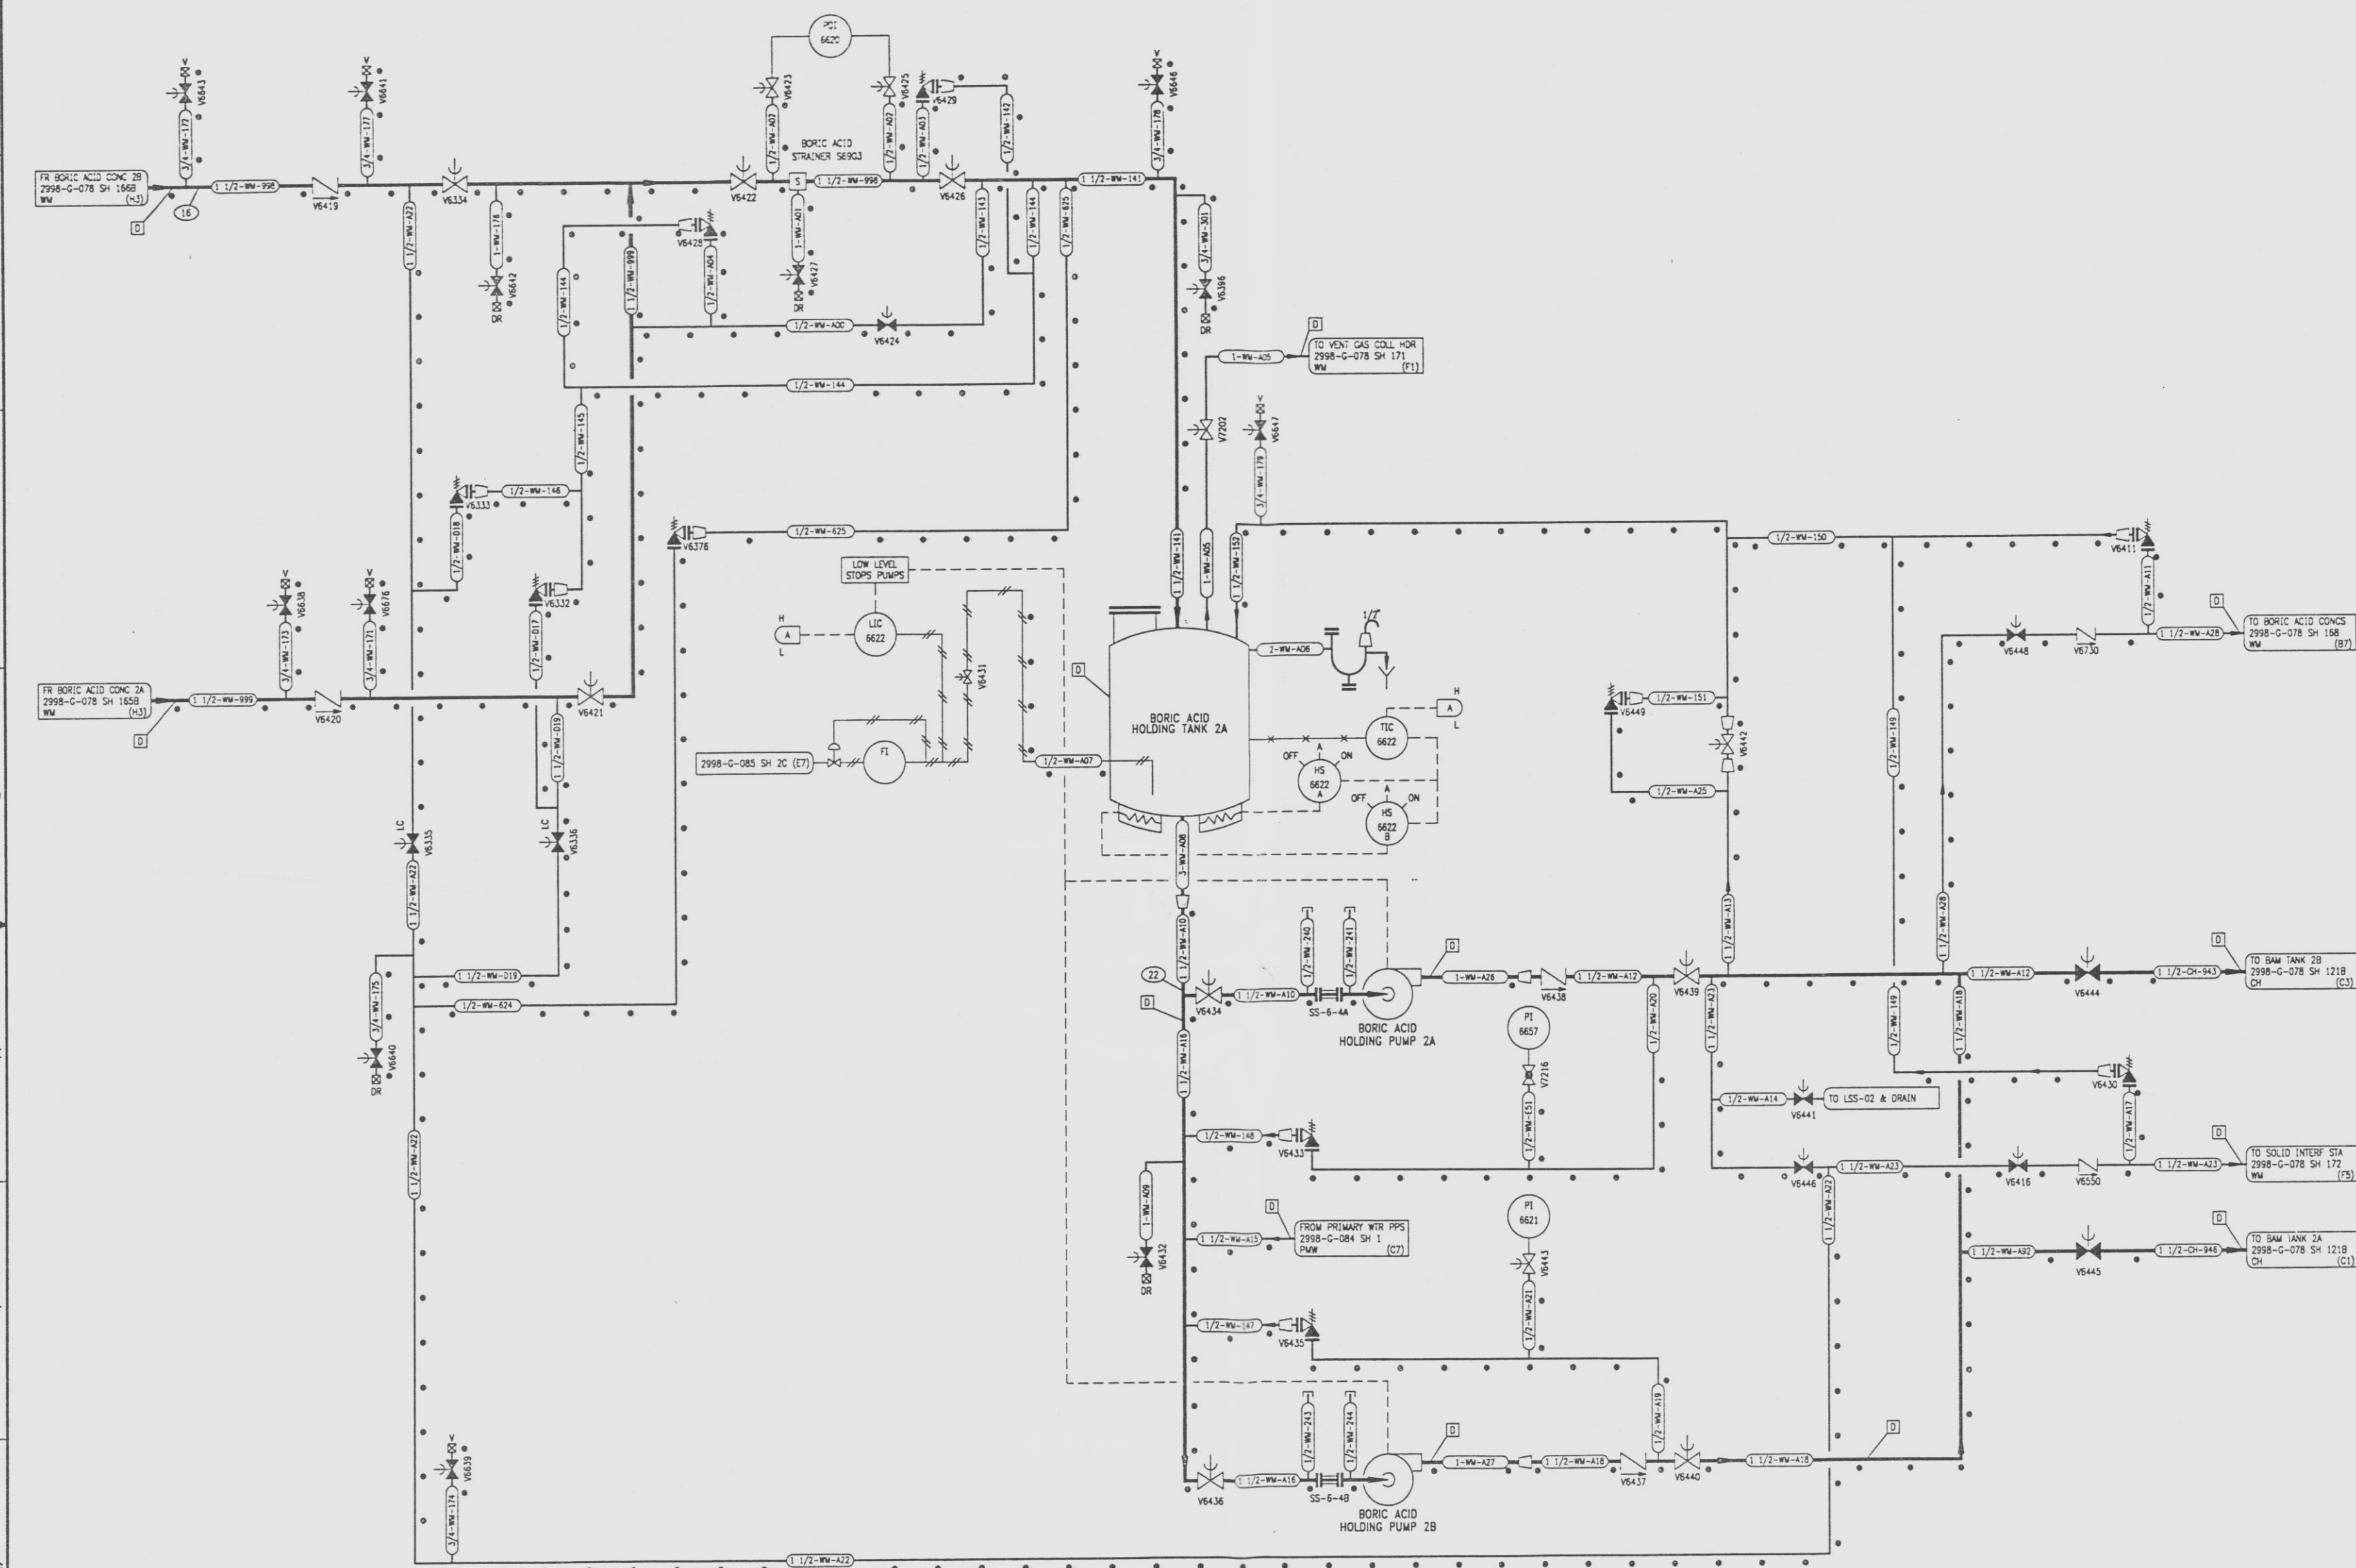

NOTES
FOR NOTES & REFERENCE DRAWINGS SEE 2998-G-078 SH 161A.

NOTE:
THIS DRAWING IS MADE FROM REV. 2
OF DRAWING 2998-G-078 SH 161.

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF
THE FOLLOWING DOCUMENT: FSAR FIGURE 11.2-5

**NUCLEAR SAFETY RELATED
IN PART ONLY**

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
:83 - 890 MW EXTENSION - UNIT 2
FLOW DIAGRAM
WASTE MANAGEMENT
SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.		
SCALE: NONE	APPROVAL	DATE
DR: MECH		2998-G-078
DR: L. OPT		SHEET
CH: J. SULLIVAN		1618
		8

2998-G-078 SH 161B

9607170092-54

D