


2998-G-096
SH 1C

REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
7	7/24/95	2998-SW-54-001: REGRAP	CJC	WJP
8	9-4-96	2998-SW-58-001: REVISE (3), DELETE "BOTTOM"	JCM	WJP

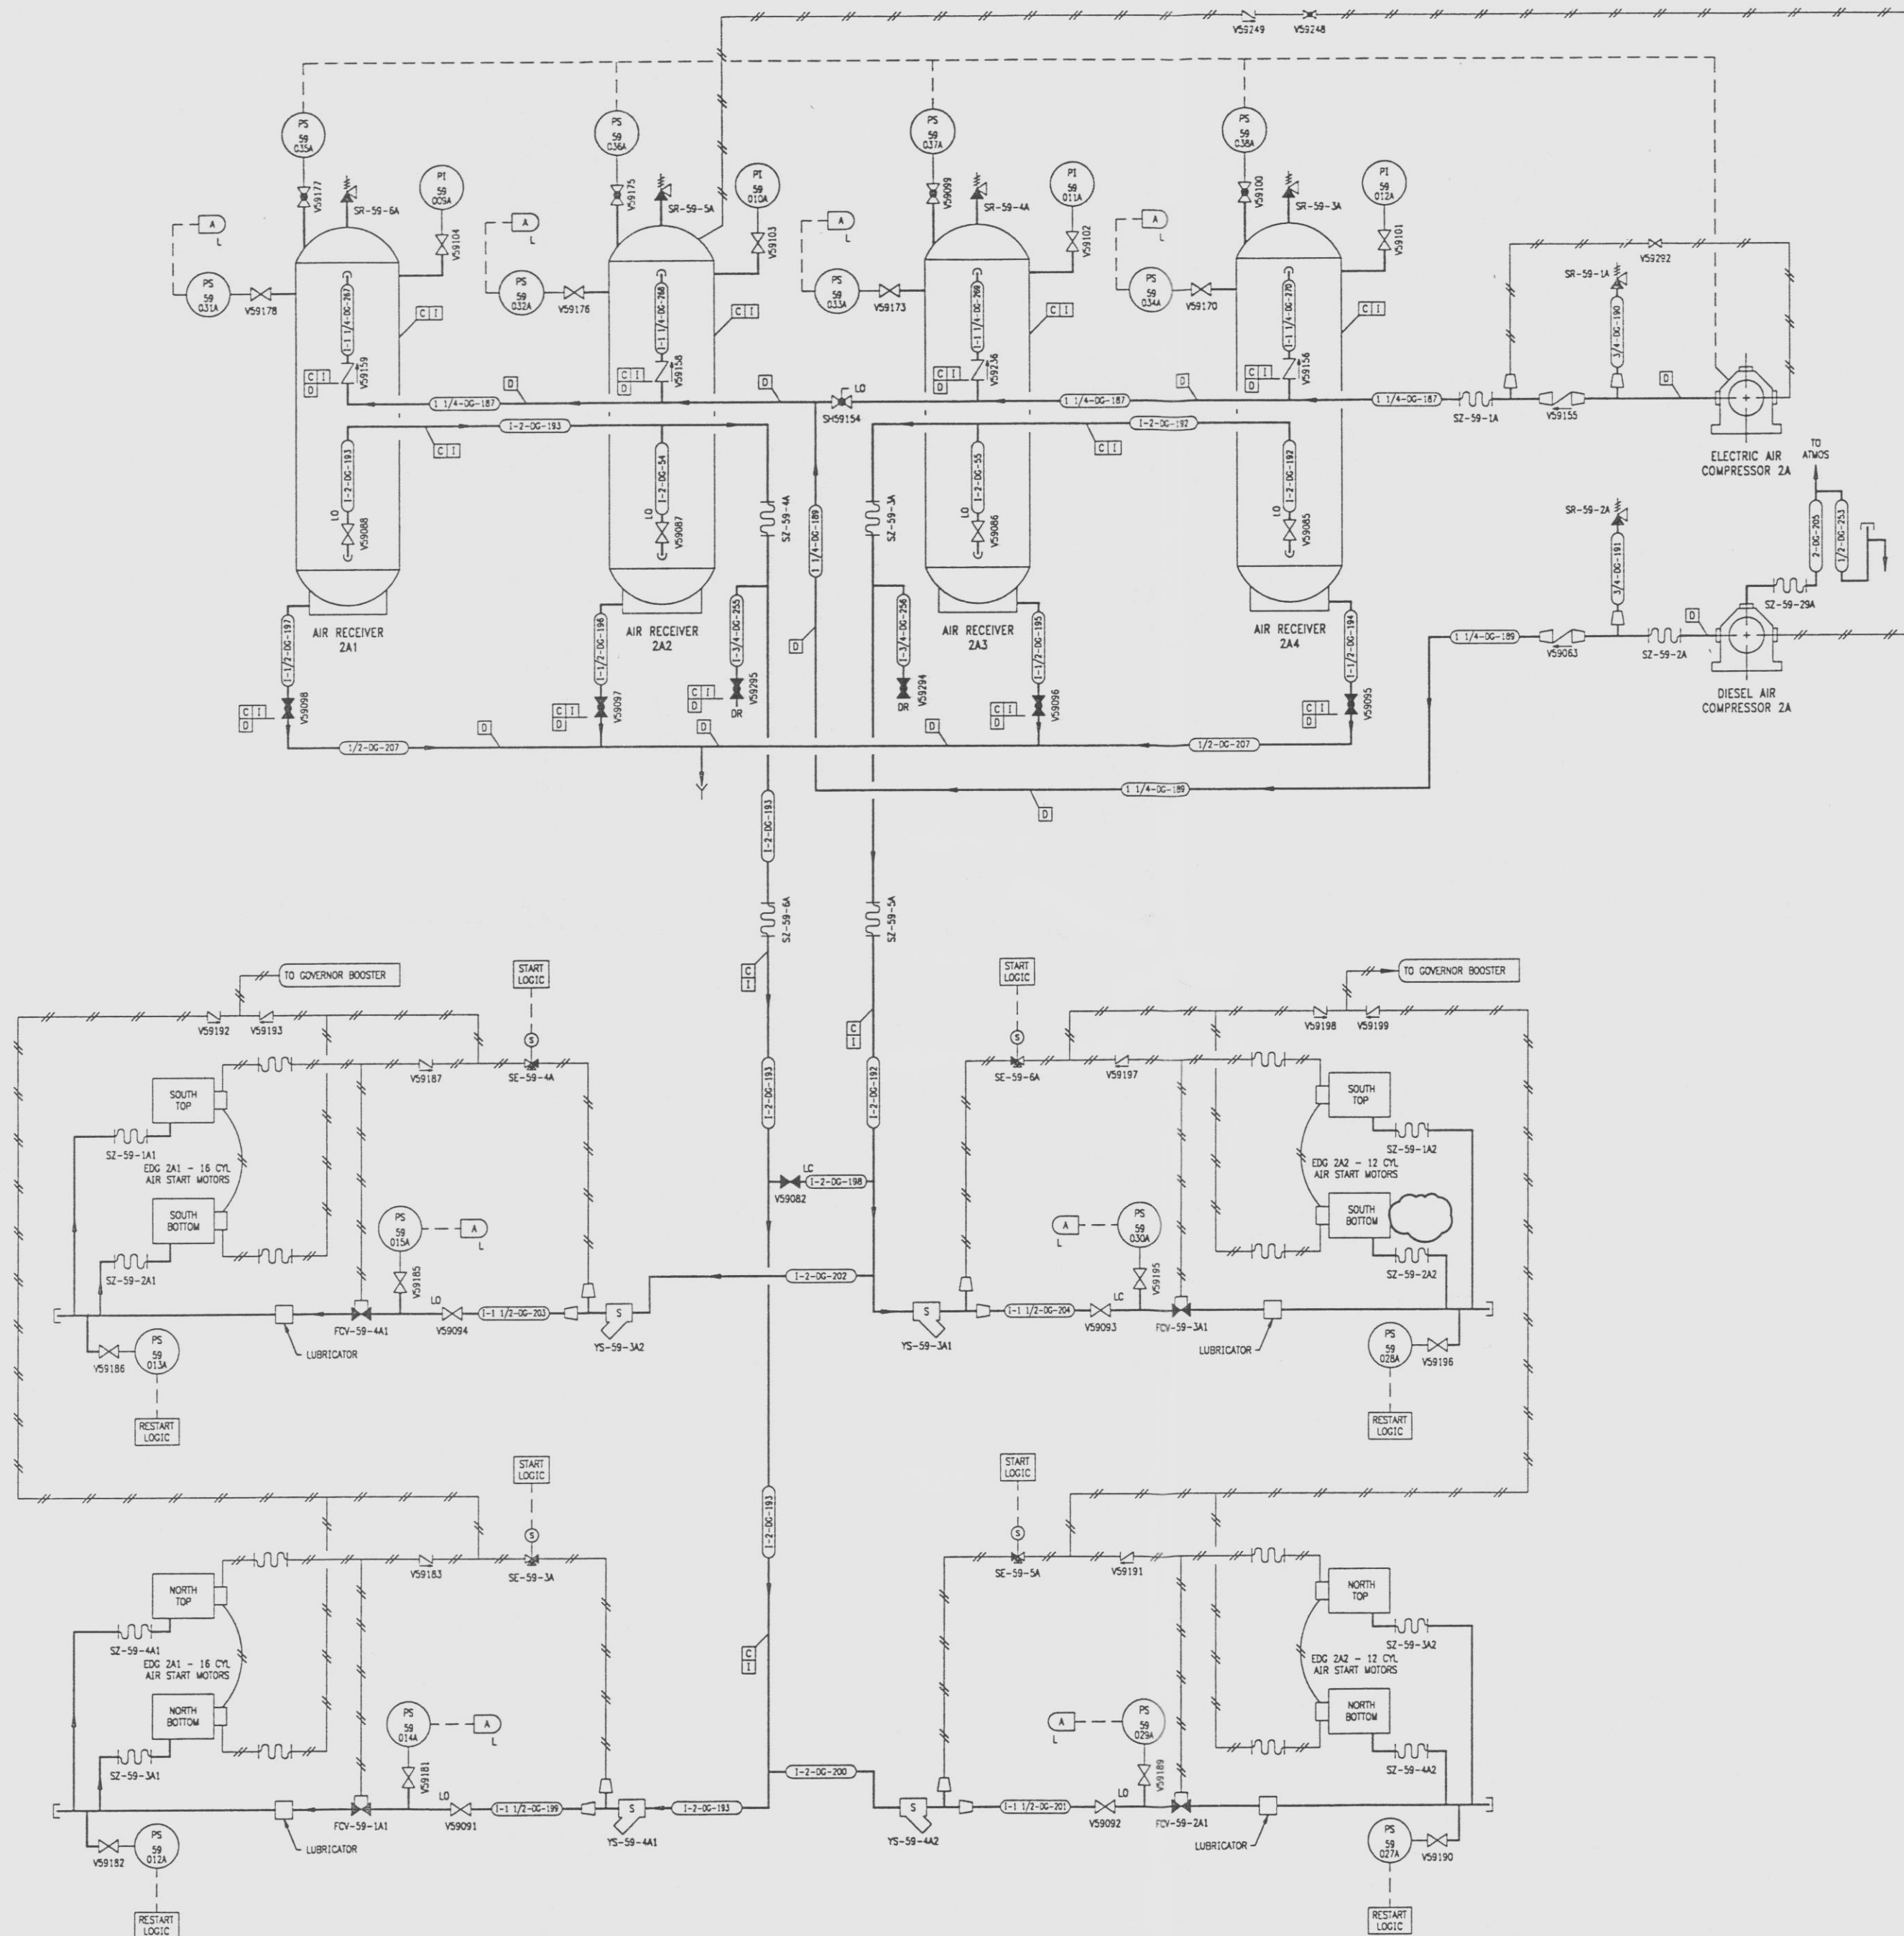

NOTE:
LOCAL ALARMS ARE GROUPED ON A LOCAL PANEL. THE LOCAL PANEL HAS AN ANNUNCIATOR IN THE CONTROL ROOM ON RTGB 201.

REFERENCE DRAWINGS
PIPE, VALVE & INSTRUMENT SYMBOLS 2998-G-078 SH 100
VALVE LIST 2998-A-051
LINE LIST 2998-B-052
VALVE OPERATIONAL NUMBER INDEX 2998-B-057A
INSTRUMENT INSTALLATION DETAILS 2998-B-231
INSTRUMENT LIST 2998-B-270C

NOTE:
THIS DRAWING IS MADE FROM REV. 6
OF DRAWING 2998-G-096 SH 1

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.5-7

NUCLEAR SAFETY RELATED
IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983 - 890 Mw EXTENSION - UNIT 2
FLOW DIAGRAM
EMERGENCY DIESEL GENERATOR SYSTEM
AIR START PACKAGE 2A

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.
SCALE: NONE
APPROVAL
DATE: 2998-G-096
SHEET 1C

2998-G-096 SH. 1C

9607170092-107