



2998-B-327 SH.97

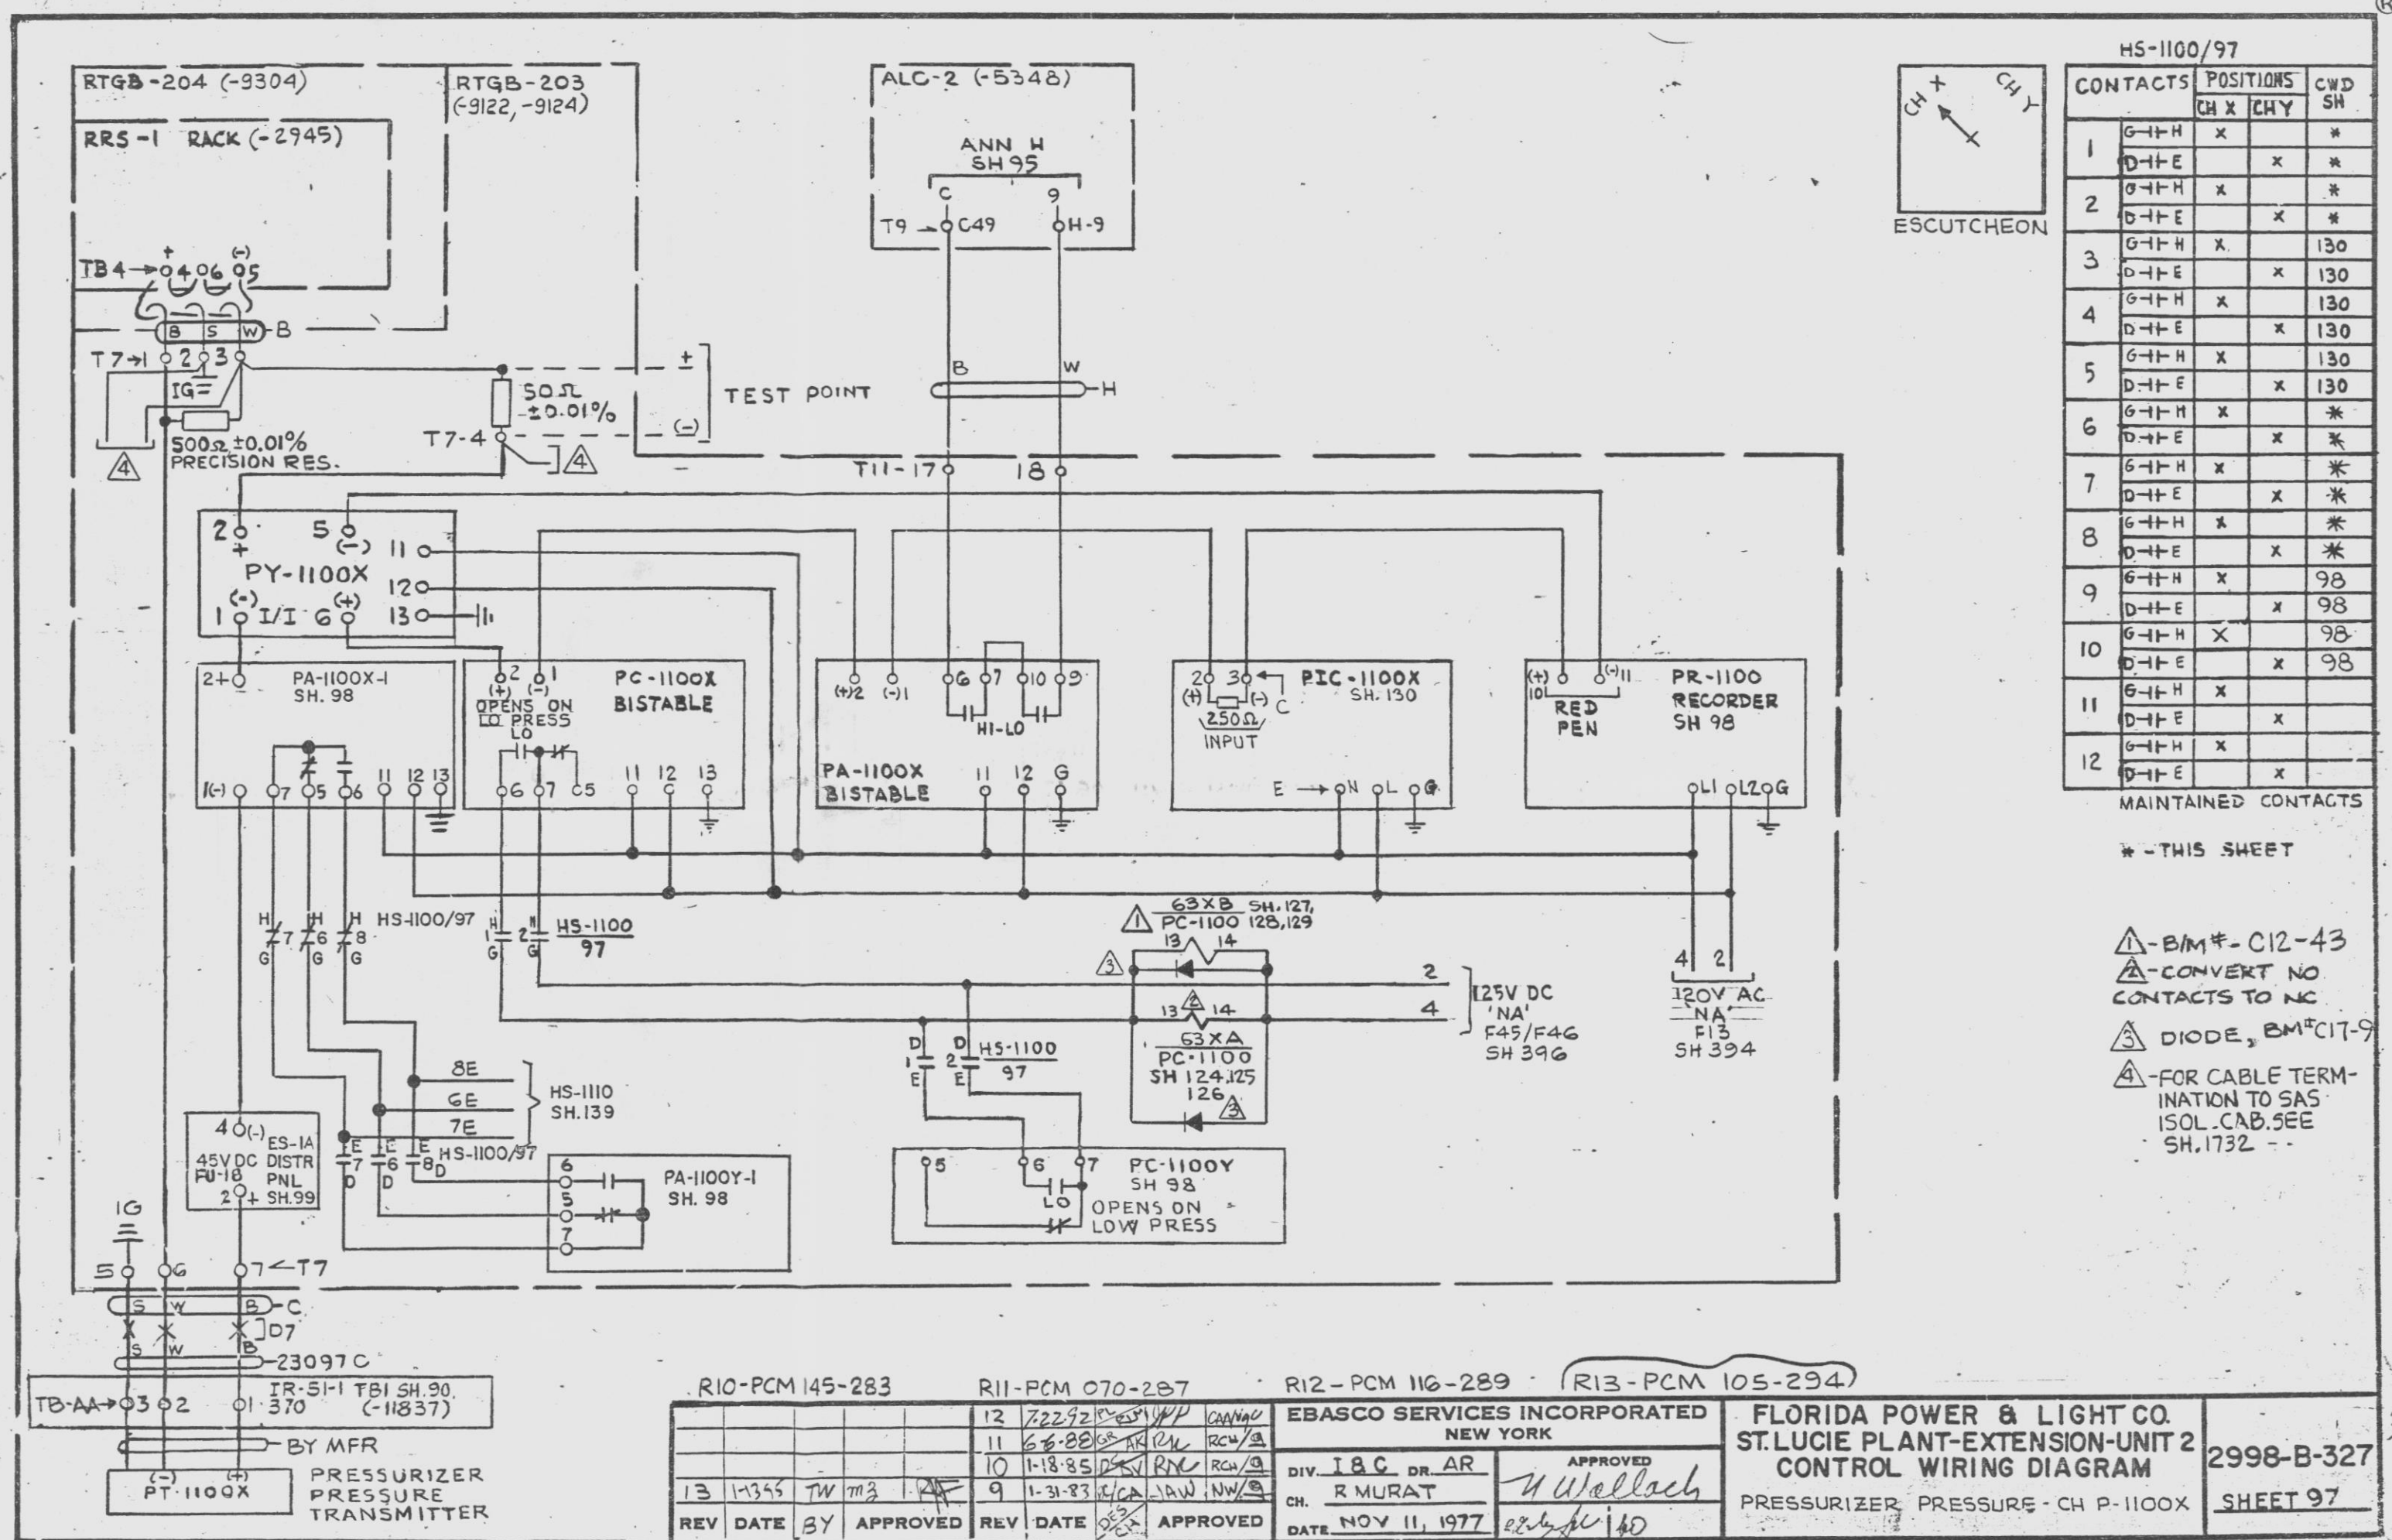

HS-1100/97			
CONTACTS	POSITIONS		CWD SH
	CH X	CH Y	
1	G-I-H	x	*
	D-I-E	x	*
2	G-I-H	x	*
	D-I-E	x	*
3	G-I-H	x	130
	D-I-E	x	130
4	G-I-H	x	130
	D-I-E	x	130
5	G-I-H	x	130
	D-I-E	x	130
6	G-I-H	x	*
	D-I-E	x	*
7	G-I-H	x	*
	D-I-E	x	*
8	G-I-H	x	*
	D-I-E	x	*
9	G-I-H	x	98
	D-I-E	x	98
10	G-I-H	x	98
	D-I-E	x	98
11	G-I-H	x	
	D-I-E	x	
12	G-I-H	x	
	D-I-E	x	

MAINTAINED CONTACTS

\* - THIS SHEET

- ⚠ - BM# - C12-43
- ⚠ - CONVERT NO CONTACTS TO NC
- ⚠ DIODE, BM# C17-9
- ⚠ - FOR CABLE TERMINATION TO SAS ISOL. CAB. SEE SH. 1732

TB-AA-0302  
 TR-5-1 T81 SH. 90 (-11837)  
 BY MFR  
 PT-1100X PRESSURIZER PRESSURE TRANSMITTER

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
12	7-22-92	...	...	10	1-18-85	...	...
11	6-6-80	...	...	9	1-31-83	...	...
13	1-3-85	...	...				

EBASCO SERVICES INCORPORATED  
 NEW YORK  
 DIV. I & C DR. AR  
 CH. R MURAT  
 DATE NOV 11, 1977  
 APPROVED  
 H. Wallach  
 FLORIDA POWER & LIGHT CO.  
 ST. LUCIE PLANT-EXTENSION-UNIT 2  
 CONTROL WIRING DIAGRAM  
 PRESSURIZER PRESSURE - CH P-1100X  
 2998-B-327  
 SHEET 97

9607170092 -137

D