


2998-B-327 SH.374

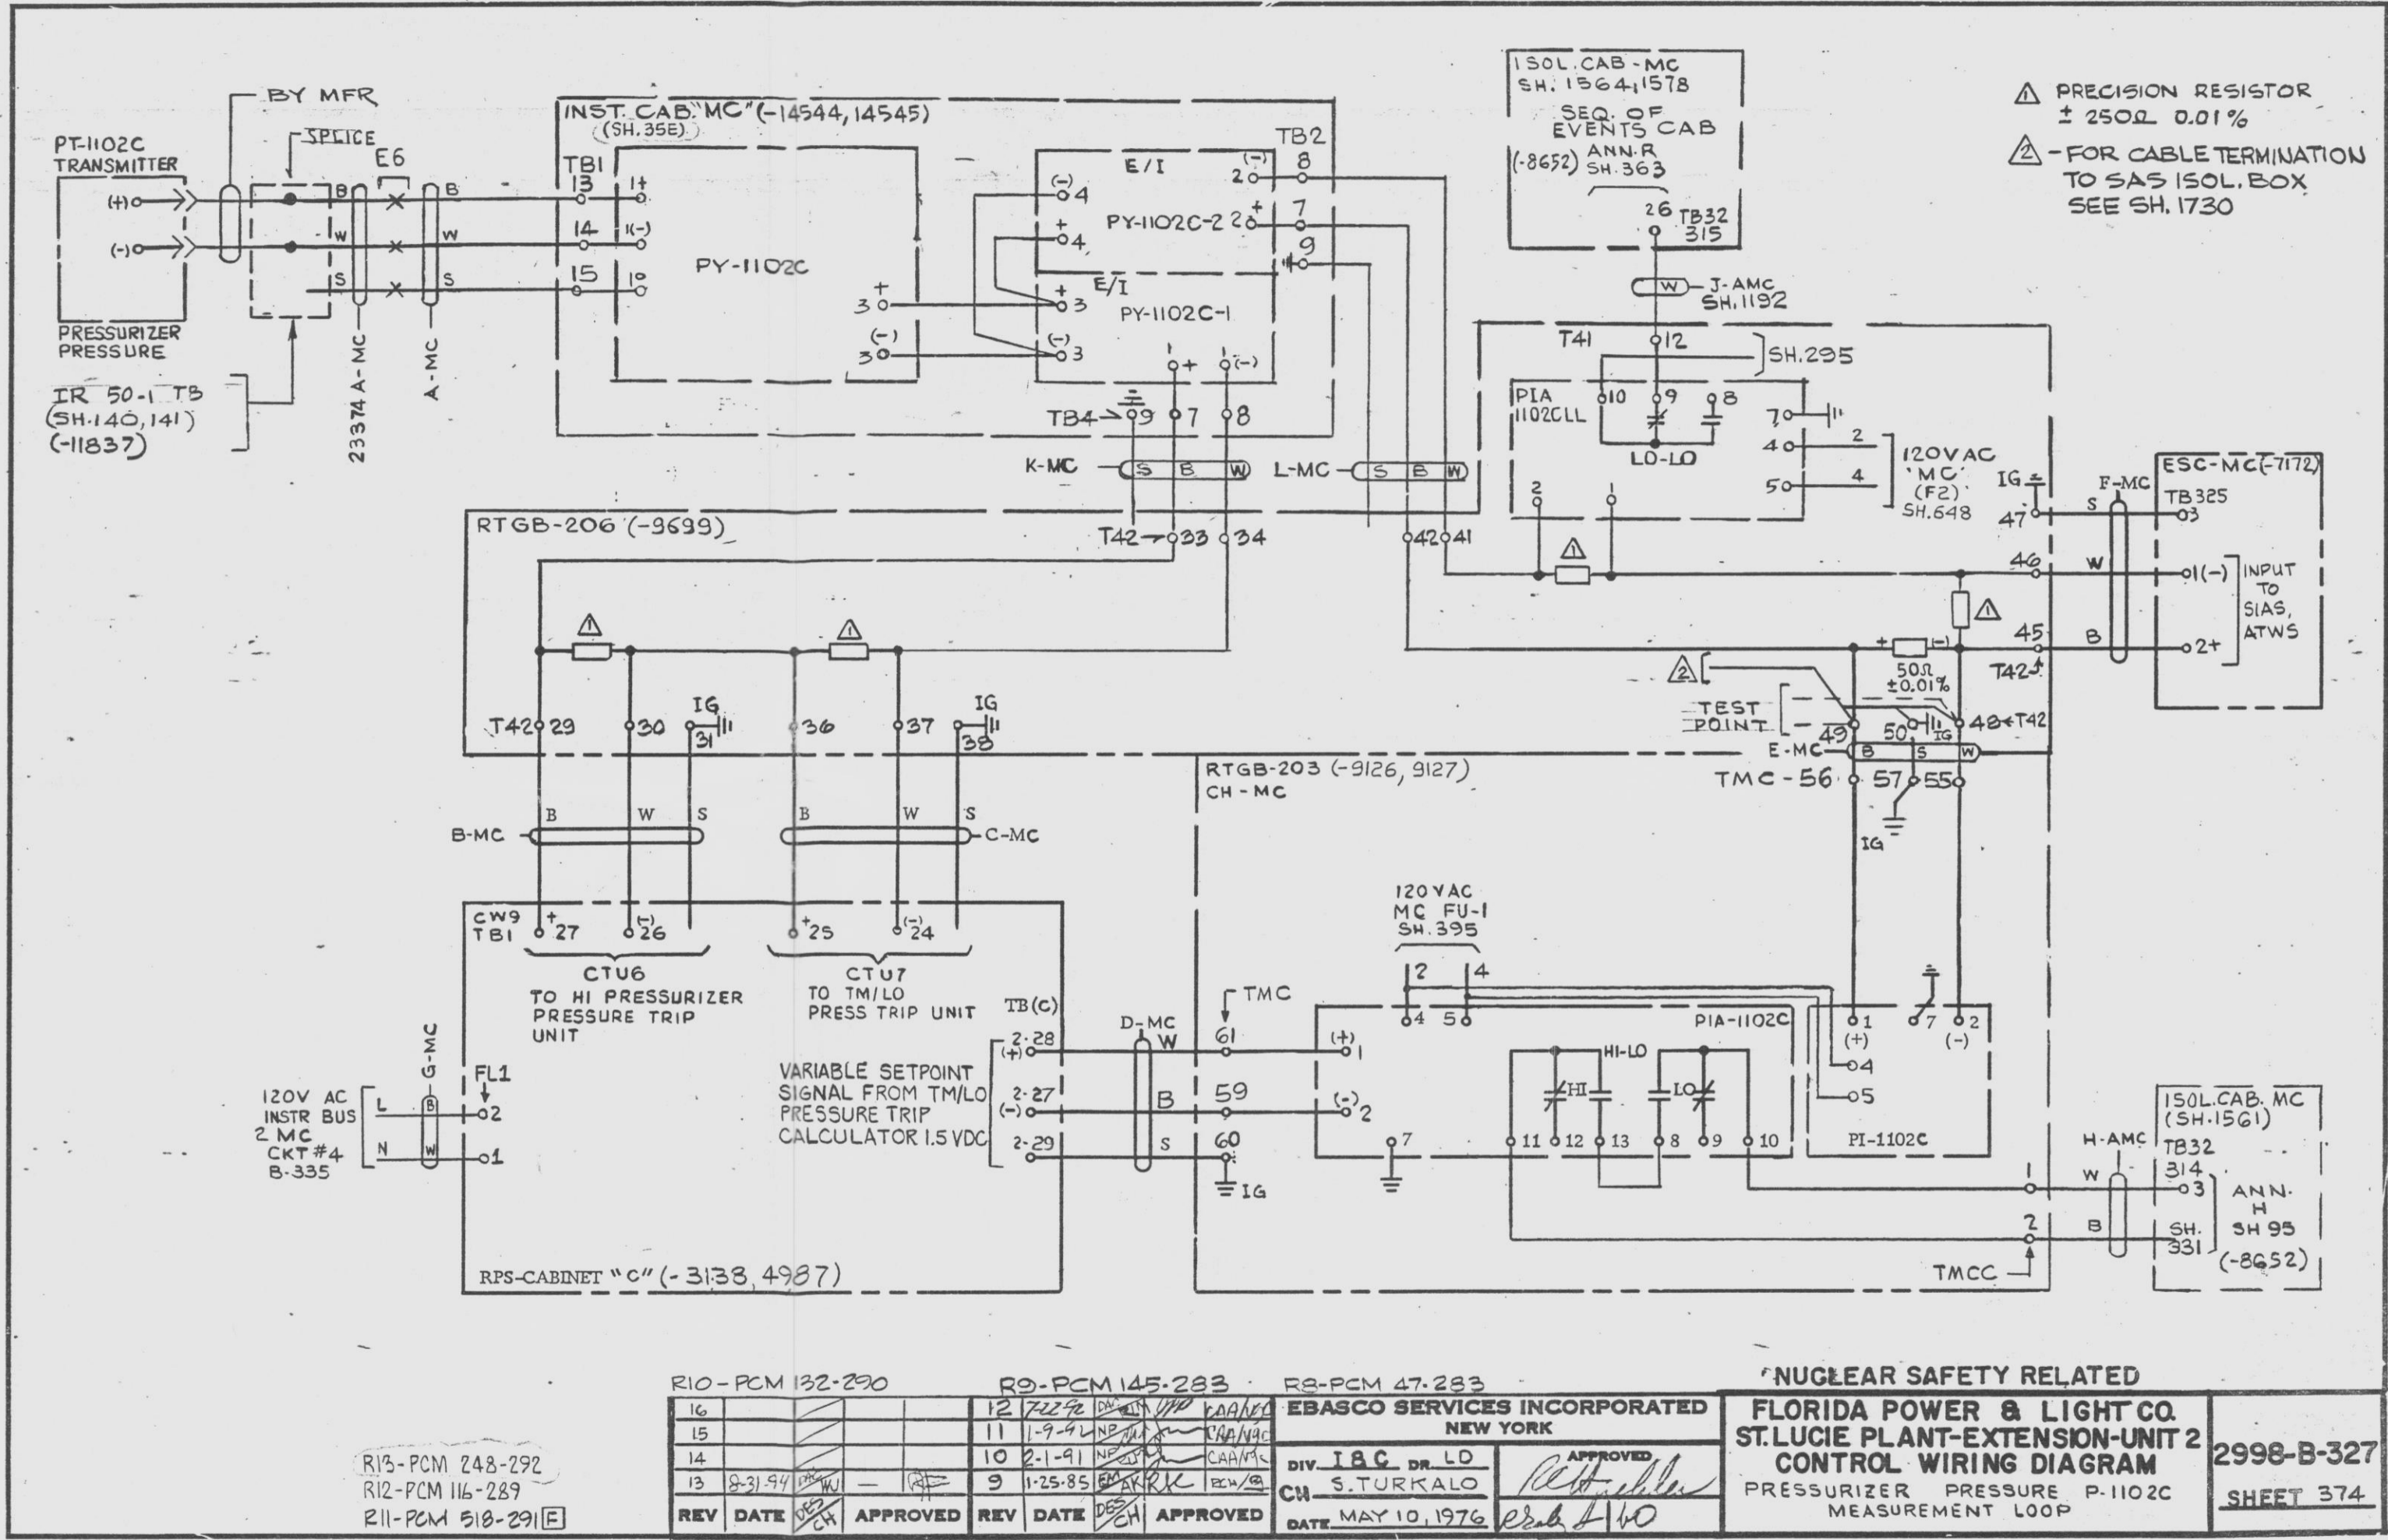

△ PRECISION RESISTOR  
± 250Ω 0.01%  
△ - FOR CABLE TERMINATION  
TO SAS ISOL. BOX  
SEE SH. 1730

R13-PCM 248-292  
R12-PCM 116-289  
R11-PCM 518-291

REV	DATE	APPROVED	REV	DATE	APPROVED
16			12	7-22-92	
15			11	1-9-91	
14			10	2-1-91	
13	8-31-94		9	1-25-85	

R10-PCM 132-290    R9-PCM 145-283    R8-PCM 47-283  
 DIV. I & C DR. LD    APPROVED  
 CH. S. TURKALO    DATE: MAY 10, 1976

NUCLEAR SAFETY RELATED  
 FLORIDA POWER & LIGHT CO.  
 ST. LUCIE PLANT-EXTENSION-UNIT 2  
 CONTROL WIRING DIAGRAM  
 PRESSURIZER PRESSURE P-1102C  
 MEASUREMENT LOOP  
 2998-B-327  
 SHEET 374

9607170092-142

D