


2998-B-327 SH.375

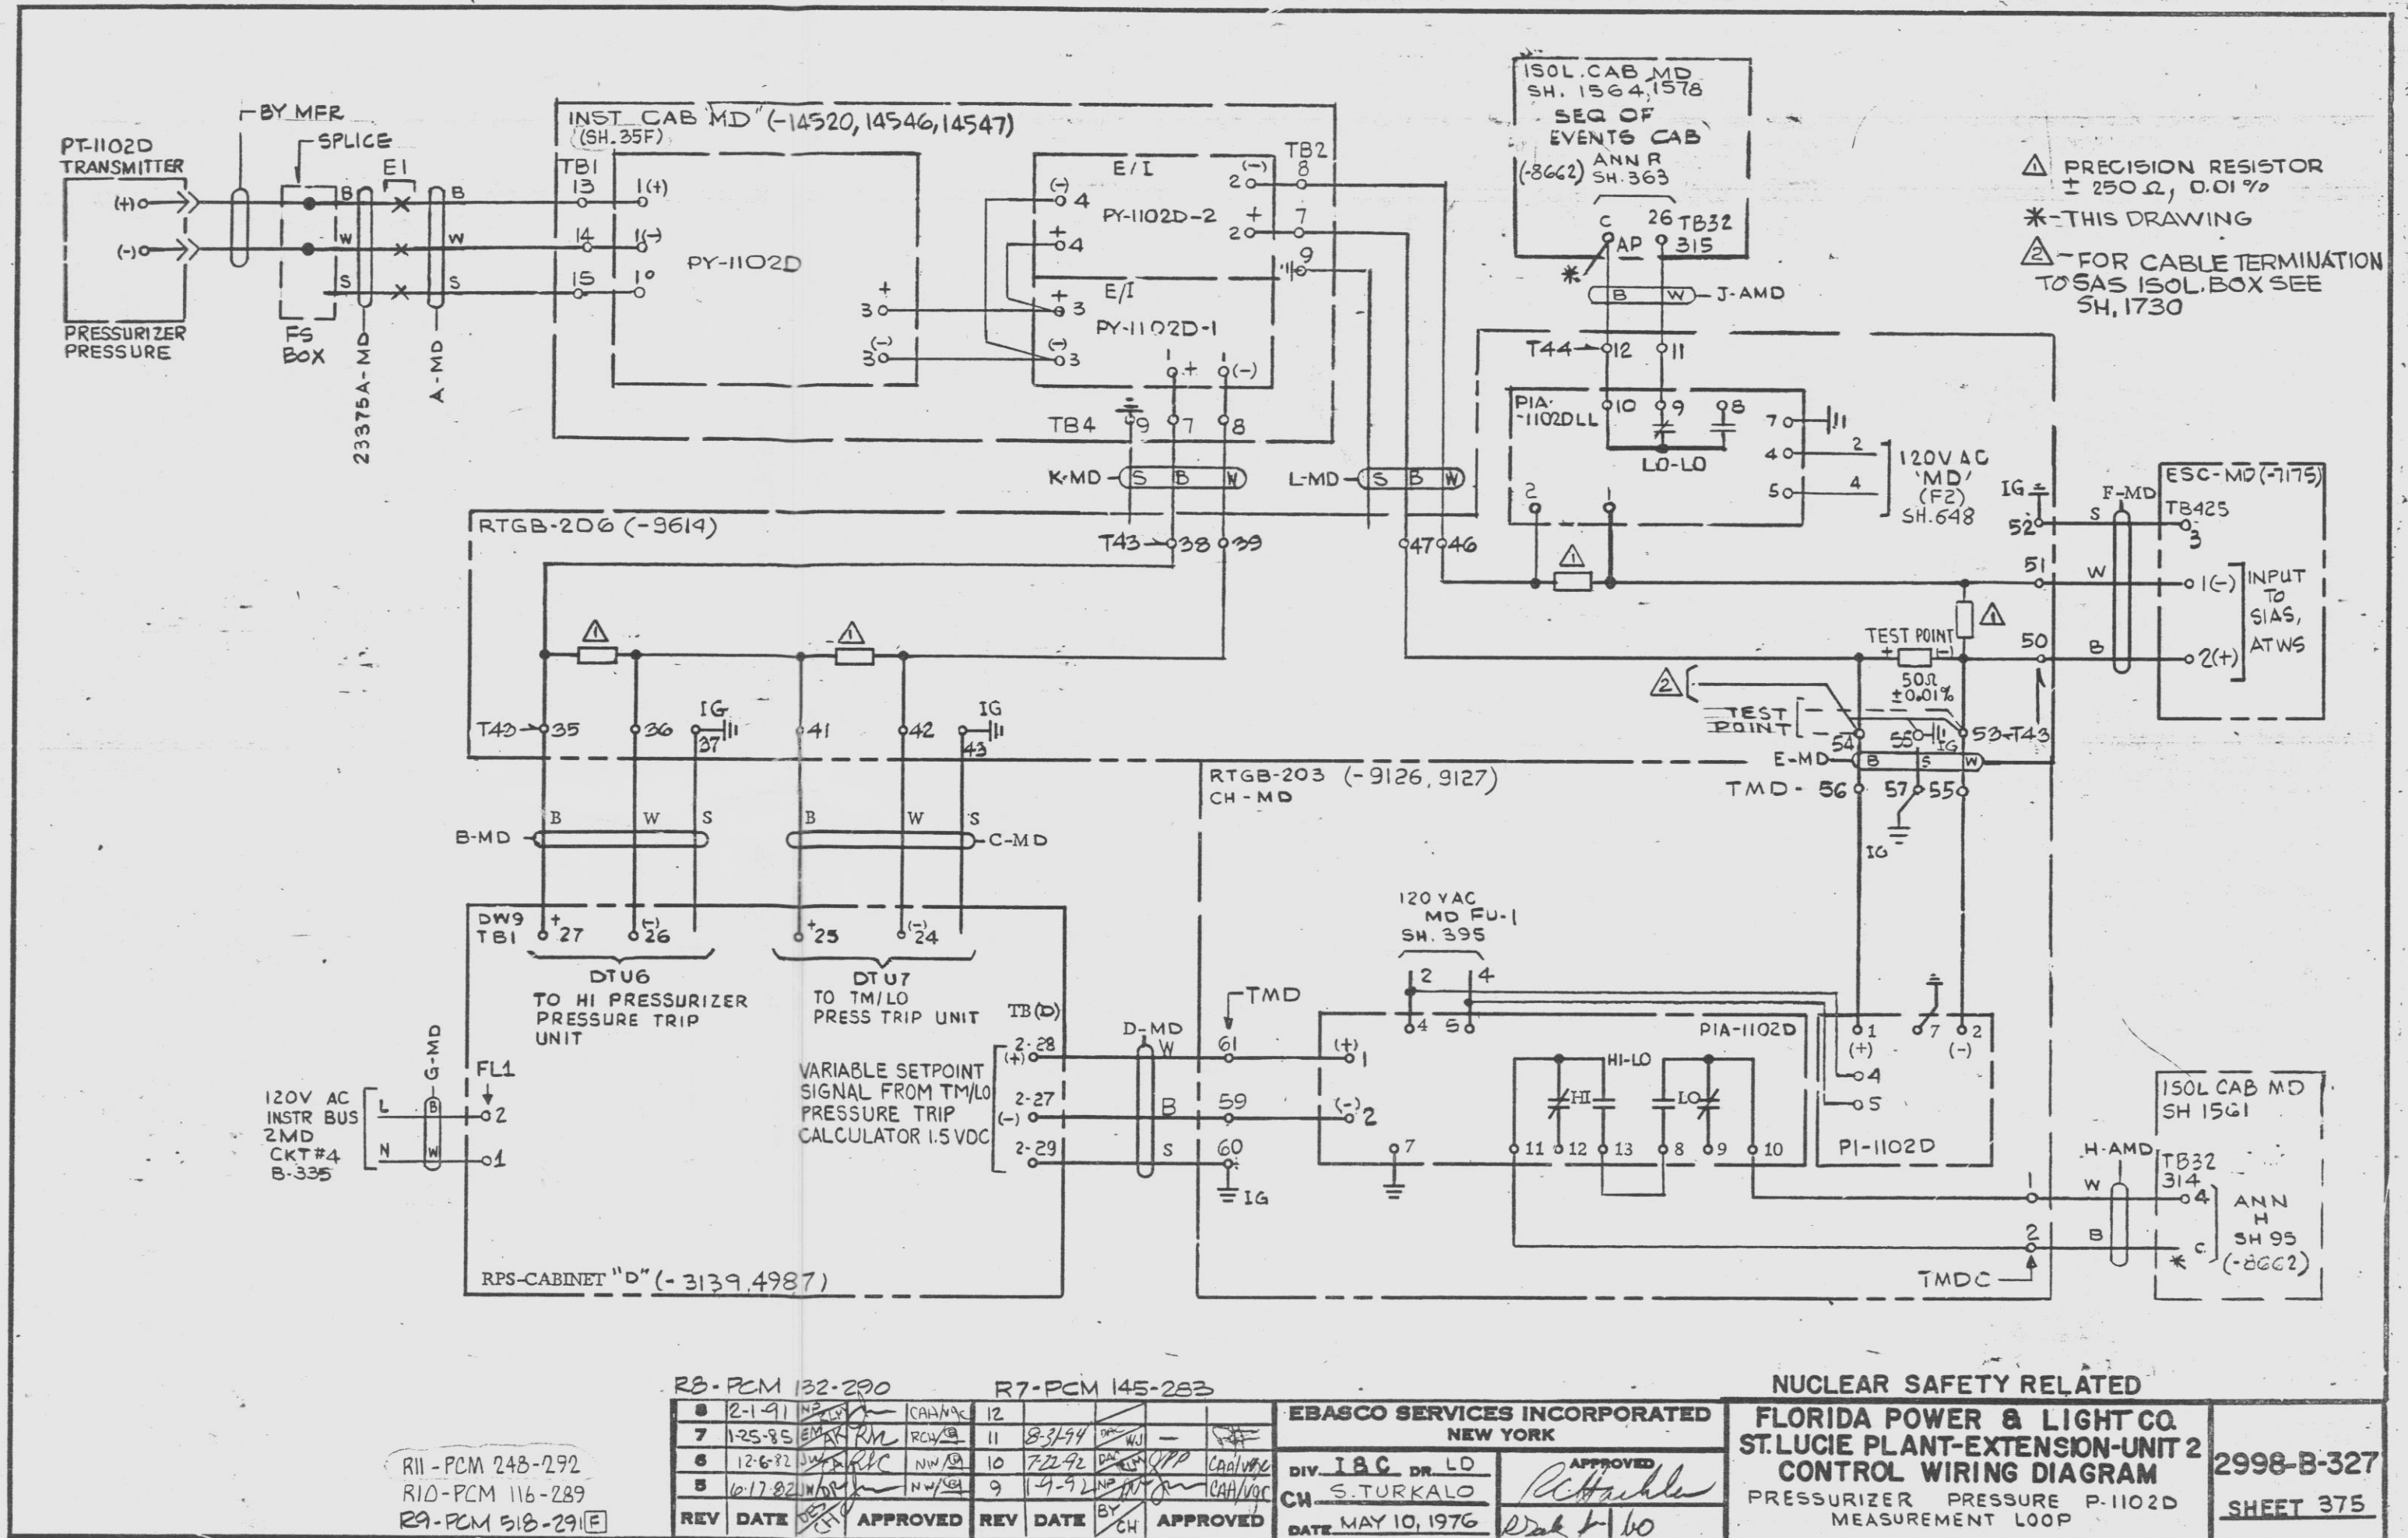

R8-PCM 132-280

R7-PCM 145-283

R11-PCM 248-292
R10-PCM 116-289
R9-PCM 518-291E

REV	DATE	APPROVED	REV	DATE	APPROVED
1	12-1-91	[Signature]	12	8-31-94	[Signature]
7	1-25-95	[Signature]	11	7-22-92	[Signature]
8	12-6-92	[Signature]	10	1-9-92	[Signature]
9	10-17-92	[Signature]	9	1-9-92	[Signature]

EBASCO SERVICES INCORPORATED
NEW YORK
DIV. I & C DR. LD
CH. S. TURKALO
DATE: MAY 10, 1976

NUCLEAR SAFETY RELATED
FLORIDA POWER & LIGHT CO.
ST. LUCIE PLANT-EXTENSION-UNIT 2
CONTROL WIRING DIAGRAM
PRESSURIZER PRESSURE P-1102D
MEASUREMENT LOOP

2998-B-327
SHEET 375

9607170098-143

D