

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8509230063. DOC. DATE: 85/09/16 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315  
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316  
 AUTH. NAME: AUTHOR AFFILIATION  
 ALEXICH, M.P. Indiana & Michigan Electric Co.  
 RECIP. NAME: RECIPIENT AFFILIATION  
 DENTON, H.R. Office of Nuclear Reactor Regulation, Director

SUBJECT: Provides schedule for submittal of Tech Specs required by NUREG-0737 as described in Generic Ltr 83-37 covering RCS vents, post-accident sampling, & containment hydrogen monitor.

DISTRIBUTION CODE: A002D COPIES RECEIVED: LTR 1 ENCL 2 SIZE: 2  
 TITLE: OR Submittal: Inadequate Core Cooling (Item II.F.2) GL 82-28

NOTES: 05000315  
 OL: 10/25/74  
 OL: 12/23/72 05000316

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	NRR ORB1 BC WIGGINGTON, D	1 1	NRR ORB1 LA	1 1
INTERNAL:	ACRS 17	10	ADM/LFMB	1
	NRR SHEA, J 01	1	NRR/DHFS/HFEB15	1
	NRR/DL/ORAB 08	1	NRR/DL/ORB5	1
	NRR/DSI DIR 09	1	NRR/DSI/CPB 10	3
	NRR/DSI/ICSB 14	1	NRR/DSI/RSB 13	1
	REG FILES 04	1	RGN3 07	1
EXTERNAL:	24X	1	LPDR 03	2
	NRC PDR 02	1	NSIC 06	1

TOTAL NUMBER OF COPIES REQUIRED: LTR 31 ENCL 30

100-200  
100-200

THE UNITED STATES OF AMERICA  
DEPARTMENT OF JUSTICE  
FEDERAL BUREAU OF INVESTIGATION  
WASHINGTON, D. C. 20535

MEMORANDUM FOR THE DIRECTOR, FBI  
FROM: SAC, NEW YORK (100-100000)  
SUBJECT: [Illegible]

Reference is made to the report of SA [Illegible] dated [Illegible] at New York, New York.

100-100000  
100-100000

100-100000  
100-100000

DATE	INITIALS	DESCRIPTION	INITIALS	DATE	INITIALS	DESCRIPTION
10/15/68	[Illegible]	[Illegible]	[Illegible]	10/15/68	[Illegible]	[Illegible]
10/16/68	[Illegible]	[Illegible]	[Illegible]	10/16/68	[Illegible]	[Illegible]
10/17/68	[Illegible]	[Illegible]	[Illegible]	10/17/68	[Illegible]	[Illegible]
10/18/68	[Illegible]	[Illegible]	[Illegible]	10/18/68	[Illegible]	[Illegible]
10/19/68	[Illegible]	[Illegible]	[Illegible]	10/19/68	[Illegible]	[Illegible]
10/20/68	[Illegible]	[Illegible]	[Illegible]	10/20/68	[Illegible]	[Illegible]
10/21/68	[Illegible]	[Illegible]	[Illegible]	10/21/68	[Illegible]	[Illegible]
10/22/68	[Illegible]	[Illegible]	[Illegible]	10/22/68	[Illegible]	[Illegible]
10/23/68	[Illegible]	[Illegible]	[Illegible]	10/23/68	[Illegible]	[Illegible]
10/24/68	[Illegible]	[Illegible]	[Illegible]	10/24/68	[Illegible]	[Illegible]
10/25/68	[Illegible]	[Illegible]	[Illegible]	10/25/68	[Illegible]	[Illegible]
10/26/68	[Illegible]	[Illegible]	[Illegible]	10/26/68	[Illegible]	[Illegible]
10/27/68	[Illegible]	[Illegible]	[Illegible]	10/27/68	[Illegible]	[Illegible]
10/28/68	[Illegible]	[Illegible]	[Illegible]	10/28/68	[Illegible]	[Illegible]
10/29/68	[Illegible]	[Illegible]	[Illegible]	10/29/68	[Illegible]	[Illegible]
10/30/68	[Illegible]	[Illegible]	[Illegible]	10/30/68	[Illegible]	[Illegible]
10/31/68	[Illegible]	[Illegible]	[Illegible]	10/31/68	[Illegible]	[Illegible]

# INDIANA & MICHIGAN ELECTRIC COMPANY

P.O. BOX 16631  
COLUMBUS, OHIO 43216

September 16, 1985

AEP:NRC: 0856P

Donald C. Cook Nuclear Plant Unit Nos. 1 and 2  
Docket Nos. 50-315 and 50-316  
License Nos. DPR-58 and DPR-74  
NUREG-0737 TECHNICAL SPECIFICATIONS SCHEDULE

Mr. Harold R. Denton, Director  
Office of Nuclear Reactor Regulation  
U. S. Nuclear Regulatory Commission  
Washington, DC 20555

Dear Mr. Denton:

The purpose of this letter is to provide a schedule for our  
submittal of the Technical Specifications (T/Ss) required by NUREG-0737  
as described in Generic Letter 83-37:

- (1) Reactor Coolant System Vents - Submitted in our letter dated March 15, 1984.
- (2) Post-Accident Sampling - This item is currently under review by NRC Region III. Since the review could affect the content of associated T/Ss, our intent is to resolve this concern prior to requesting the T/S amendment for this item as well as items (4), (5), and (6). Information identifying the NUREG-0737 requirements and relevant correspondence is to be available for Region III review by September 30, 1985. The T/S submittal schedule will depend on the Region's response to this review.
- (3) Long-Term Auxiliary Feedwater System Evaluation - Submitted in our letter dated April 23, 1985.
- (4) Noble Gas Effluent Monitors - Awaiting Region III review as described in (2).
- (5) Sampling and Analysis of Plant Effluents - Awaiting Region III review as described in (2).
- (6) Containment High-Range Radiation Monitor - Awaiting Region III review as described in (2).

8509230063 850916  
PDR ADCK 05000315  
PDR

A002  
1/0



1  
7  
8

[REDACTED]

- (7) Containment Pressure Monitor - This T/S is planned to be submitted by October 1, 1985.
- (8) Containment Water Level Monitor - This T/S is planned to be submitted by December 1, 1985.
- (9) Containment Hydrogen Monitor - This T/S is planned to be submitted by November 1, 1985.
- (10) Instrumentation for Detection of Inadequate Core Cooling - T/Ss are planned to be submitted by October 1, 1985 for the Reactor Vessel Level Indication System and by November 1, 1985 for the Unit 1 Incore Thermocouples. It should be noted that these T/Ss will reflect our plans to install the Incore Thermocouples in Unit 2 during the 1987 refueling outage after we have operating experience with the Unit 1 thermocouples.
- (11) Control Room Habitability Requirement - This T/S is not planned to be submitted until February 1, 1986. This is because the T/Ss in Generic Letter 83-37 require revision to ensure consistency with the plant design. Additional time is needed for development of a new T/S.

In addition to the above, we are currently developing an administrative procedure which will identify the equipment that is not in the T/Ss but must be operable to comply with confirmatory orders and license conditions. This procedure will include the equipment specified in NUREG-0737.

This document has been prepared following Corporate procedures which incorporate a reasonable set of controls to ensure its accuracy and completeness prior to signature by the undersigned.

Very truly yours,




M. P. Alexich  
Vice President

RBK  
9/16/85

MPA/ad

cc: John E. Dolan  
W. G. Smith, Jr. - Bridgman  
R. C. Callen  
G. Bruchmann  
G. Charnoff  
NRC Resident Inspector - Bridgman

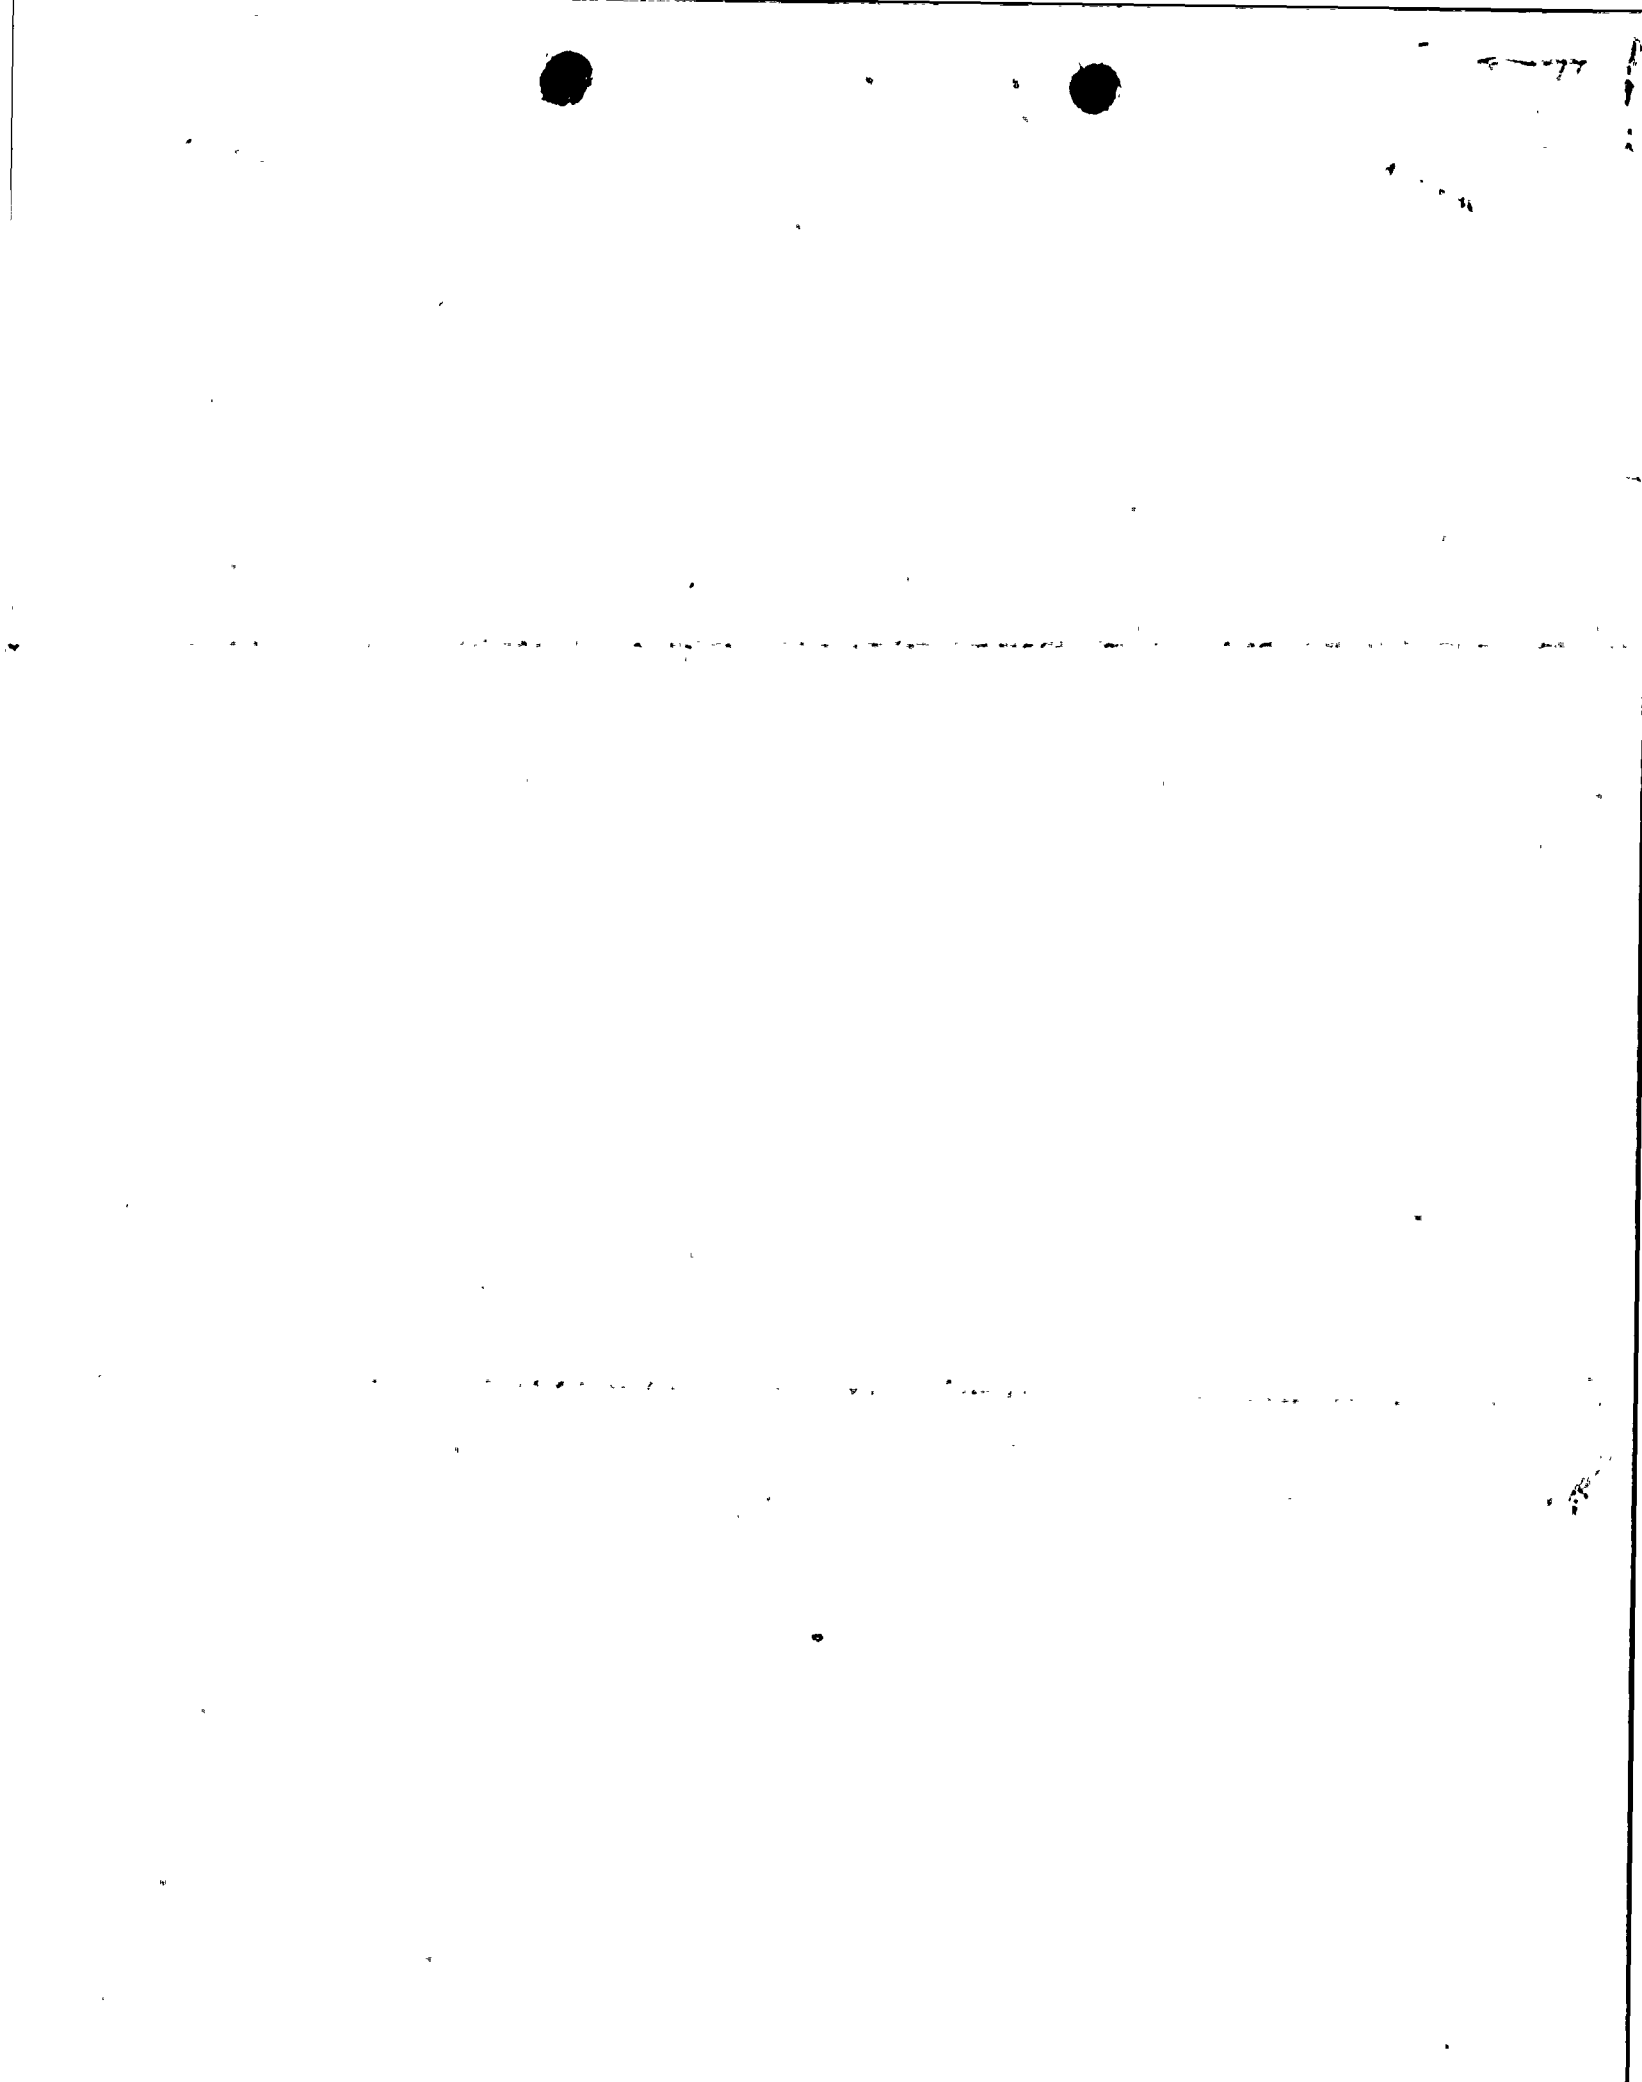

**DISTRIBUTION**  
~~Docket File w/o encl.~~  
 ORB#1 Rdg w/o encl.  
 CParrish w/encl.  
 DWigginton w/encl.

September 16, 1985

DOCKET NO(S) 50/315/316  
 Mr. John Dolan, Vice President  
 Indiana and Michigan Electric Company  
 c/o American Electric Power Service Corporation  
 1 Riverside Plaza  
 Columbus, Ohio 43215

SUBJECT: Donald C. Cook Nuclear Plant, Units 1/2

The following documents concerning our review of the subject facility are transmitted for your information.

- Notice of Receipt of Application, dated \_\_\_\_\_.
- Draft/Final Environmental Statment, dated \_\_\_\_\_.
- Notice of Availability of Draft/Final Environmental Statement, dated \_\_\_\_\_.
- Safety Evaluation Report, or Supplement No. \_\_\_\_\_, dated \_\_\_\_\_.
- Notice of Hearing on Application for Construction Permit, dated \_\_\_\_\_.
- Notice of Consideration of Issuance of Facility Operating License, dated \_\_\_\_\_.
- Monthly Notice; Applications and Amendments to Operating Licenses Involving no Significant Hazards Considerations, dated \_\_\_\_\_.
- Application and Safety Analysis Report, Volume \_\_\_\_\_.
- Amendment No. \_\_\_\_\_ to Application/SAR dated \_\_\_\_\_.
- Construction Permit No. CPPR- \_\_\_\_\_, Amendment No. \_\_\_\_\_ dated \_\_\_\_\_.
- Facility Operating License No. \_\_\_\_\_, Amendment No. \_\_\_\_\_, dated \_\_\_\_\_.
- Order Extending Construction Completion Date, dated \_\_\_\_\_.
- Other (Specify) Bi-weekly notice covering period September 11, 1985. Expiration date  
for hearing requests and comments October 11, 1985.

Division of Licensing, ORB#1  
 Office of Nuclear Reactor Regulation

Enclosures:  
 As stated

cc:

OFFICE	ORB#1:DL					
SURNAME	CParrish:kb					
DATE	9/16/85					

1950

1950

1950

1950

1950

1950

1950

1950