

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8710090204 DOC. DATE: 87/10/02 NOTARIZED: NO DOCKET #  
 FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315  
 50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316  
 AUTH. NAME AUTHOR AFFILIATION  
 ALEXICH, M. P. Indiana Michigan Power Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)


SUBJECT: Provides followup info to 870305 ltr ack receipt of NRC rept on plant survey on 860915-19. Reanalyses to demonstrate control room habitability under radiological & toxic gas conditions required. Rept will be completed by June 1988.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2  
 TITLE: DR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD3-3 LA	1 0	PD3-3 PD	5 1
	WIGGINGTON, D	1 1		
INTERNAL:	ARM/DAF/LFMB	1 0	NRR/DEST/ADS	1 1
	NRR/DEST/CEB	1 1	NRR/DEST/MTB	1 1
	NRR/DEST/RSB	1 1	NRR/DOEA/TSB	1 1
	NRR/PMAS/ILRB	1 1	OGC/HDS1	1 0
	<u>REG FILES</u> 01	1 1	RES/DE/EIB	1 1
EXTERNAL:	EG&G BRUSKE, S	1 1	LPDR	1 1
	NRC PDR	1 1	NSIC	1 1

TOTAL NUMBER OF COPIES REQUIRED: LTTR 21 ENCL 18

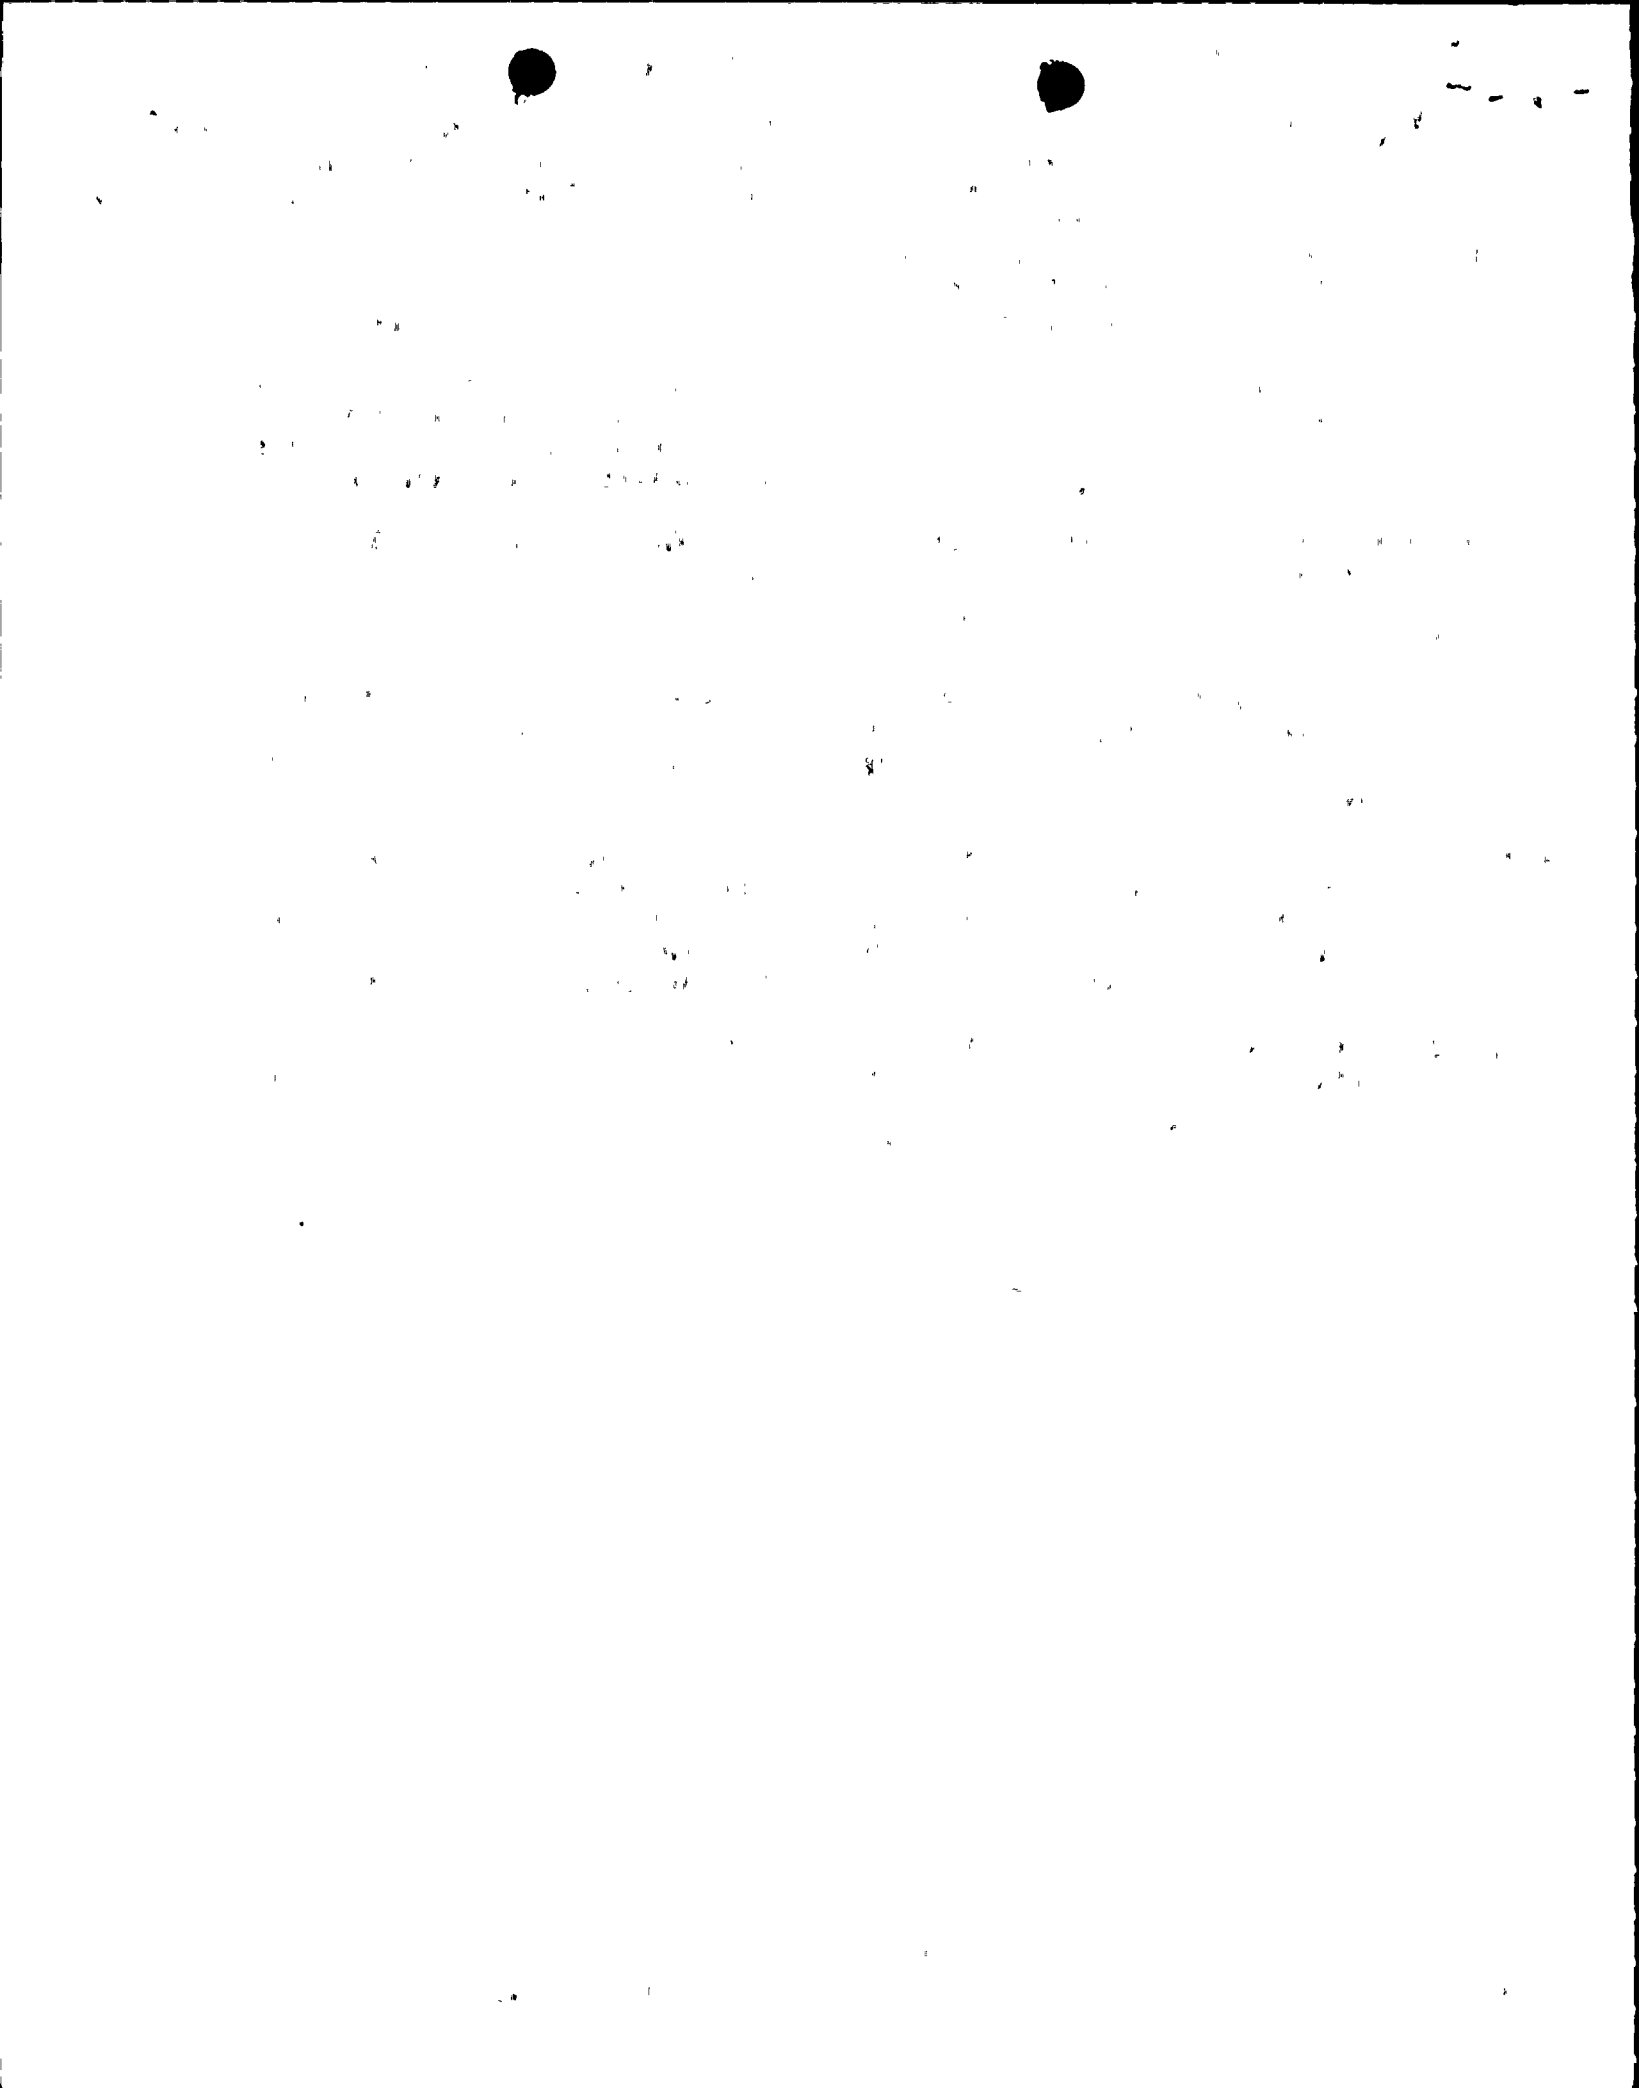

Indiana Michigan  
Power Company  
P.O. Box 16631  
Columbus, OH 43216



AEP:NRC:0398N

Donald C. Cook Nuclear Plant Units 1 and 2  
License Nos. DPR-58 and DPR-74  
Docket Nos. 50-315 and 50-316  
INTERIM RESPONSE TO CONTROL ROOM  
VENTILATION SYSTEM SURVEY

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D.C. 20555

Attn: T. E. Murley

October 2, 1987

Dear Dr. Murley:

This letter provides follow-up information to our letter AEP:NRC:0398M, dated March 5, 1987. In that letter, we acknowledged receipt of your staff's report on a survey of the D. C. Cook Plant Control Room Ventilation Systems which was conducted during the period of September 15-19, 1986. We also committed to providing you with a status report on resolution of the items addressed in the report.

Our review of the report has determined that reanalyses to demonstrate control room habitability will be required. The analyses will address habitability under both radiological and toxic gas conditions, and will address, as appropriate, concerns raised in the survey report. We anticipate that the analyses will be completed by June 1988. At that time, we will advise you of the results of our analyses as well as any necessary plant modifications which may be required. At that time also, we will propose a schedule for submittal of any Technical Specification changes which may be necessary.

8710090204 871002  
PDR ADDCK 05000315  
P PDR

A001  
1/10


Dr. T. E. Murley

-2-

AEP:NRG:0398N

This document has been prepared following Corporate procedures which incorporate a reasonable set of controls to insure its accuracy and completeness prior to signature by the undersigned.

Sincerely,

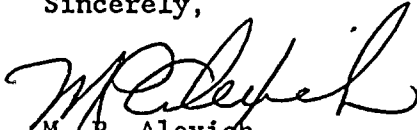

M. P. Alexich  
Vice President

cm

cc: John E. Dolan  
W. G. Smith, Jr. - Bridgman  
R. C. Callen  
G. Bruchmann  
G. Charnoff  
NRC Resident Inspector - Bridgman  
A. B. Davis - Region III