

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8912200150 DOC. DATE: 89/12/12 NOTARIZED: NO DOCKET #

FACIL: 50-315 Donald C. Cook Nuclear Power Plant, Unit 1, Indiana & 05000315

50-316 Donald C. Cook Nuclear Power Plant, Unit 2, Indiana & 05000316

AUTH. NAME AUTHOR AFFILIATION.

ALEXICH, M.P. Indiana Michigan Power Co. (formerly Indiana & Michigan Ele

RECIP. NAME RECIPIENT AFFILIATION

 Document Control Branch (Document Control Desk)

SUBJECT: Forwards addl info re 890825 change to administrative Tech Specs.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 344


TITLE: OR Submittal: General Distribution

NOTES:

| | RECIPIENT | | COPIES | | RECIPIENT | | COPIES | |
|-----------|-----------------|-----|--------|--------------------|-----------|------|--------|--|
| | ID CODE/NAME | LTR | ENCL | ID CODE/NAME | LTR | ENCL | | |
| | PD3-1 LA | 1 | 1 | PD3-1 PD | 1 | 1 | | |
| | GIITTER, J. | 5 | 5 | | | | | |
| INTERNAL: | NRR/DET/ECMB 9H | 1 | 1 | NRR/DOEA/OTSB11 | 1 | 1 | | |
| | NRR/DST 8E2 | 1 | 1 | NRR/DST/SELB 8D | 1 | 1 | | |
| | NRR/DST/SICB 7E | 1 | 1 | NRR/DST/SRXB 8E | 1 | 1 | | |
| | NUDOCS-ABSTRACT | 1 | 1 | OC/LFMB | 1 | 0 | | |
| | OGC/HDSL | 1 | 0 | <u>REG FILE 01</u> | 1 | 1 | | |
| | RES/DSIR/EIB | 1 | 1 | | | | | |
| EXTERNAL: | LPDR | 1 | 1 | NRC PDR | 1 | 1 | | |
| | NSIC | 1 | 1 | | | | | |

TOTAL NUMBER OF COPIES REQUIRED: LTR 21 ENCL 19

R
I
D
S
/
A
D
S
/
A
D
D
S

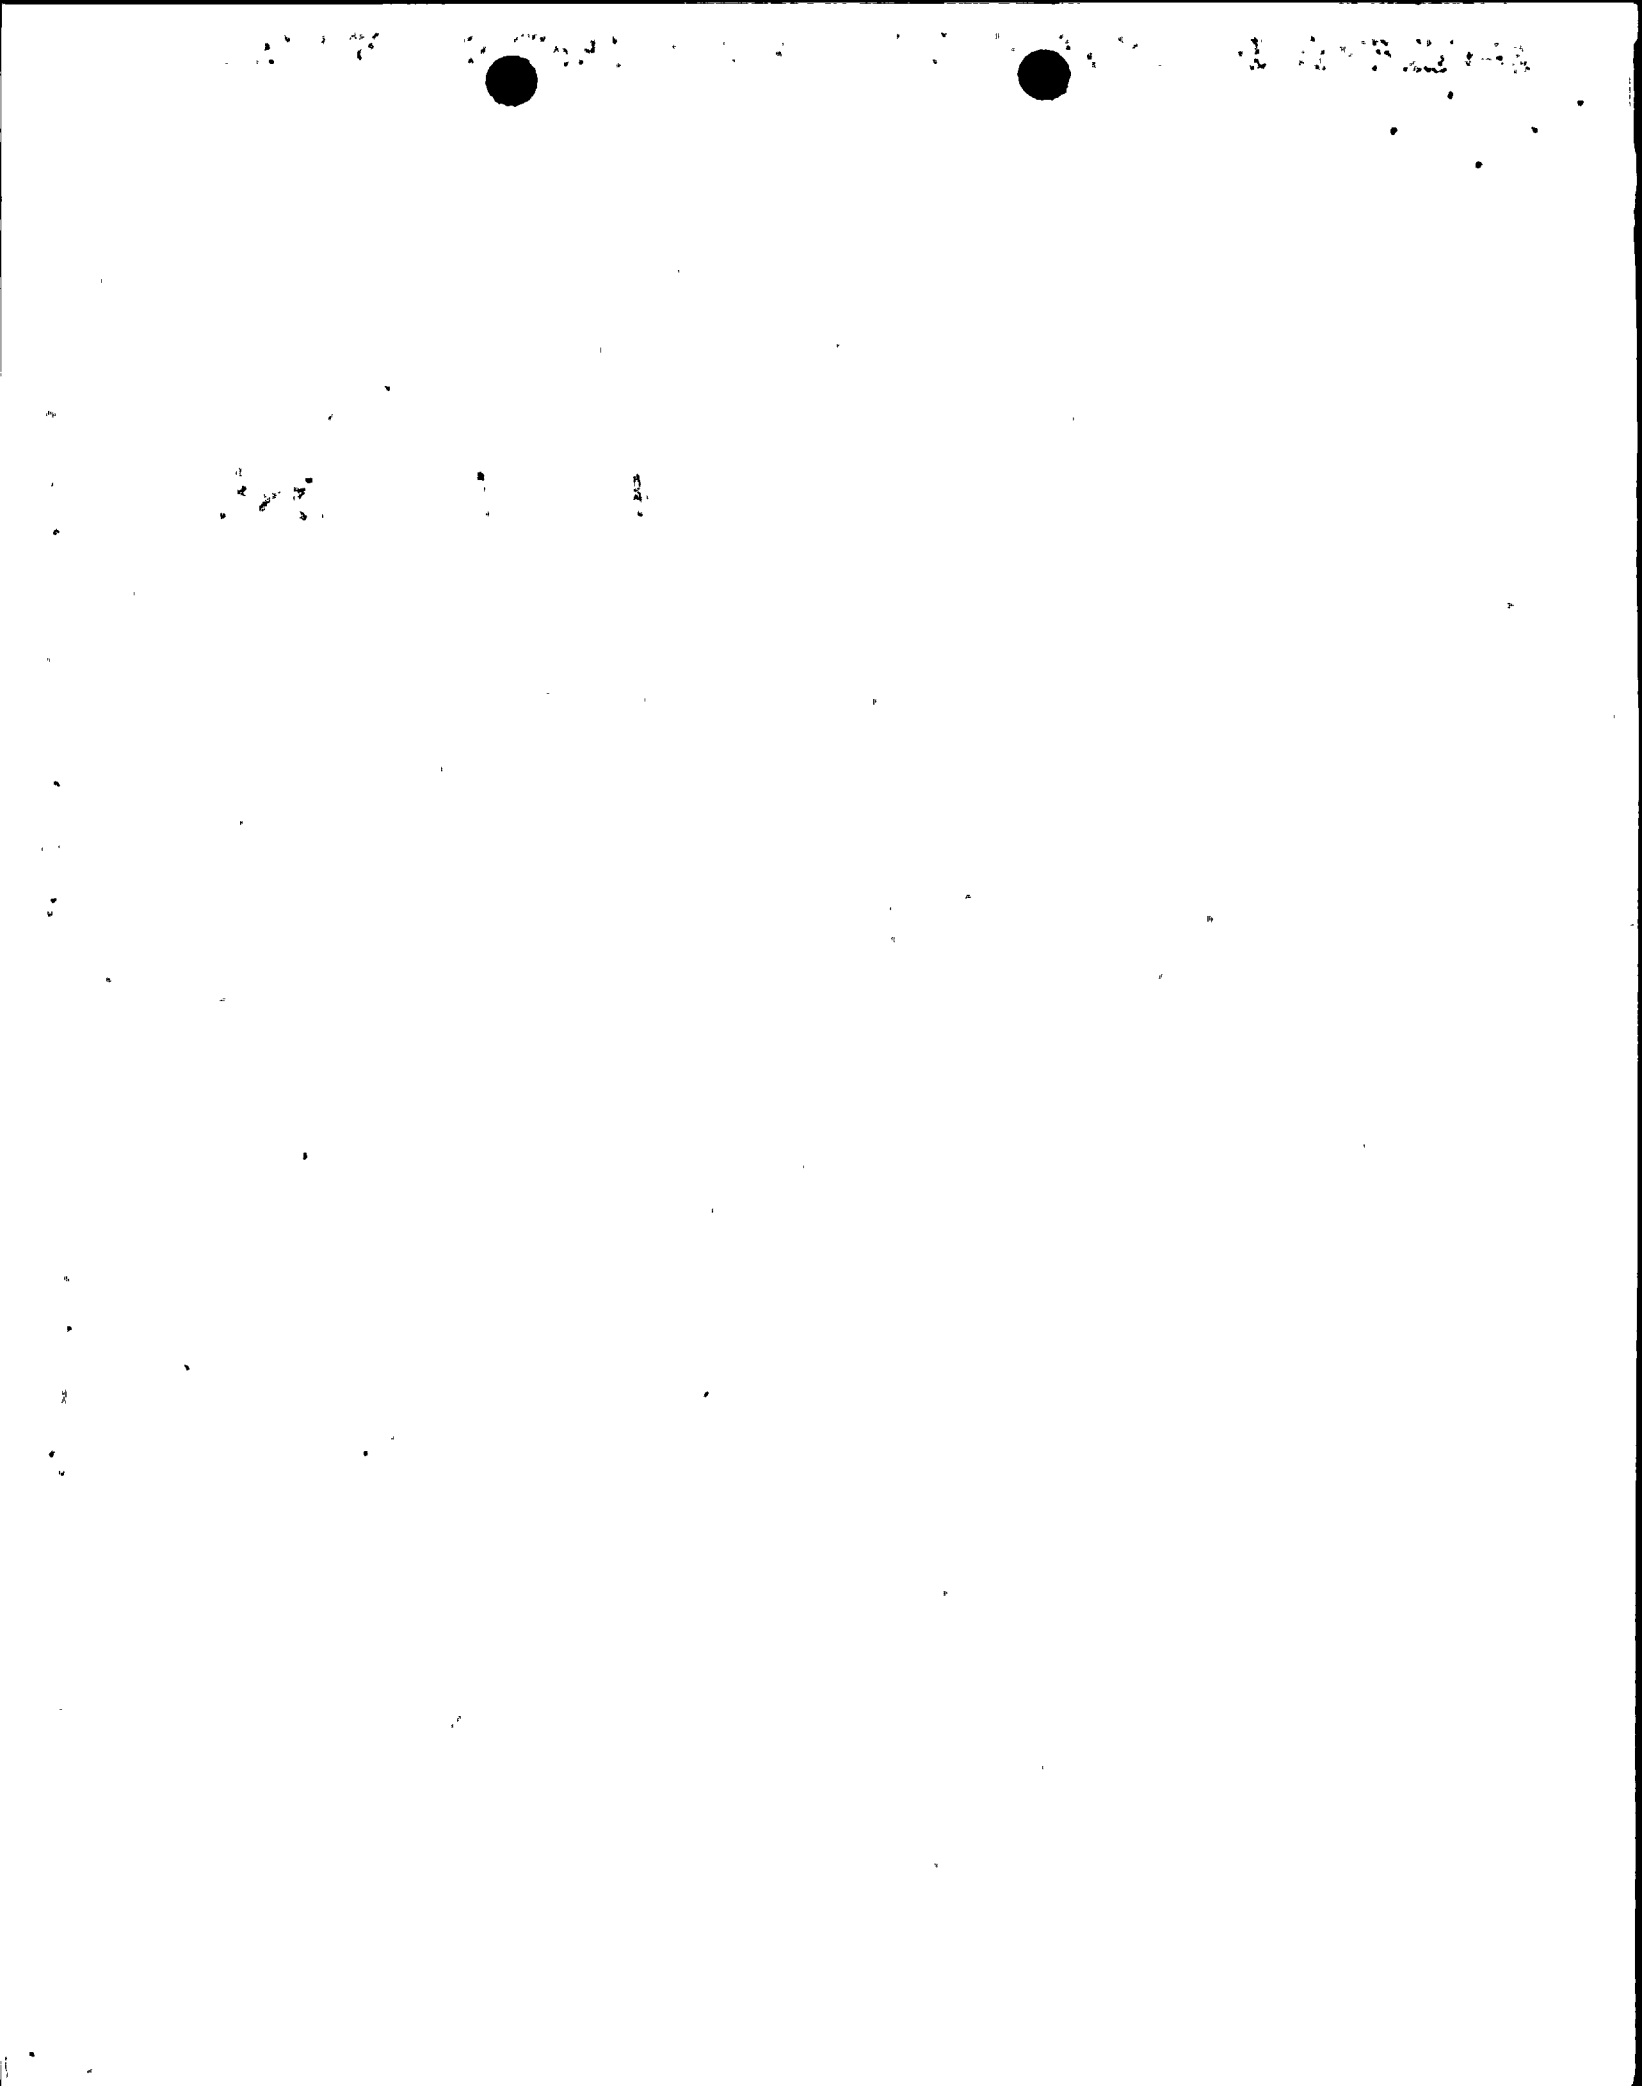



AEP:NRC:0659P

Donald G. Cook Nuclear Plant Units 1 and 2
Docket Nos. 50-315 and 50-316
License Nos. DPR-58 and DPR-74
CLARIFICATION TO SECTION 6 T/S CHANGE REQUEST

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D.C. 20555

Attn: T. E. Murley

December 12, 1989

Dear Dr. Murley:

This letter transmits the additional information that was requested by your staff on the technical specification change request to the "Administrative Controls" T/Ss (AEP:NRC:0659M dated August 25, 1989). This information only clarifies the information provided in our August 25, 1989 submittal. The revised proposed T/S pages are in the attachment to this letter.

In Section 6.3.1, a third exception to the qualifications of ANSI N18.1-1971 is taken for the Operations Superintendent who was qualified as a Senior Operator, but who does not hold a current Senior Operator License as specified in Section 6.2.2.h. The Shift Supervisor, who must maintain a Senior Operator License, has the responsibility of reviewing and approving any proposed operational instructions for the units prior to directing the operation of the units (this requirement is specified in Section 6.1.2). Unit Supervisors, who hold Senior Operator Licenses, direct the minute-to-minute activities in the control room. One mid-level Production Supervisor also holds a current Senior Operator License. Therefore, we believe we meet the intent of ANSI N18.1-1971 and that this is not a substantial change to our T/S change request proposed in our August 25, 1989 submittal.

An editorial correction has been made to Section 6.2.2.h for the Unit 1 T/Ss. This page has also been included in the attachment.

A001
11

8912200150 891212
PDR ADOCK 05000315
P PNU


Dr. T. E. Murley

-2-

AEP:NRC:0659P

This document has been prepared following Corporate procedures that incorporate a reasonable set of controls to ensure its accuracy and completeness prior to signature by the undersigned.

Sincerely,



M. P. Alexich
Vice President

ldp

Attachment

cc: D. H. Williams, Jr.
A. A. Blind - Bridgman
R. C. Callen
G. Charnoff
A. B. Davis - Region III
NRC Resident Inspector - Bridgman
NFEM Section Chief

ATTACHMENT TO AEP:NRG:0659P

PROPOSED REVISED T/S PAGES