

CHEM-NUCLEAR SYSTEMS, LLC.
140 STONERIDGE DRIVE
COLUMBIA, S.C. 29210

DESIGN DOCUMENT COVER SHEET

DOCUMENT ID NUMBER: ST-307 REVISION NUMBER: 0

PROJECT NUMBER: 46628

SECURITY STATUS: PROPRIETARY _____ NON-PROPRIETARY x

PERIOD: Life of the Project + 1 year

TITLE: Structural Evaluation of the D.C. Cook Unit 2 SGLA Package

PREPARED BY: *W. Fran Baig* DATE: 8/19/98

TITLE: Principal Engineer

REVIEWED BY: *Paul Dambler* DATE: 8/20/98

TITLE: Senior Project Engineer

REVISION NOTES: CONTROLLED COPY NO. *3242*

**INFORMATION
ONLY**

DOCUMENT CONTROL	
Received By: <u><i>Ulga Bolyard</i></u>	Date: <u><i>8/21/98</i></u>
Document Dated From: <u><i>8/19/98</i></u>	To: <u><i>8/20/98</i></u>
Verification to Index By: <u><i>(113 12 Pages)</i></u>	Date: <u><i>8/21/98</i></u>
Storage Shelf Location: <u><i>4-A</i></u>	

9810140052 981008
PDR ADDCK 05000316
PDR

1
 2
 3
 4
 5
 6
 7
 8
 9
 10
 11
 12
 13
 14
 15
 16
 17
 18
 19
 20
 21
 22
 23
 24
 25
 26
 27
 28
 29
 30
 31
 32
 33
 34
 35
 36
 37
 38
 39
 40
 41
 42
 43
 44
 45
 46
 47
 48
 49
 50
 51
 52
 53
 54
 55
 56
 57
 58
 59
 60
 61
 62
 63
 64
 65
 66
 67
 68
 69
 70
 71
 72
 73
 74
 75
 76
 77
 78
 79
 80
 81
 82
 83
 84
 85
 86
 87
 88
 89
 90
 91
 92
 93
 94
 95
 96
 97
 98
 99
 100
 101
 102
 103
 104
 105
 106
 107
 108
 109
 110
 111
 112
 113
 114
 115
 116
 117
 118
 119
 120
 121
 122
 123
 124
 125
 126
 127
 128
 129
 130
 131
 132
 133
 134
 135
 136
 137
 138
 139
 140
 141
 142
 143
 144
 145
 146
 147
 148
 149
 150
 151
 152
 153
 154
 155
 156
 157
 158
 159
 160
 161
 162
 163
 164
 165
 166
 167
 168
 169
 170
 171
 172
 173
 174
 175
 176
 177
 178
 179
 180
 181
 182
 183
 184
 185
 186
 187
 188
 189
 190
 191
 192
 193
 194
 195
 196
 197
 198
 199
 200
 201
 202
 203
 204
 205
 206
 207
 208
 209
 210
 211
 212
 213
 214
 215
 216
 217
 218
 219
 220
 221
 222
 223
 224
 225
 226
 227
 228
 229
 230
 231
 232
 233
 234
 235
 236
 237
 238
 239
 240
 241
 242
 243
 244
 245
 246
 247
 248
 249
 250
 251
 252
 253
 254
 255
 256
 257
 258
 259
 260
 261
 262
 263
 264
 265
 266
 267
 268
 269
 270
 271
 272
 273
 274
 275
 276
 277
 278
 279
 280
 281
 282
 283
 284
 285
 286
 287
 288
 289
 290
 291
 292
 293
 294
 295
 296
 297
 298
 299
 300
 301
 302
 303
 304
 305
 306
 307
 308
 309
 310
 311
 312
 313
 314
 315
 316
 317
 318
 319
 320
 321
 322
 323
 324
 325
 326
 327
 328
 329
 330
 331
 332
 333
 334
 335
 336
 337
 338
 339
 340
 341
 342
 343
 344
 345
 346
 347
 348
 349
 350
 351
 352
 353
 354
 355
 356
 357
 358
 359
 360
 361
 362
 363
 364
 365
 366
 367
 368
 369
 370
 371
 372
 373
 374
 375
 376
 377
 378
 379
 380
 381
 382
 383
 384
 385
 386
 387
 388
 389
 390
 391
 392
 393
 394
 395
 396
 397
 398
 399
 400
 401
 402
 403
 404
 405
 406
 407
 408
 409
 410
 411
 412
 413
 414
 415
 416
 417
 418
 419
 420
 421
 422
 423
 424
 425
 426
 427
 428
 429
 430
 431
 432
 433
 434
 435
 436
 437
 438
 439
 440
 441
 442
 443
 444
 445
 446
 447
 448
 449
 450
 451
 452
 453
 454
 455
 456
 457
 458
 459
 460
 461
 462
 463
 464
 465
 466
 467
 468
 469
 470
 471
 472
 473
 474
 475
 476
 477
 478
 479
 480
 481
 482
 483
 484
 485
 486
 487
 488
 489
 490
 491
 492
 493
 494
 495
 496
 497
 498
 499
 500
 501
 502
 503
 504
 505
 506
 507
 508
 509
 510
 511
 512
 513
 514
 515
 516
 517
 518
 519
 520
 521
 522
 523
 524
 525
 526
 527
 528
 529
 530
 531
 532
 533
 534
 535
 536
 537
 538
 539
 540
 541
 542
 543
 544
 545
 546
 547
 548
 549
 550
 551
 552
 553
 554
 555
 556
 557
 558
 559
 560
 561
 562
 563
 564
 565
 566
 567
 568
 569
 570
 571
 572
 573
 574
 575
 576
 577
 578
 579
 580
 581
 582
 583
 584
 585
 586
 587
 588
 589
 590
 591
 592
 593
 594
 595
 596
 597
 598
 599
 600
 601
 602
 603
 604
 605
 606
 607
 608
 609
 610
 611
 612
 613
 614
 615
 616
 617
 618
 619
 620
 621
 622
 623
 624
 625
 626
 627
 628
 629
 630
 631
 632
 633
 634
 635
 636
 637
 638
 639
 640
 641
 642
 643
 644
 645
 646
 647
 648
 649
 650
 651
 652
 653
 654
 655
 656
 657
 658
 659
 660
 661
 662
 663
 664
 665
 666
 667
 668
 669
 670
 671
 672
 673
 674
 675
 676
 677
 678
 679
 680
 681
 682
 683
 684
 685
 686
 687
 688
 689
 690
 691
 692
 693
 694
 695
 696
 697
 698
 699
 700
 701
 702
 703
 704
 705
 706
 707
 708
 709
 710
 711
 712
 713
 714
 715
 716
 717
 718
 719
 720
 721
 722
 723
 724
 725
 726
 727
 728
 729
 730
 731
 732
 733
 734
 735
 736
 737
 738
 739
 740
 741
 742
 743
 744
 745
 746
 747
 748
 749
 750
 751
 752
 753
 754
 755
 756
 757
 758
 759
 760
 761
 762
 763
 764
 765
 766
 767
 768
 769
 770
 771
 772
 773
 774
 775
 776
 777
 778
 779
 780
 781
 782
 783
 784
 785
 786
 787
 788
 789
 790
 791
 792
 793
 794
 795
 796
 797
 798
 799
 800
 801
 802
 803
 804
 805
 806
 807
 808
 809
 810
 811
 812
 813
 814
 815
 816
 817
 818
 819
 820
 821
 822
 823
 824
 825
 826
 827
 828
 829
 830
 831
 832
 833
 834
 835
 836
 837
 838
 839
 840
 841
 842
 843
 844
 845
 846
 847
 848
 849
 850
 851
 852
 853
 854
 855
 856
 857
 858
 859
 860
 861
 862
 863
 864
 865
 866
 867
 868
 869
 870
 871
 872
 873
 874
 875
 876
 877
 878
 879
 880
 881
 882
 883
 884
 885
 886
 887
 888
 889
 890
 891
 892
 893
 894
 895
 896
 897
 898
 899
 900
 901
 902
 903
 904
 905
 906
 907
 908
 909
 910
 911
 912
 913
 914
 915
 916
 917
 918
 919
 920
 921
 922
 923
 924
 925
 926
 927
 928
 929
 930
 931
 932
 933
 934
 935
 936
 937
 938
 939
 940
 941
 942
 943
 944
 945
 946
 947
 948
 949
 950
 951
 952
 953
 954
 955
 956
 957
 958
 959
 960
 961
 962
 963
 964
 965
 966
 967
 968
 969
 970
 971
 972
 973
 974
 975
 976
 977
 978
 979
 980
 981
 982
 983
 984
 985
 986
 987
 988
 989
 990
 991
 992
 993
 994
 995
 996
 997
 998
 999
 1000

111
 112
 113

114
 115

CHEM-NUCLEAR SYSTEMS, INC.
 140 STONERIDGE DRIVE
 COLUMBIA, S.C. 29210

DESIGN DOCUMENT REVIEW CHECKLIST

Design Package Identification No ST-307

Date 8/19/98

Revision No. 0

ITEM	YES	N/A*
1.A Design Inputs such as design bases, regulatory requirements, codes, and standards are identified and documented.	✓	
1.B Effect of design package on compliance with the Safety Analysis Report or Certificate of Compliance identified and documented.		✓
2. Revision numbers correct on the list of drawings?	✓	
3. Assumptions reasonable?	✓	
4. Appropriate analysis method used?	✓	
5. Correct values used from drawings?	✓	
6. Answers and units correct?	✓	
7. Summary of results matches calculations?		✓
8. Material properties properly taken from credible references?	✓	
9. Figures match design drawings?	✓	
10. Computer input complete and properly identified?		✓
11. Documentation of all hand calculations attached?	✓	
12. Meeting minutes of the Design Review?		✓

* Not Applicable, Explain


1.B There is no SAR or Certificate of Compliance for this equipment.

7. Results are not summarized.

10. No computer analysis performed.

12. No design review meeting needed.

Independent Reviewer

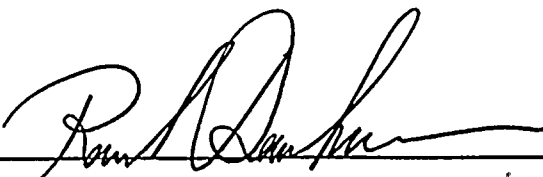



1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

100

OBJECTIVE

Structural evaluation of the D.C. Cook steam generator lower assembly (SGLA) package to demonstrate that its closures provide sufficient strength to maintain their integrity during the transportation.

INTRODUCTION

American Electric Power (AEP) company has replaced the steam generators at their D.C. Cook Unit 2 facility. The steam dome portions of the old steam generators (OSGs) (Reference 1) have been cut. The steam generator lower assembly (SGLA) packages will be transported to Barnwell South Carolina for disposal. These packages have been classified as SCO-II under 49 CFR Part 173 (Reference 2). Per 49 CFR 173.427, the SCO-II class materials are required to be shipped using IP-2 packages. Because of the unique size and shape of the SGLA, and controlled handling process during the transportation, an exemption from packaging requirement is requested from the DOT. A detailed handling and shipment plan is developed and will be adhered to during the transportation of these assemblies. The ability of this plan to provide an equivalent safety as that of an SCO-II object shipped in an IP-2 package forms the basis of this exemption request.

The SGLAs have several openings that have been welded shut for the transportation. These openings and their circumferential locations are listed in Table 1 and are shown in Figure 1. The details of the closure of these openings are shown in Reference 3. The cut end of the steam generators were closed using 3" thick end-plates that are welded to the body using 3/8" fillet welds. These welds were made according to AEP work plan but lack the quality assurance documentation. Therefore, additional attachment is provided by specially designed clips that are welded to the steam generator body and the endplate. Details of these clips are provided in Reference 4.

Evaluations are provided in this document that show that all the closures of the SGLA have sufficient structural strength to maintain their integrity under the loading expected during the transportation.

REFERENCES

- (1) CNS Drawing No. C-110-B-46628-001, Rev.1, *D.C. Cook Unit 2, Steam Generator General Layout.*
- (2) Code of Federal Regulations Title 49 Part 173.
- (3) CNS Drawing No. C-110-B-46628-004, Rev.1, *D.C. Cook Unit 2, Steam Generator Containment Details.*
- (4) CNS Drawing No. C-110-B-46628-003, Rev.1, *D.C. Cook Unit 2, Steam Generator Shear Key and Shield Plate Tie-Bar.*
- (5) AISC, *Steel Construction Manual*, Ninth Edition.

(6) AAR Manual, Rev.9, Section No.1, General Rules, 1993.

MATERIAL PROPERTIES

Shells

Specification: ASME SA-516 Gr 70

Minimum Yield Strength, S_y = 38,000 psi

Minimum Ultimate Strength, S_u = 70,000 psi

Caps and Plugs

Specification: ASTM A-36

Minimum Yield Strength, S_y = 36,000 psi

Minimum Ultimate Strength, S_u = 58,000 psi

Welds

Rod Specification: E-70xx Electrodes

Minimum Ultimate Strength, S_u = 70,000 psi

ALLOWABLE STRESSES

Stresses in the caps and plugs and the welds are conservatively based on the AISC (Reference 5) allowable values.

Caps and Plugs

Allowable bending stress = $0.66 S_y$ = 24,000 psi

Allowable shear stress = $0.4 S_y$ = 14,400 psi

Welds

Allowable shear stress in fillet welds = $0.3 S_u$ = 21,000 psi

EVALUATION OF THE CLOSURES

The closures of the steam generator package are evaluated for the largest acceleration the package may experience during the transportation. The largest acceleration that the SGLA would experience during the entire process of shipping and handling is during the rail transportation. According to the general rules of AAR (Reference 6), these accelerations are 3g in the longitudinal direction, 2g in the lateral direction, and 2g in the vertical direction. Conservatively,



19

20

3g acceleration is assumed to occur in all directions and the closures are analyzed for this loading. It is also assumed that the mass of the components used for closing the opening during storage - plates, manways, handholes lid, etc. - apply the inertia loading to the closures.

Primary Inlet & Outlet Nozzle Closures

The primary inlet and outlet nozzle closures (Figure 2) are made of two items:

Item - 1: 50.5 in Dia \times $\frac{1}{4}$ in thick plate. Its weight is,

$$W_a = (\pi/4) \times 50.5^2 \times 0.25 \times (1/12)^3 \times 490 = 142 \text{ lbs}$$

Item - 2: 50.5 in Dia \times $\frac{1}{4}$ in thick \times 26 in long shell. Its weight is,

$$W_b = \pi \times 50.5 \times 0.25 \times 26 \times (1/12)^3 \times 490 = 293 \text{ lbs}$$

Total closure weight = 142 + 293 = 435 say 450 lbs

Conservatively assume that the coverplate has a dia of 50.5 in and thickness of 2.5 in. Then, the coverplate weight,

$$W_c = (\pi/4) \times 50.5^2 \times 2.5 \times (1/12)^3 \times 490 = 1,420 \text{ lbs, say 1,500 lbs}$$

The inertia load in a direction normal to the $\frac{1}{4}$ in plate will be reacted by the edge shear. The shear stress in the plate is:

$$\tau = 3 \times (450 + 1,500) / (\pi \times 50.5 \times 0.25) = 148 \text{ psi} \ll 14,400 \text{ psi}$$

The plate is welded to the shell with a full penetration weld which will have strength equal to or larger than the base metal. The welds between the shell and the nozzle are $3/16$ " fillet which will develop a shear stress,

$$\tau_{\text{weld}} = 3 \times (450 + 1,500) / (\pi \times 50.5 \times 0.707 \times 3/16) = 278 \text{ psi} \ll 21,000 \text{ psi}$$

The inertia load in the plane of the coverplate, will cause bending and shear load at the base of the shell. Conservatively assuming that the entire mass is located at the end of the shell, the bending moment at the base of the shell is:

$$M = 3 \times (450 + 1,500) \times 26 = 152,100 \text{ in-lb}$$

Bending stress in the shell,

$$\sigma_{\text{bending}} = 152,100 / [\pi \times (50.5/2)^2 \times 0.25] = 304 \text{ psi} \ll 24,000 \text{ psi}$$

Shear stress in the shell,

$$\tau = 3 \times (450 + 1,500) / (\pi \times 50.5 \times 0.25) = 147 \text{ psi} \ll 14,400 \text{ psi}$$



1984

1984

Shear stress in the weld caused by bending moment,

$$\tau_{\text{bending}} = 152,100 / [\pi \times (50.5/2)^2 \times 0.707 \times 3/16] = 573 \text{ psi}$$

Shear stress in the caused by the shear force,

$$\tau_{\text{shear}} = 3 \times (450 + 1,500) / (\pi \times 50.5 \times 0.707 \times 3/16) = 278 \text{ psi}$$

Combined shear stress,

$$\tau = 573 + 278 = 851 \text{ psi} < 21,000 \text{ psi}$$

Manway Closures

The manway closures (Figure 3) are made of two items:

Item - 1: 28 in Dia \times $\frac{1}{4}$ in thick plate. Its weight is,

$$W_a = (\pi/4) \times 28^2 \times 0.25 \times (1/12)^3 \times 490 = 44 \text{ lbs}$$

Item - 2: 28 in Dia \times $\frac{1}{4}$ in thick \times 6.5 in long shell. It weight is,

$$W_b = \pi \times 28 \times 0.25 \times 6.5 \times (1/12)^3 \times 490 = 41 \text{ lbs}$$

Total closure weight = 44 + 41 = 85 say 100 lbs

Conservatively assume that the manway has a dia of 28 in and thickness of 6.5 in. Then, the manway weight,

$$W_m = (\pi/4) \times 28^2 \times 6.5 \times (1/12)^3 \times 490 = 1,135 \text{ lbs, say 1,200 lbs}$$

The inertia load in a direction normal to the $\frac{1}{4}$ in plate will be reacted by the edge shear. The shear stress in the plate is:


$$\tau = 3 \times (100 + 1,200) / (\pi \times 28 \times 0.25) = 177 \text{ psi} \ll 14,400 \text{ psi}$$

The plate is welded to the shell with a full penetration weld which will have strength equal to or larger than the base metal. The welds between the shell and the nozzle are $\frac{1}{4}$ in fillet which will develop a shear stress,

$$\tau_{\text{weld}} = 3 \times (100 + 1,200) / (\pi \times 28 \times 0.707 \times 1/4) = 251 \text{ psi} \ll 21,000 \text{ psi}$$

The inertia load in the plane of the coverplate, will cause bending and shear load at the base of the shell. Conservatively assuming that the entire mass is located at the end of the shell, the bending moment at the base of the shell is:

$$M = 3 \times (100 + 1,200) \times 6.5 = 25,350 \text{ in-lb}$$

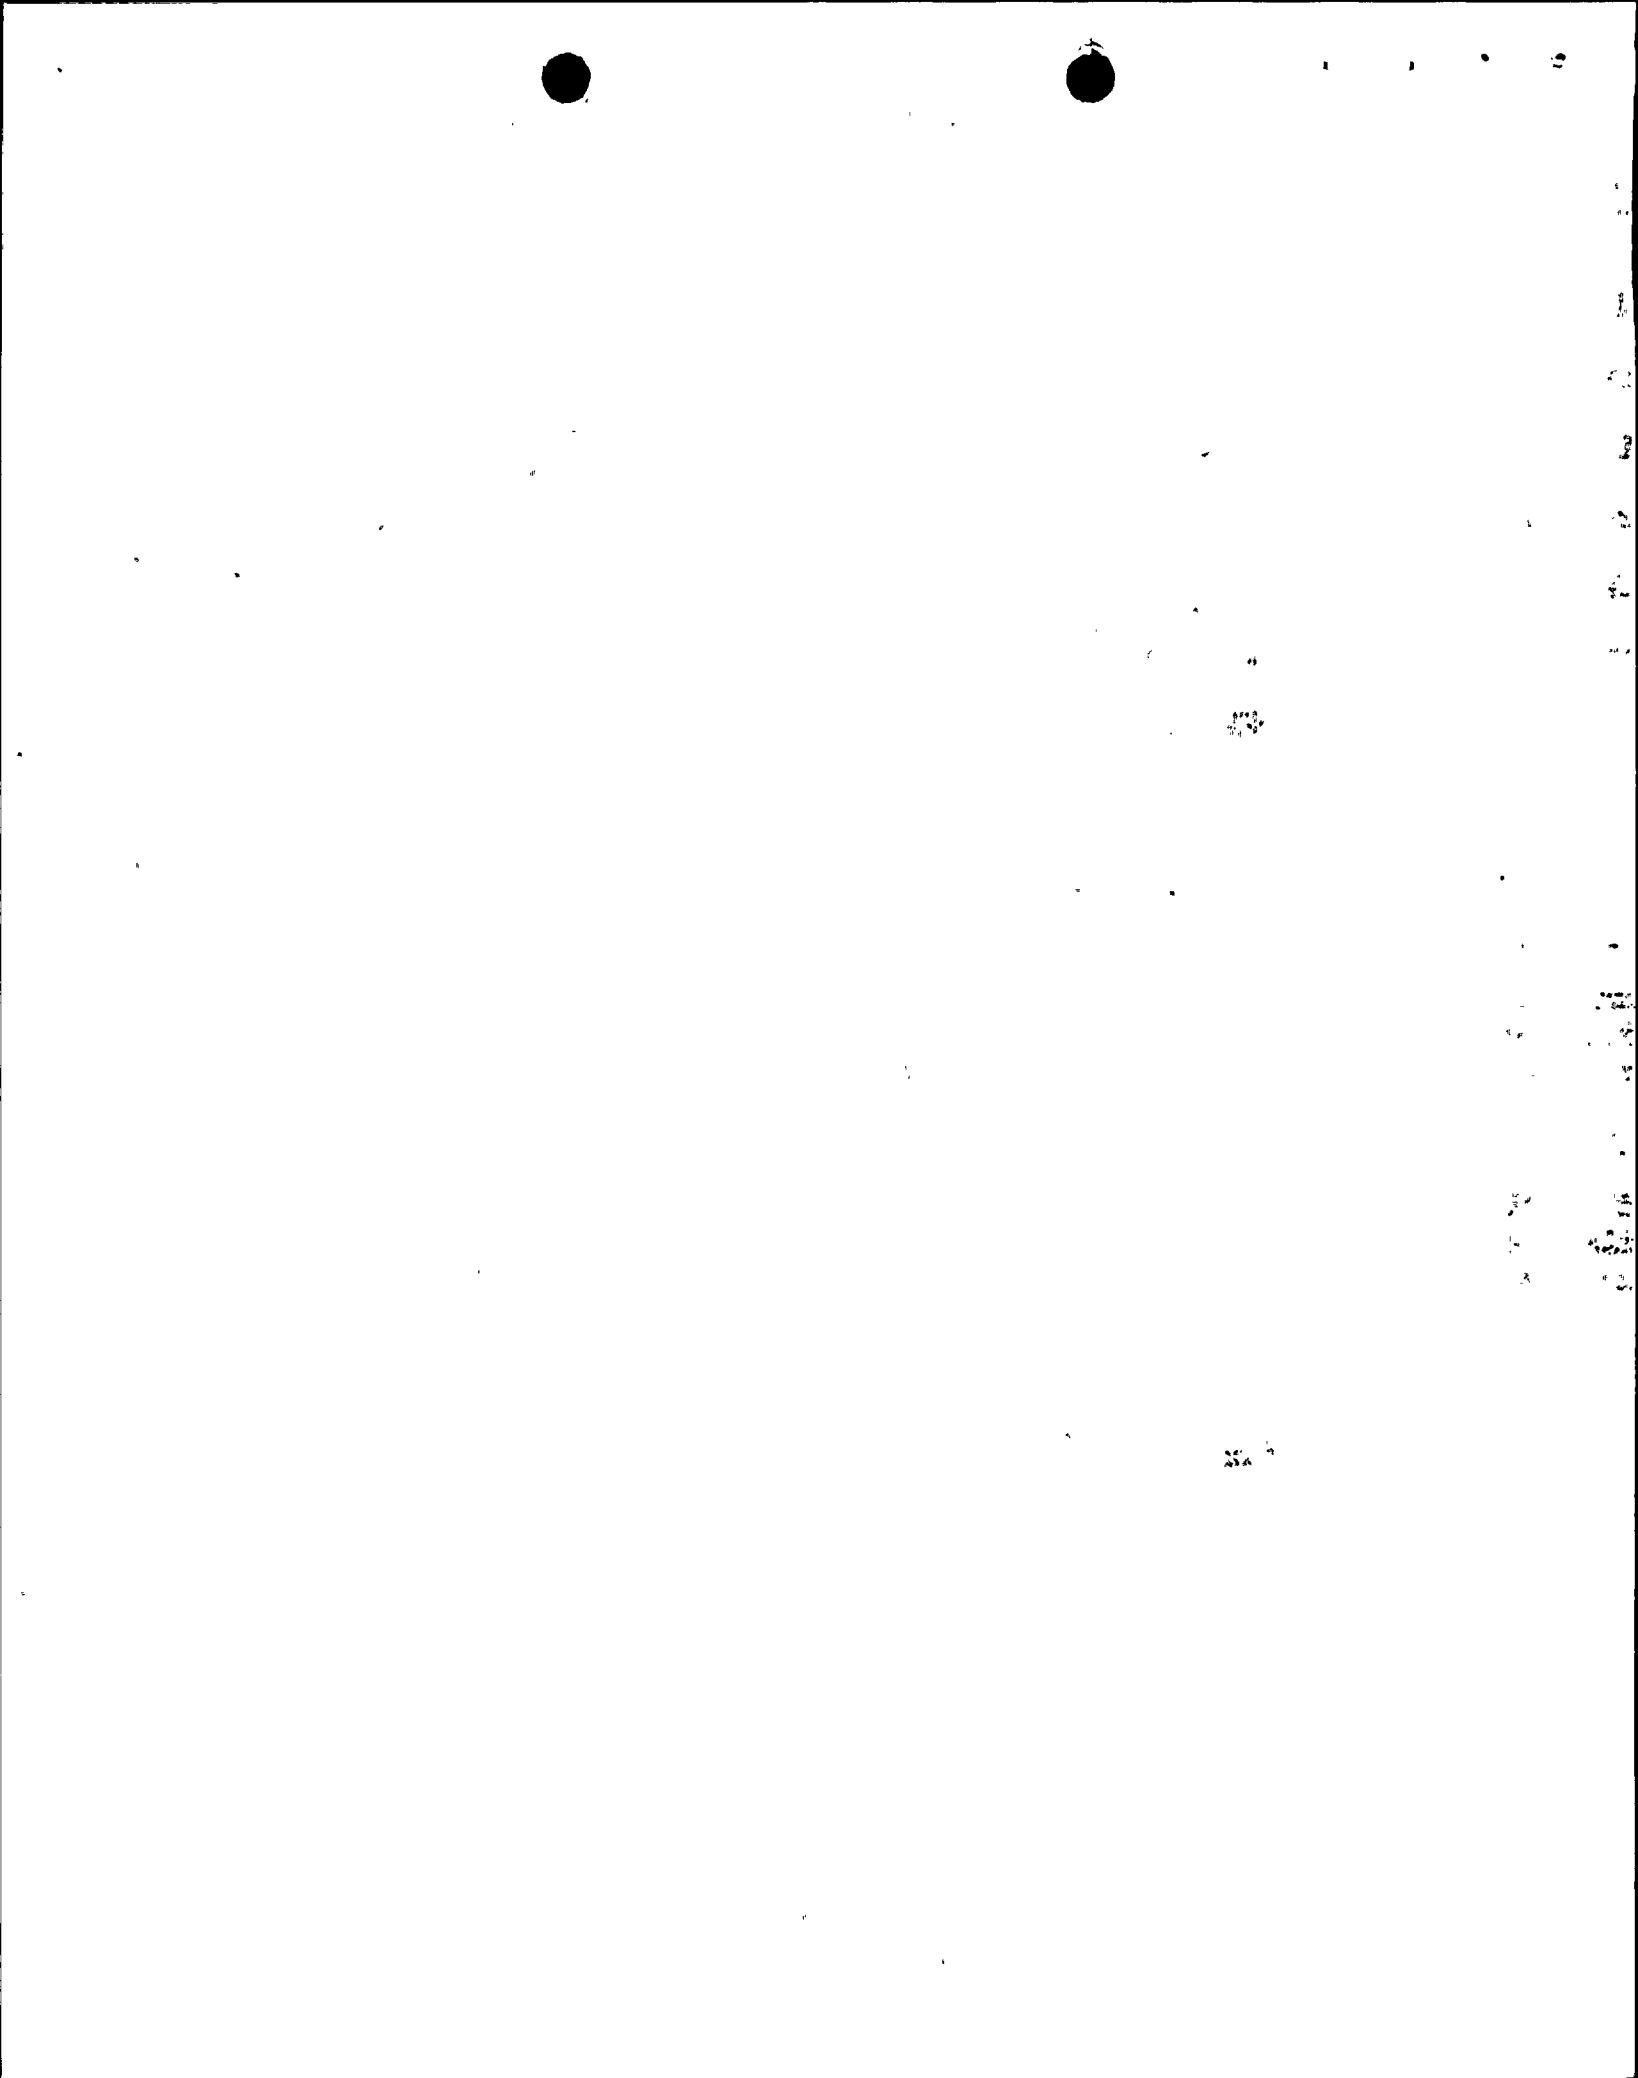

Bending stress in the shell,

$$\sigma_{\text{bending}} = 25,350 / [\pi \times (28/2)^2 \times 0.25] = 165 \text{ psi} \ll 24,000 \text{ psi}$$

Shear stress in the shell,

$$\tau = 3 \times (100 + 1,200) / (\pi \times 28 \times 0.25) = 177 \text{ psi} \ll 14,400 \text{ psi}$$

Shear stress in the weld caused by the bending moment,

$$\tau_{\text{bending}} = 25,350 / [\pi \times (28/2)^2 \times 0.707 \times 1/4] = 233 \text{ psi}$$

Shear stress in the weld caused by the shear force.

$$\tau_{\text{shear}} = 3 \times (100 + 1,200) / (\pi \times 28 \times 0.707 \times 1/4) = 251 \text{ psi}$$

Combined shear stress,

$$\tau = 233 + 251 = 484 \text{ psi} < 21,000 \text{ psi}$$

Handhole, Blowdown, Shell Drain and Water Level Nozzle Closures

These closures have the same design details as the manway closures. Since they are much smaller in size than the manway closure, the stresses calculated for the manway closure envelop the stresses in these closures.


Endplate Clips

Eight clips (Figure 4), in addition to the 3/8" fillet weld around the circumference hold the endplates of the SGLAs. These clips are designed to provide restraint to the endplate against 3g acceleration in all directions without relying on the endplate to steam generator weld. The endplates are 176 in diameter, 3 in thick that weigh,

$$W_p = \pi/4 \times 176^2 \times 3 \times 490/12^3 = 20,696 \text{ lbs say } 21,000 \text{ lbs}$$

The eight clips share the inertia load normal to the plate surface equally. Therefore, load on each clip is:

$$P = 3 \times 21,000 / 8 = 7,875 \text{ lbs}$$

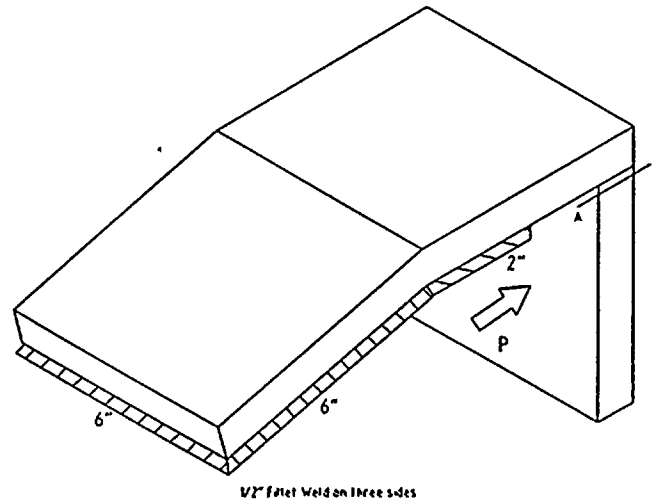


This load causes the shear of section AA. The average shear stress over this section is:

$$\tau = 7,875 / (6 \times 1) = 1,313 \text{ psi} \ll 14,400 \text{ psi}$$

The welds on the horizontal end react to this load. Assuming that only the weld legs parallel to the load react to it, the shear stress in the weld is:

$$\tau_{\text{weld}} = 7,875 / (2 \times 8 \times 0.5 \times 0.707) = 1,392 \text{ psi} \ll 21,000 \text{ psi}$$

The inertia load parallel to the plane of the endplate is assumed to be reacted by only two clips that are parallel to the direction of the load. In this case the loading on the clips are as follows:

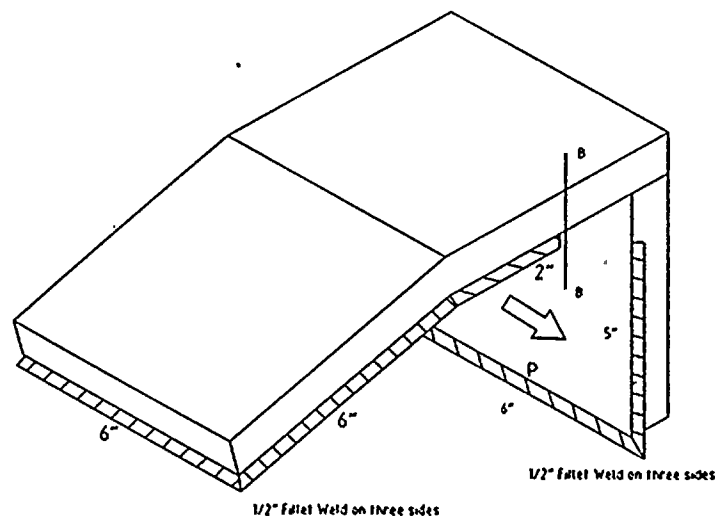

The loading on each clip is:

$$P = 3 \times 21,000 / 2 = 31,500 \text{ lbs}$$



11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

Shear stress on section BB is:

$$\tau = 31,500/(6 \times 1) = 5,250 \text{ psi} \ll 14,400 \text{ psi}$$

Bending stress on section BB is:

$$\sigma_{\text{bending}} = 31,500 \times 3 \times 6 / (1 \times 6^2) = 15,750 \text{ psi} < 24,000 \text{ psi}$$

To calculate the maximum stress in the weld group on the steam generator, the entire group of weld is assumed to react the 31,500 load and the two 8 in legs only are assumed to react to the bending moment. The stresses due to these two effects are added to obtain the maximum weld stress. Shear stress due to 31,500 lbs force.

$$\tau_{\text{force}} = 31,500 / (22 \times 0.5 \times 0.707) = 4,050 \text{ psi}$$

Shear stress in the weld due to bending moment,

$$\tau_{\text{moment}} = 31,500 \times 8 / (6 \times 8 \times 0.5 \times 0.707) = 14,851 \text{ psi}$$

Combined shear stress,

$$\tau = 4,050 + 14,851 = 18,901 \text{ psi} < 21,000 \text{ psi}$$

CONCLUSIONS

It has been shown in this report that all the closures of the SGLA have adequate strength to react to the load normally expected during its handling and transportation. The stress allowables based on the AISC criteria are satisfied by all the components of the closure assembly with a large margin of safety. SGLAs will be, therefore, completely sealed and behave like a unitized body for which exemption from packaging may be requested from DOT.



1950

1950

Vertical text on the right edge of the page, possibly a page number or margin note.

Title Structural Evaluation of the D.C: Cook Unit 2 S.G.L.A. Package

Calc. No. ST-307 Rev. 0

Sheet 8 of 10

Table 1 - Location of the Protrusions on the D.C. Cook SGLA

Protrusion	Circumferential Location from the Top (Degrees)
Primary Inlet Nozzle	36.3
Primary Outlet Nozzle	143.7
Handhole No.1	90
Handhole No.2	270
Primary Manway No.1	308.7
Primary Manway No.2	241.7
Blow-Down Nozzle No.1	90
Blow-Down Nozzle No.2	270
Shell Drain	206.3
Water Level Tap	126.7
End Plate	-(1)

Notes:

(1) 3" End-plate is used to close the cut end of the SGLA.

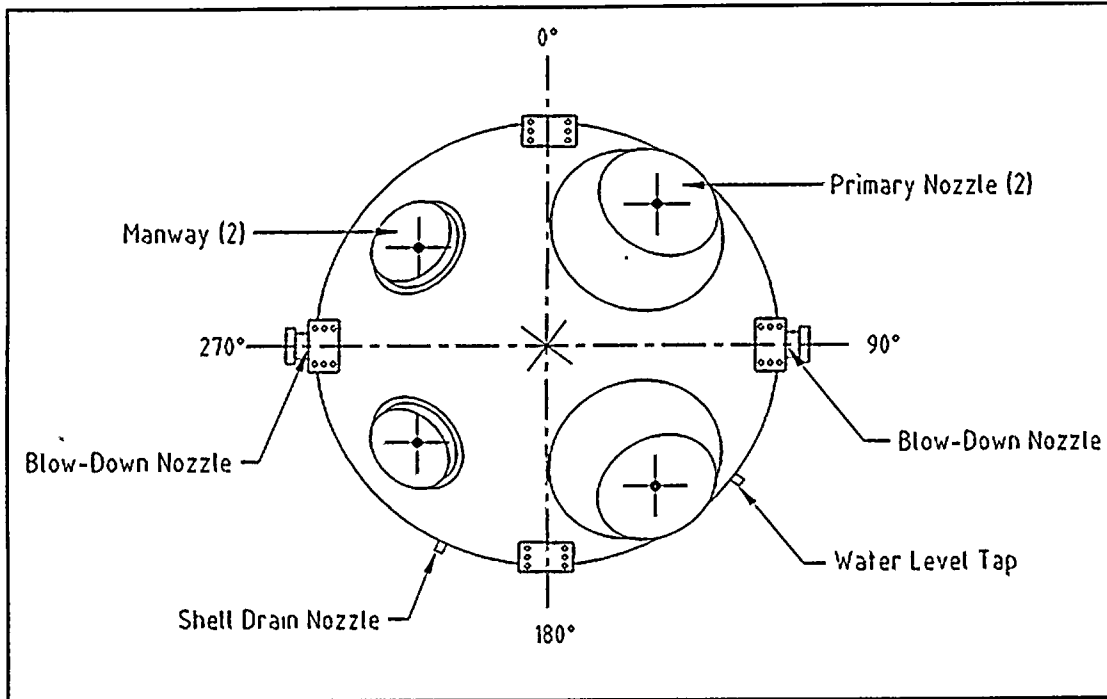


Figure-1 D.C. Cook SGLA Protrusion Location

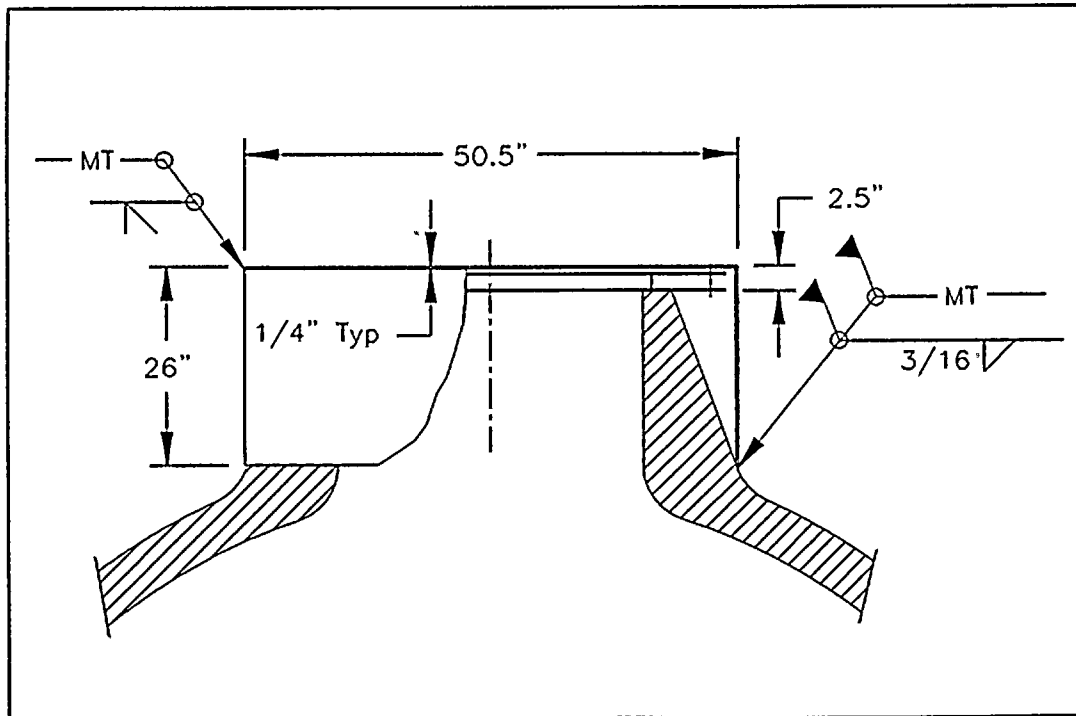


Figure-2 Primary Nozzle Cover Details

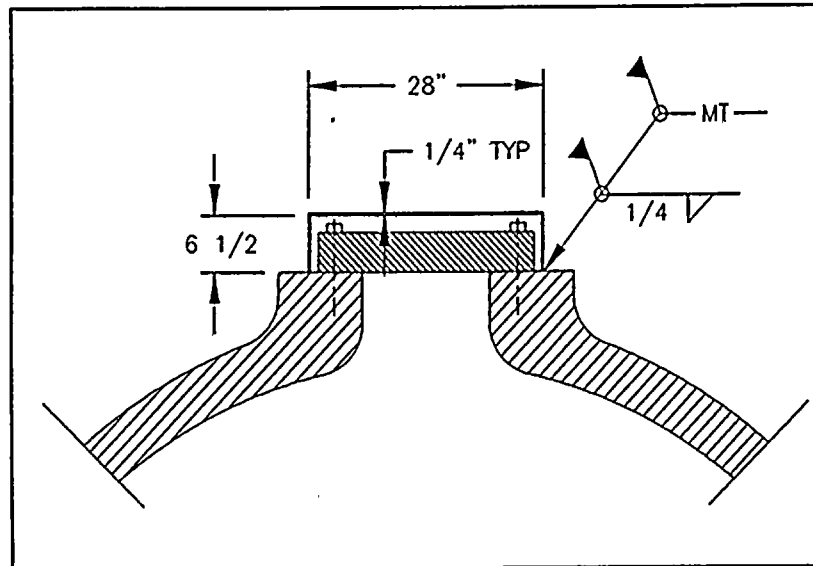


Figure-3 Manway Cover Details

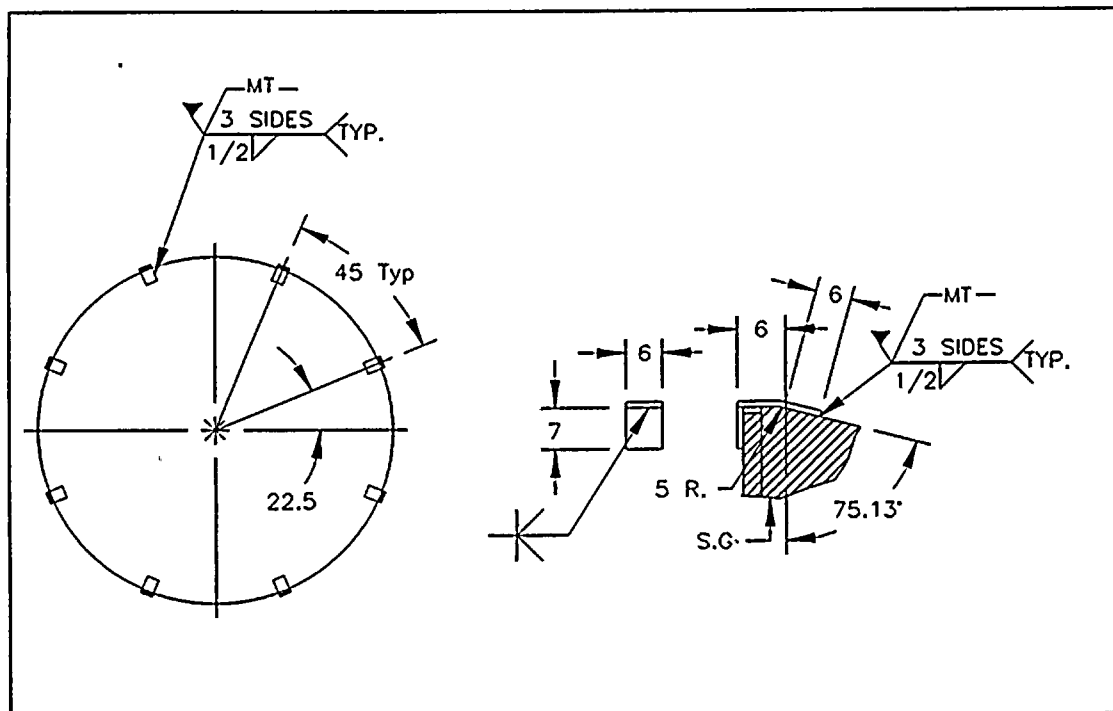


Figure-4 End-Plate Attachment Details

