

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8101230428 DOC. DATE: 81/01/14 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 VARGA, S.A. Operating Reactors Branch 1

SUBJECT: Forwards "Auxiliary Feedwater Pumps Endurance Test," per NRC 800530 ltr.


DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 3 ENCL 3 SIZE: 1+31
 TITLE: General Distribution for after Issuance of Operating License

NOTES:

ACTION:	RECIPIENT	COPIES	RECIPIENT		COPIES
	ID CODE/NAME		LTR	ENCL	
	VARGA, S. 04	13	13		
INTERNAL:	D/DIR, HUM FAC08	1	1	DIR, DIV OF LIC	1 1
	I&E 06	2	2	NRC PDR 02	1 1
	OELD 11	1	0	OR ASSESS BR 10	1 0
	REG FILE 01	1	1		
EXTERNAL:	ACRS 09	16	16	LPDR 03	1 1
	NSIC 05	1	1		

JAN 26 1981

41

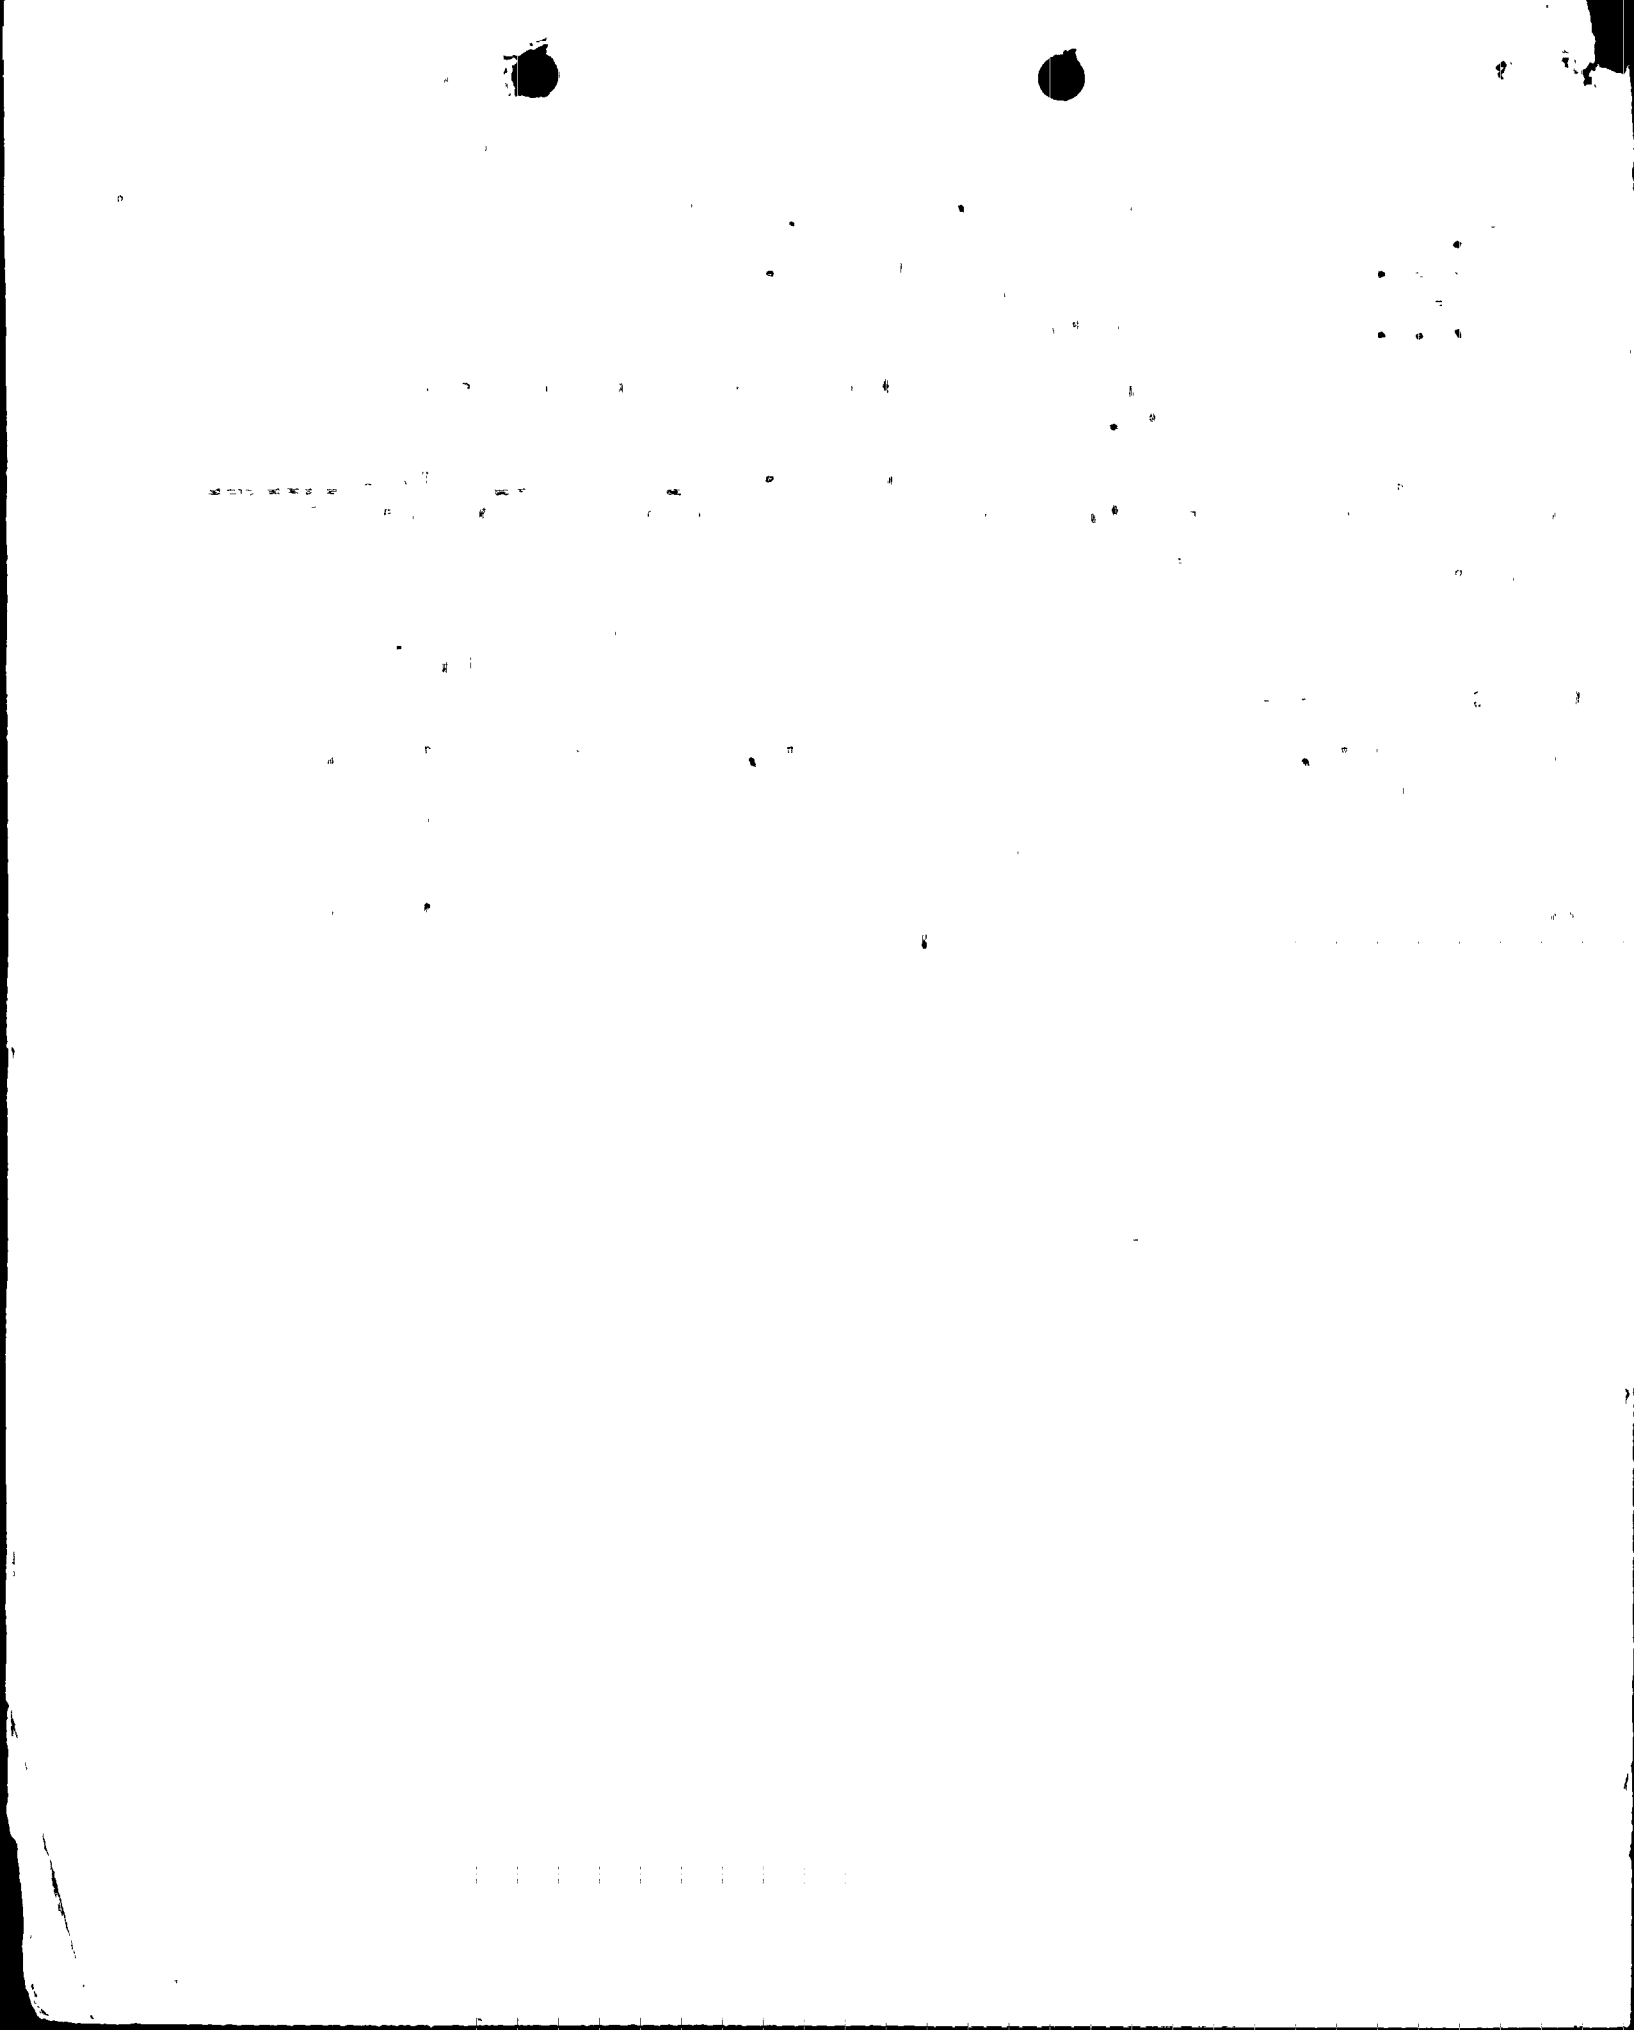



January 14, 1981
L-81-18

Office of Nuclear Reactor Regulation
Attention: Mr. S.A. Varga, Chief
Operating Reactors Branch #1
Division of Operating Reactors
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4
Docket Nos. 50-250 and 50-251
Auxiliary Feedwater Pump Endurance Test

Florida Power & Light has completed an endurance test of the Auxiliary Feedwater Pumps at the Turkey Point Plant as requested in your letter dated May 30, 1980. Our report of the results of that test is attached.

Very truly yours,

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PLP/mbd

cc: J.P. O'Reilly, Region II
Harold F. Reis, Esquire

US NRC
DISTRIBUTION SERVICES
BRANCH

1981 JAN 22 PM 3 31

DISTRIBUTION
SERVICES UNIT

A001
S
3/3

P 8101230428

