

APR 17 1981

Docket No. 50-250

Dr. Robert E. Uhrig, Vice President  
Advanced Systems and Technology  
Florida Power and Light Company  
Post Office Box 529100  
Miami, Florida 33152

DISTRIBUTION:

Docket  
NRC PDR  
L PDR  
TERA  
NSIC  
ORB#1 Rdg  
DEisenhut  
OELD  
IE-3  
ACRS-10  
SVarga  
CParrish  
MGrotenhuis



Dear Dr. Uhrig:

In accordance with paragraph 3.E.5 of Facility Operating License No. DPR-31 for Turkey Point Plant Unit No. 3, you conducted an inspection of the steam generator tubes and submitted the results to us for our review and approval prior to restart by letter dated April 2, 1981.

We find that the inspection results and implemented preventive plugging program provide adequate justification to support six equivalent full power months of operation before the next steam generator inspection will be performed. Therefore, approval is hereby granted for resumption of power operation of Turkey Point No. 3.

Your request for a license amendment for the subsequent steam generator inspections should be submitted within the next two weeks.

Sincerely,

Original signed by:  
S. A. Varga

Steven A. Varga, Chief  
Operating Reactors Branch #1  
Division of Licensing

cc: See next page

81 05 060 024

OFFICE	ORB#1:DL	ORB#1:DL					
SURNAME	MGrotenhuis	SVarga:ds					
DATE	4/17/81:ds	4/17/81					





UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

Docket

April 17, 1981

Docket No. 50-250

Dr. Robert E. Uhrig, Vice President  
Advanced Systems and Technology  
Florida Power and Light Company  
Post Office Box 529100  
Miami, Florida 33152

Dear Dr. Uhrig:

In accordance with paragraph 3.E.5 of Facility Operating License No. DPR-31 for Turkey Point Plant Unit No. 3, you conducted an inspection of the steam generator tubes and submitted the results to us for our review and approval prior to restart by letter dated April 2, 1981.

We find that the inspection results and implemented preventive plugging program provide adequate justification to support six equivalent full power months of operation before the next steam generator inspection will be performed. Therefore, approval is hereby granted for resumption of power operation of Turkey Point No. 3.


Your request for a license amendment for the subsequent steam generator inspections should be submitted within the next two weeks.

Sincerely,

A handwritten signature in dark ink, appearing to read "Steven A. Varga", is written over the typed name.

Steven A. Varga, Chief  
Operating Reactors Branch #1  
Division of Licensing

cc: See next page

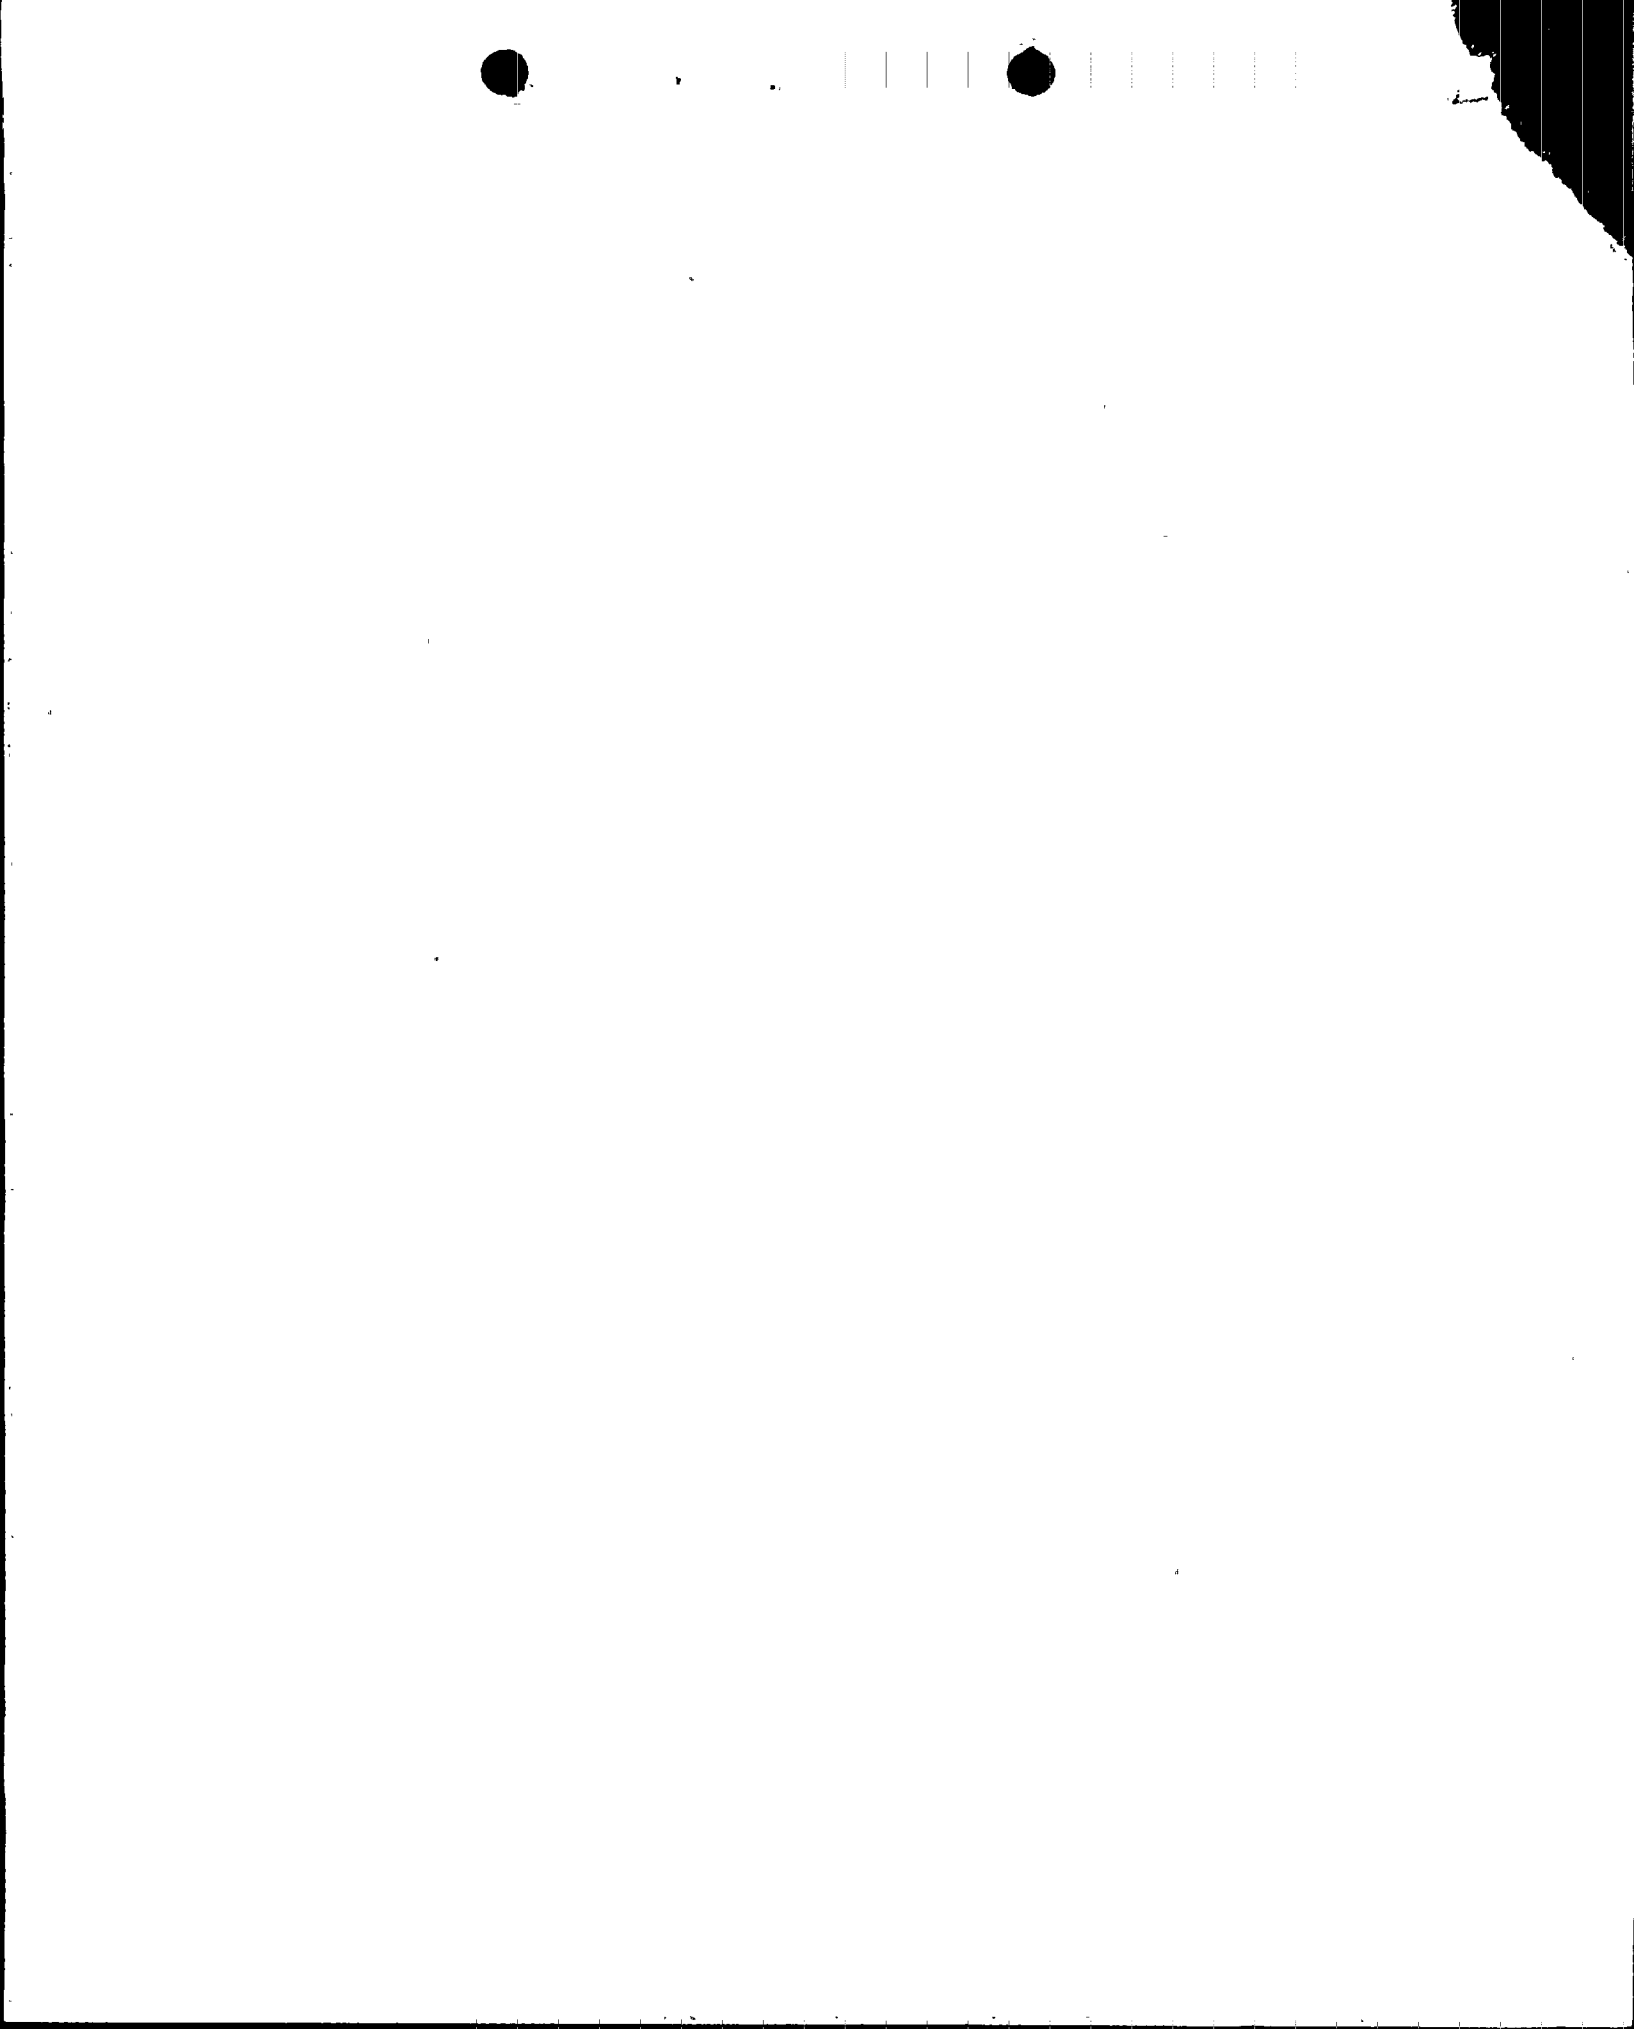

Robert E. Uhrig  
Florida Power and Light Company

cc: Mr. Robert Lowenstein, Esquire  
Lowenstein, Newman, Reis and Axelrad  
1025 Connecticut Avenue, N.W.  
Suite 1214  
Washington, D. C. 20036

Environmental and Urban Affairs Library  
Florida International University  
Miami, Florida 33199

Mr. Norman A. Coll, Esquire  
Steel, Hector and Davis  
1400 Southeast First National  
Bank Building  
Miami, Florida 33131

Mr. Henry Yaeger, Plant Manager  
Turkey Point Plant  
Florida Power and Light Company  
P. O. Box 013100  
Miami, Florida 33101

Mr. Jack Shreve  
Office of the Public Counsel  
Room 4, Holland Building  
Tallahassee, Florida 32304

Administrator  
Department of Environmental Regulation  
Power Plant Siting Section  
State of Florida  
2600 Blair Stone Road  
Tallahassee, Florida 32301

Resident Inspector  
Turkey Point Nuclear Generating Station  
U. S. Nuclear Regulatory Commission  
Post Office Box 1207  
Homestead, Florida 33030

