

5/15/81

UNITED STATES OF AMERICA
NUCLEAR REGULATORY COMMISSION

BEFORE THE ATOMIC SAFETY AND LICENSING BOARD

In the Matter of)	
FLORIDA POWER AND LIGHT COMPANY)	Docket Nos. 50-250
)	50-251
(Turkey Point Nuclear Generating)	(Proposed Amendments to Facility
Unit Nos. 3 and 4))	Operating Licenses to Permit
)	Steam Generator Repair)

TESTIMONY OF ROBERT F. ABBEY, JR. ON CONTENTION 4B

Q. 1. Could you please state your name and place of employment?

A. My name is Robert F. Abbey, Jr. I am employed by the U.S. Nuclear Regulatory Commission as a Senior Environmental Scientist (Meteorologist), presently on detail to the Division of Systems Integration, Office of Nuclear Reactor Regulation, from the Office of Nuclear Regulatory Research. A copy of my professional qualifications are attached.

Q. 2. Have you reviewed the tornado, hurricane, and fastest-mile windspeed data corresponding to the area encompassing the Turkey Point plant site?

If so, what did this data consist of?

A. Yes. The data, in part, consisted of frequency of occurrence of tornadoes and hurricanes, their associated windspeeds (measured and calculated), and the actual date of occurrence of each event. The data period of record for tornadoes was 1950-1979; the data period for hurricanes was 1871-1978.^{1,2,3} The area that encompasses the Turkey Point site was considered to be 50 miles in coastline length.⁴




Q. 3. How would you define the hurricane season for southeast Florida?

A. All major hurricanes (windspeeds greater than 110 mph) in the southeast area of Florida have occurred in August, September, and October only; with one, seven, and two occurrences, respectively.⁵ For the 50 mile segment encompassing the Turkey Point site, the earliest recorded hurricane made landfall on September 8; the latest occurring hurricane occurred on October 21.² The hurricane season is defined as June 1 through November 30.⁶ Hurricanes are tropical cyclones that have attained windspeeds at least 74 mph.¹

Q. 4. How would you define the tornado season for southeast Florida?

A. The tornado season is more difficult to define. Within 125 nautical miles of the Turkey Point site, 253 tornadoes have been reported in the period 1950-1980. Of these tornadoes, 14 occurred in the months of January and December combined; 51 tornadoes were reported in June, the maximum in any one month. In the one degree square encompassing the Turkey Point site, 37 tornadoes have been reported in the period 1950-1979. One tornado had estimated windspeeds in the range 207-260 mph; one tornado had estimated windspeeds in the range 158-206 mph; three tornadoes had estimated windspeeds 113-157 mph; nine with windspeeds 73-112 mph; and 23 had windspeeds between 40-72 mph.

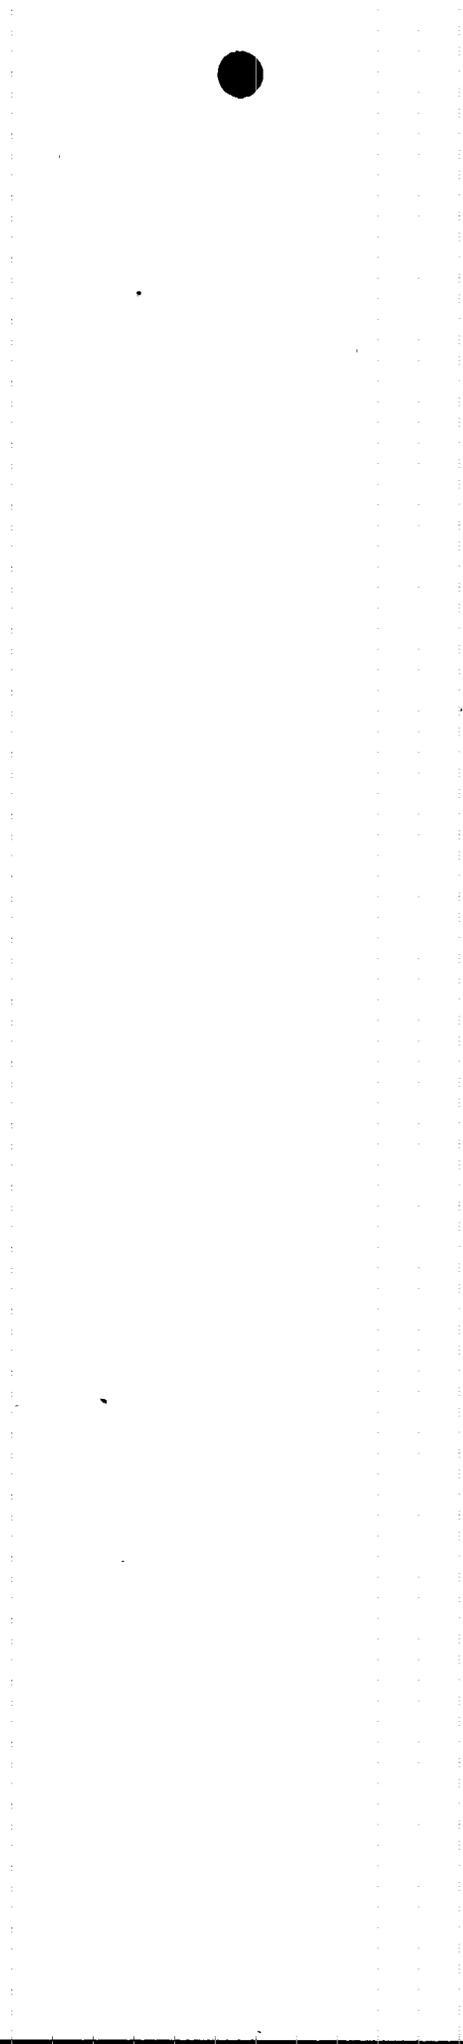

Q. 5. Have you calculated the windspeed hazard probabilities for the Turkey Point site? If so, please state your calculations.

A. The windspeed hazard probabilities for the Turkey Point site have been calculated; the fastest-mile windspeeds from Key West, Florida have been used to represent the Turkey Point site. These are thought to be conservative (higher) windspeeds that would occur at Turkey Point due to the more exposed location of Key West as compared to Turkey Point. Table 1 summarizes the results of these calculations.



Q. 6. What is the windspeed sufficient to dislodge and overturn the replaced steam generator lower assembly (SGLA) and its probability of occurrence?

A. A windspeed sufficient to dislodge and overturn the replaced steam generator lower assembly (SGLA) following its removal from the containment and prior to its destined onsite storage when located on two three-foot high supports ranges from 390 mph to 635 mph depending on the support width; the narrower the distance between supports, the less windspeed required to overturn the SGLA. The greatest recorded hurricane windspeed at the site is about 150 mph; the greatest inferred tornado windspeed is between 207 and 260 mph. As shown in Table 1, the probability of the site experiencing a 150 mph windspeed event is about $5 \times 10^{-4}/\text{yr}$; the probability of the site experiencing a 260 mph event is $1.5 \times 10^{-7}/\text{yr}$. The probability of a windspeed necessary to overturn the SGLA is on the order of $1 \times 10^{-10}/\text{yr}$. These windspeeds could only be caused by a tornado passage. Should the SGLA be in the containment building during a tornado passage, no appreciable, if any, damage would result, even considering the hatch door to be open.



Q. 7. Did you draw any conclusion with regard to the probability of an SGLA being moved by the wind? If so, please state your conclusion.

A. Yes. Based on my review of the possibility of tornadoes or hurricanes causing the SGLAs to be moved or bump into one another or other solid object, I conclude that the SGLAs have an extremely small probability (1×10^{-10} /yr) of even being moved by the wind, let alone cause a release of radioactive material. This conclusion is based on the following:


- 1) the season for hurricanes (September-late October) for the Turkey Point site compared to the proposed SGLA repair schedule (approximately October-June);
- 2) the remote chance of a tornado occurrence, much less a tornado of the magnitude required to move the SGLA;
- 3) the remote probability of a windspeed occurring sufficient to dislodge the SGLA from its supports (1×10^{-10} /yr based on worst case support width); and
- 4) the unlikely chance that even if the SGLA should be moved, it would strike some other object with an impact as great as for the 12 ft drop analyzed in Section 4.4 of the Final Environmental Statement (NUREG-0743) related to the steam generator repair.



Q. 8. Did you examine the probabilities associated with tornado or hurricane generated missiles (projectiles) penetrating an SGLA outside of containment? If so, please state those probabilities.

A. Yes. I have examined the probabilities associated with tornado or hurricane generated missiles (projectiles) penetrating the SGLA when the SGLA is outside of the containment building. In addition to the probability of the site experiencing a hurricane or tornado of sufficient windspeed, the following probabilities have to be factored in:

- a. the probability that a significant postulated missile exists at the site in such a location (generally not on the ground) as to make itself available for pickup;
- b. the probability that once the missile is picked up it will transverse such a path so as to strike the SGLA;
- c. the probability that the missile will attain a speed necessary to penetrate the steel shell of the SGLA;
- d. the probability that the missile with the required speed will penetrate the SGLA in a critical part so as to breach the SGLA in such a manner as to expose radioactive material to the passage of air; and
- e. the probability that once exposed to the air, the radioactive material will become airborne and disperse downwind.



If one assumes that the probabilities associated with question 8 equal 1, then the probability of missiles eventually causing a release of radioactive material from a SGLA during transit from the containment to temporary outside storage is at least of the order $1 \times 10^{-7}/\text{yr}$.

Q. 9 Is it reasonable to assume that the probabilities associated with your answer to question 8 are equal to one?

A. No. It can reasonably be argued that those probabilities are of the order $1 \times 10^{-2}/\text{yr}$ or less. Particularly, the probability associated with a tornado windspeed necessary to drive a 1" rebar, for example, through the SGLA is less than 1×10^{-12} . This would yield the probability of missiles caused by tornadoes resulting in release of radioactive material to be on the order of $1 \times 10^{-14}/\text{yr}$ or less. It is important to realize that if the breaching of the SGLA be by a tornado (or even by a hurricane with windspeeds about 100 mph), that the resulting dilution of the radioactive material would be increased in proportion to the windspeed.

Q. 10. In your opinion, what is the initiating mechanism that would cause any object to strike with sufficient velocity to penetrate the SGLA or a reinforced concrete building?

A. Hurricane winds have not been known to cause objects to become projectiles with sufficient velocity to penetrate reinforced concrete buildings or thick steel shells. The most likely generating event would be a tornado; the tornado begins to dominate the windspeed hazard probabilities at about a level of $1.5 \times 10^{-7}/\text{yr}$ with a windspeed of about 260 mph. This windspeed is not sufficient to drive projectiles through either 2 ft thick reinforced concrete or 3" thick steel plates, such as the SGLA.



4
2
3
4

Q. 11. Even if radioactive material could be released during a hurricane or tornado passage, what would be the resultant downwind concentration?

A. In the FES, Section 4.4, the limiting accident, the 12 foot drop, assumed a windspeed of 2 mph and very stable atmospheric conditions. A tornado or hurricane passage would increase the dilution a factor of 50 to 150 by virtue of the windspeed alone; and yet again increase the dilution by virtue of the highly unstable conditions giving rise to dispersion coefficients greater than those used for the 12 foot drop. This, in turn, would increase the dilution even more.

A. 12. In section 8.6.5 of the FES, the Staff reached the following conclusions concerning the potential effects of breaching the SGLA outside of containment:

...breaching the generators during the transit from the containment to the storage building has been considered by the staff (Section 4.4). Regardless of the mechanism, the staff concluded that the most pessimistic result (i.e., the largest calculated dose) is as indicated; namely, dropping the generator outside containment during normal (non-storm) meteorological conditions. Should the breaching mechanism be by hurricane or tornado, which is a highly unlikely occurrence due to the weight of the generators and the strength of the welds, the conservatively evaluated release would be the same. However, the dispersion factor would be much larger and the environmental impact thus reduced.

Q. 13. Do you concur with this conclusion?

A. Yes.

