



UNITED STATES
NUCLEAR REGULATORY COMMISSION


WASHINGTON, D. C. 20555

February 11, 1982

50-250/251 Turkey Point

MEMORANDUM FOR: Chief, Document Management Branch, TIDC
FROM: Director, Division of Rules and Records, ADM
SUBJECT: REVIEW OF UTILITY EMERGENCY PLAN DOCUMENTATION

The submitter of the attached document has expressed no desire to withhold any information contained therein. Therefore, this material may now be made publicly available.

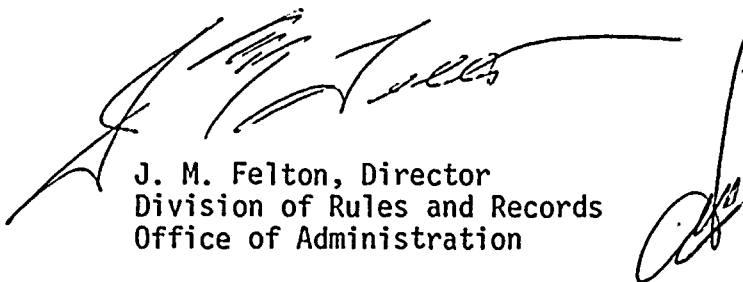
J. M. Felton, Director
Division of Rules and Records
Office of Administration


Attachment: As stated



8202190086 820211
PDR ADDCK 05000250
F PDR



Handwritten text at the bottom right of the page, which is mostly illegible due to fading and blurring.



REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: ~~8202050555~~ DUC DATE: 82/01/27 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 HAYS, J.K. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION

SUBJECT: Central Files version of Emergency Procedure 20007, "Loss of All AC Power."

DISTRIBUTION CODE: X005S COPIES RECEIVED: LTR 0 ENCL 1 SIZE: 26
 TITLE: Emerg Plan (CF Avail)


NOTES:

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
	ORB #1 BC		0	GROTENHUIS, N 01		1
INTERNAL:	<u>ADM/DRR</u> 02		1	FEMA-REP DIV 09		1
	IE 08	2	1	IE/DEP DIR		0
	IE/DEP/EPDB 06		1	IE/DEP/EPLB 03	3	3
	NRR/DSI/AEB		1	NRR/DSI/RAB		0
	REG FILES 07		1			

TOTAL NUMBER OF COPIES REQUIRED: LTR 0 ENCL 10

50-250

FLORIDA POWER AND LIGHT COMPANY
TURKEY POINT UNITS 3 AND 4
EMERGENCY PROCEDURE 20007
JANUARY 21, 1982

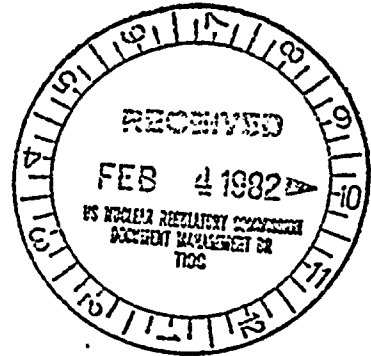

1.0 Title:

LOSS OF ALL A.C. POWER

2.0 Approval and List of Effective Pages:

2.1 Approval:

Change dated 1/21/82 Reviewed by PNSC January 21, 1982

Approved by [Signature] Plant Mgr.-Nuc January 27, 1982

2.2 List of Effective Pages:

<u>Page</u>	<u>Date</u>	<u>Page</u>	<u>Date</u>	<u>Page</u>	<u>Date</u>	<u>Page</u>	<u>Date</u>
1	1/21/82	8	1/21/82	15	1/21/82	22	1/21/82
2	1/21/82	9	1/21/82	16	1/21/82	23	1/21/82
3	1/21/82	10	1/21/82	17	1/21/82	24	1/21/82
4	1/21/82	11	1/21/82	18	1/21/82	25	1/21/82
5	1/21/82	12	1/21/82	19	1/21/82	26	1/21/82
6	1/21/82	13	1/21/82	20	1/21/82		
7	1/21/82	14	1/21/82	21	1/21/82		

3.0 Purpose:

This instruction verifies the proper response of available automatic protection systems following the loss of all A.C. power and specifies appropriate operator actions to:

- 3.1 Minimize RCS Inventory Loss
- 3.2 Maintain an Ultimate Heat Sink
- 3.3 Restore A.C. Power
- 3.4 Recover the Plant following Restoration of Power

8202190089 820211
PDR ADDCK 05000250
PDR

4.0 Symptoms:

The following are symptoms of a Loss of All A.C. Power. These symptoms should all appear simultaneously.

- 4.1 Control Room Standard Lighting Off and Emergency Lighting On
- 4.2 Plant Safeguards Equipment Not Energized
- 4.3 Zero Voltage Indication on both 4KV Buses

NOTE: A loss of all A.C. power is an UNUSUAL EVENT. Notify the Nuclear Plant Supervisor.

~~8202030333 820127~~
~~CF ADDCK 05000250~~
~~OF~~

X005
50/11



1951