


TABLE 4.1-2 (SHEET 2 OF 3)

MINIMUM FREQUENCIES FOR EQUIPMENT AND SAMPLING TESTS

11.	Reactor Coolant System Leakage	Evaluate	Daily	NA
12.	Diesel Fuel Supply	Fuel inventory	Weekly	10
13.	Spent Fuel Pit	Boron Concentration	Prior to refueling	NA
14.	Secondary Coolant	I-131 Concentration	Weekly**	10
15.	Vent Gas & Particulates	I-131 & Particulate Activity	Weekly*	10
16.	Fire Protection Pump & Power Supply	Operable	Monthly	45
17.	Turbine Stop and Control Valves, Reheater Stop and Intercept Valves	Closure	Monthly***	45
18.	LP Turbine Rotor Inspector (w/o rotor disassembly)	V, MT, PT	Every 5 Years	6 Years
19.	Spent Fuel Cask Crane Interlocks	Functioning	Within 7 days	7 days when crane is being used to maneuver spent fuel cask

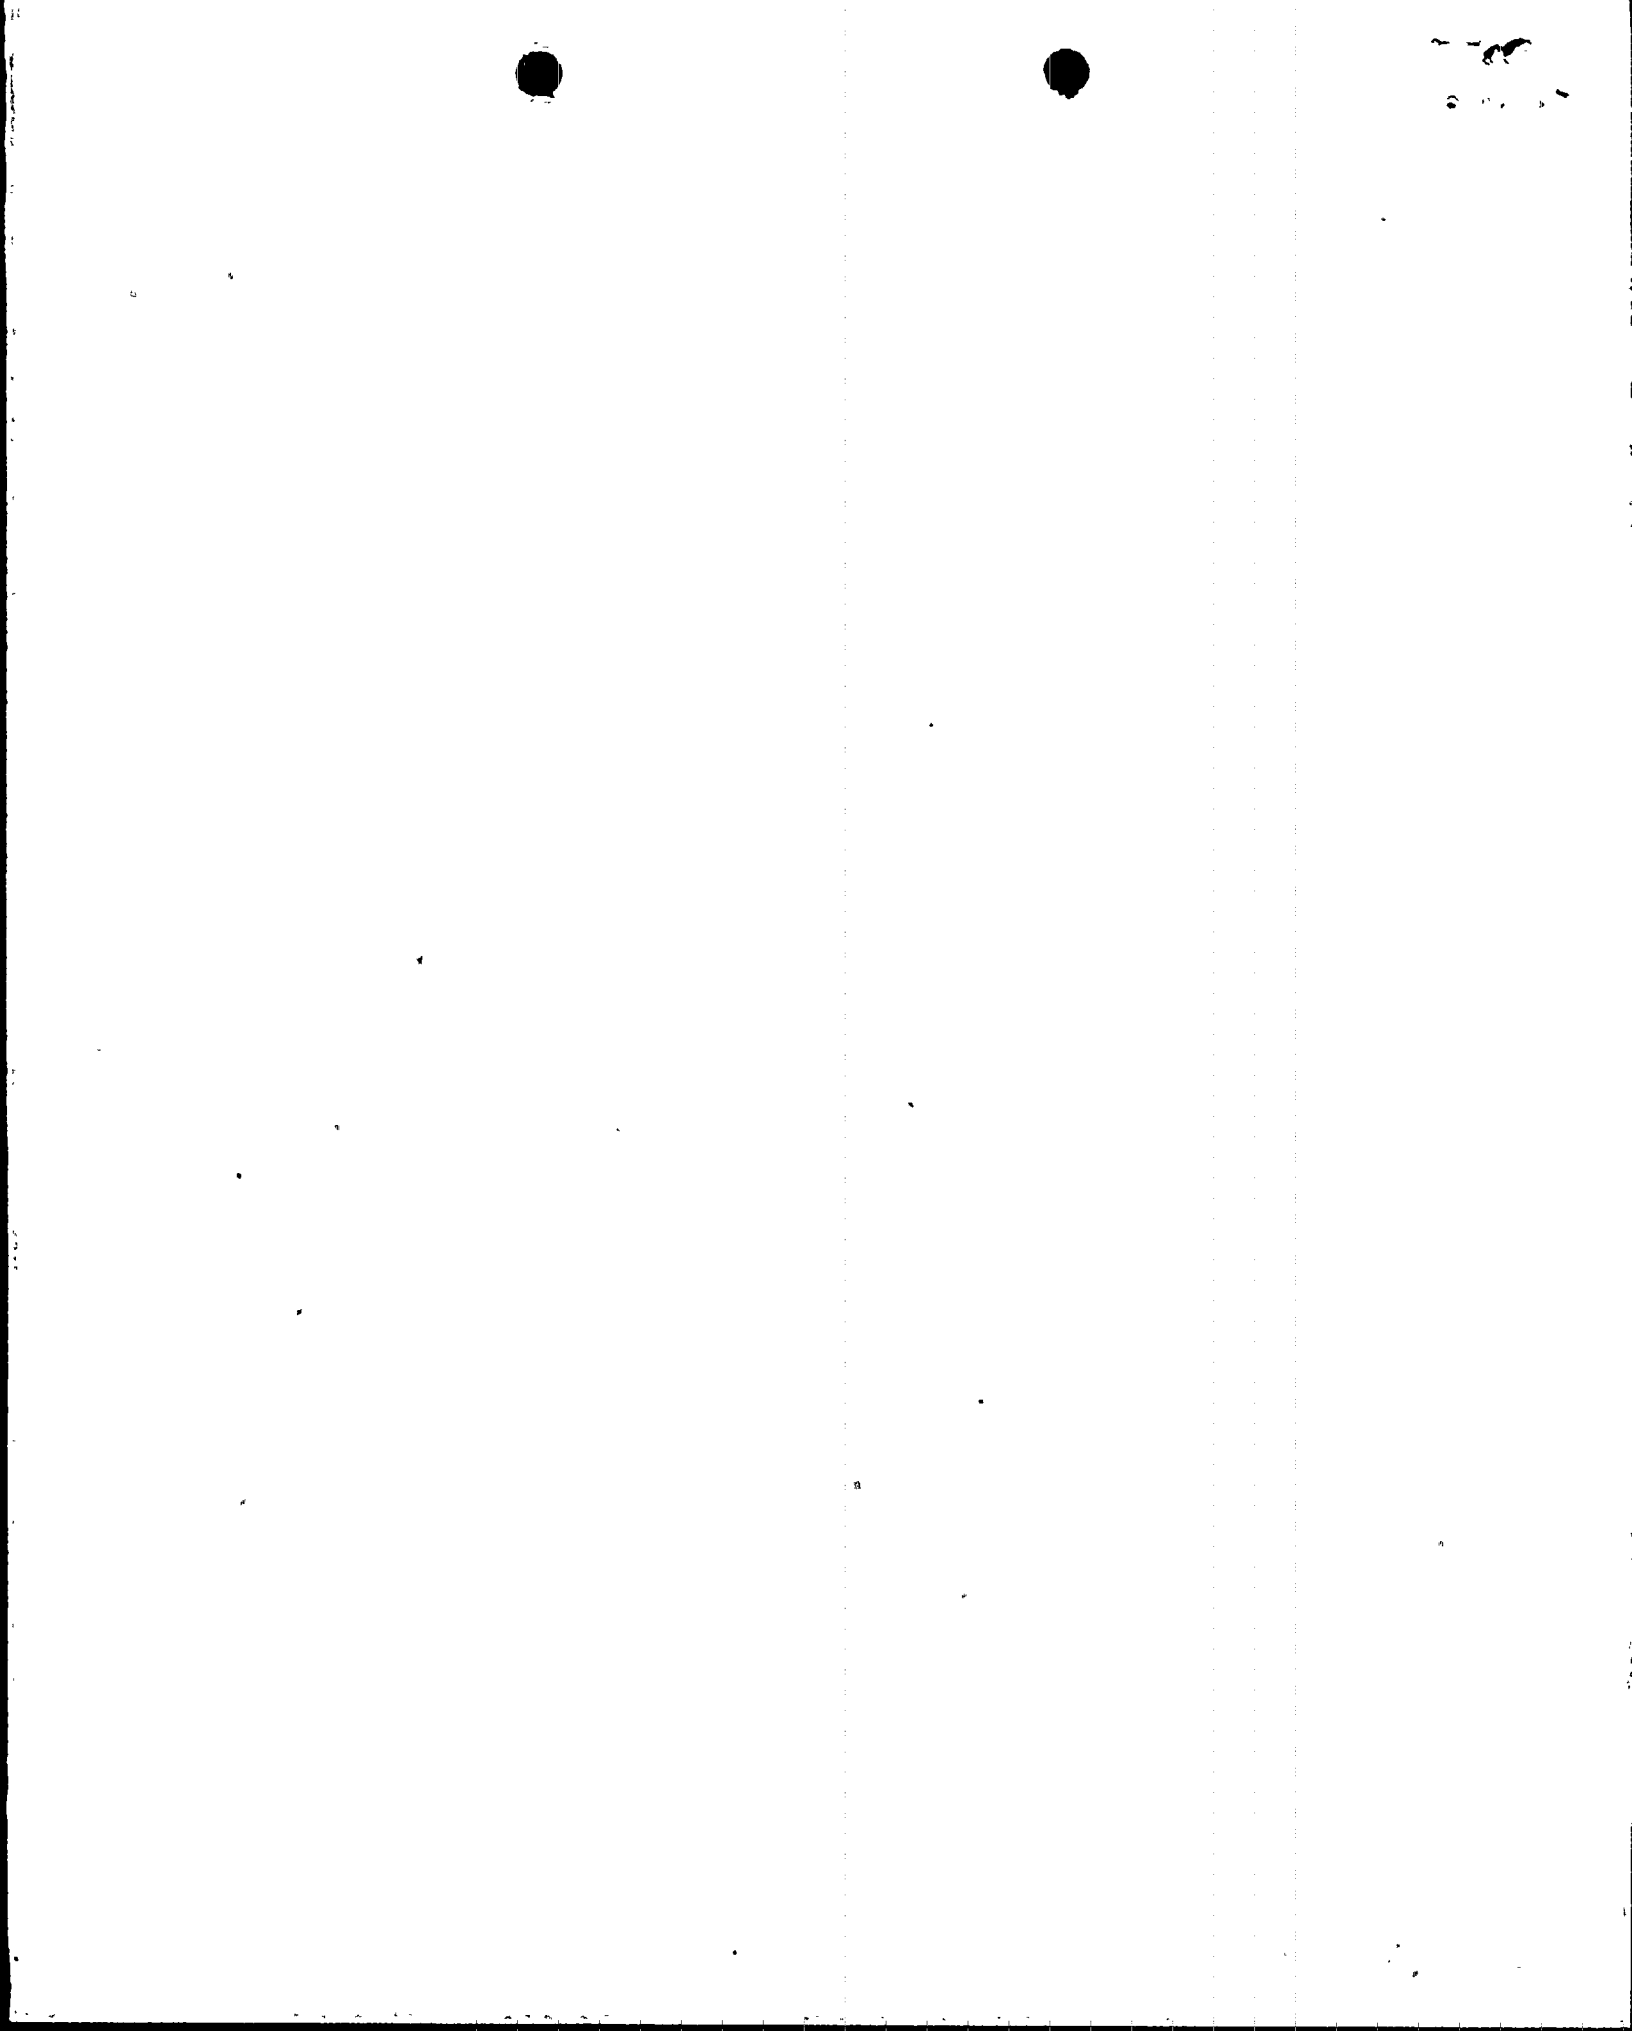

4. ONE residual heat removal pump may be out of service, provided the pump is restored to operable status within 24 hours. In addition the other residual heat removal pump shall be tested to demonstrate operability prior to initiating maintenance of the inoperable pump:

