

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8211150134      DOC. DATE: 82/11/10      NOTARIZED: NO      DOCKET #  
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C      05000250  
       50-251 Turkey Point Plant, Unit 4, Florida Power and Light C      05000251  
 AUTH. NAME      AUTHOR AFFILIATION  
 UHRIG, R. E.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
 VARGA, S. A.      Operating Reactors Branch 1

SUBJECT: Responds to NRC 821015 ltr requesting addl info re 780809 application to amend Tech Specs to add valves 863A & 863B to ECCS valve list. Change will facilitate surveillance & maint of valves.

DISTRIBUTION CODE: A001S      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 2  
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	NRR ORB1 BC	01	7	7					
INTERNAL:	ELD/HDS4		1	0	NRR/DL DIR		1	1	
	NRR/DL/ORAB		1	0	NRR/DSI/RAB		1	1	
	<u>REG FILE</u>	04	1	1	RGN2		1	1	
EXTERNAL:	ACRS	09	6	6	LPDR	03	1	1	
	NRC PDR	02	1	1	NSIC	05	1	1	
	NTIS		1	1					


ADDRESS: LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 FACIL: 20-200 LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 20-201 LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 AUTOMATIC LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 FLORIAN POWER & LIGHT CO.  
 RECEIVED: LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 VARIOUS: LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)

SUBJECT: Response to the valve in the presence of a valve  
 operation to open the valve to the valve in the  
 valve list. The valve will facilitate surveillance & control  
 of valves.

DISTRIBUTION: LABORATORY FOR THE STUDY OF THE SYSTEMS (1958)  
 TITLE: The Control of the Valve in the Valve

DATE:

INTERNAL EXTERNAL	RECEIVED DATE	CLASS		RECEIVED DATE	CLASS	RECEIVED DATE	CLASS
		CLASS	CLASS				
INTERNAL	INTERNAL	1	1	1	1	1	1
INTERNAL	INTERNAL	1	1	1	1	1	1
INTERNAL	INTERNAL	1	1	1	1	1	1
INTERNAL	INTERNAL	1	1	1	1	1	1
INTERNAL	INTERNAL	1	1	1	1	1	1

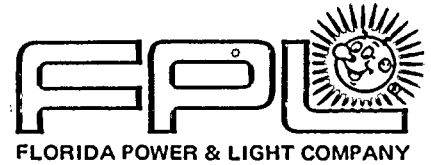

November 10, 1982  
L-82-495

Office of Nuclear Reactor Regulation  
Attention: Mr. S. A. Varga, Chief  
Operating Reactors Branch #1  
Division of Operating Reactors  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 & 4  
Docket Nos. 50-250 and 50-251  
ECCS Single Failure Review

Florida Power & Light has reviewed your letter dated October 13, 1982, which requested confirmation of information which had been provided in telephone conferences with your staff.


The subject of the conferences was our application dated August 9, 1978 to amend the Turkey Point Units 3 & 4 Technical Specifications. The change would add valves 863A and 863B to the list of ECCS valves which have power removed from their motor operators by locking open the circuit breakers at the motor control center. This change will facilitate surveillance and maintenance of these valves.

In response to your request, we confirm the following:

1. The relevant motor control centers (B&C) are two flights of stairs below the control room and inside the auxiliary building. The breakers are in an accessible location.
2. Transit from the control room to the motor control centers would require no more than two minutes. The operators are not likely to encounter any obstacles or any radiation environments.
3. Communication with the control room is possible through regular phones, a paging system, hand held transmitters, and a "PAX" phone system. The noise level is not an impediment to communication.
4. Battery powered emergency lighting is available in and on the way to the MCC's.

8211150134 821110  
PDR ADDCK 05000250  
P PDR

*Acc*

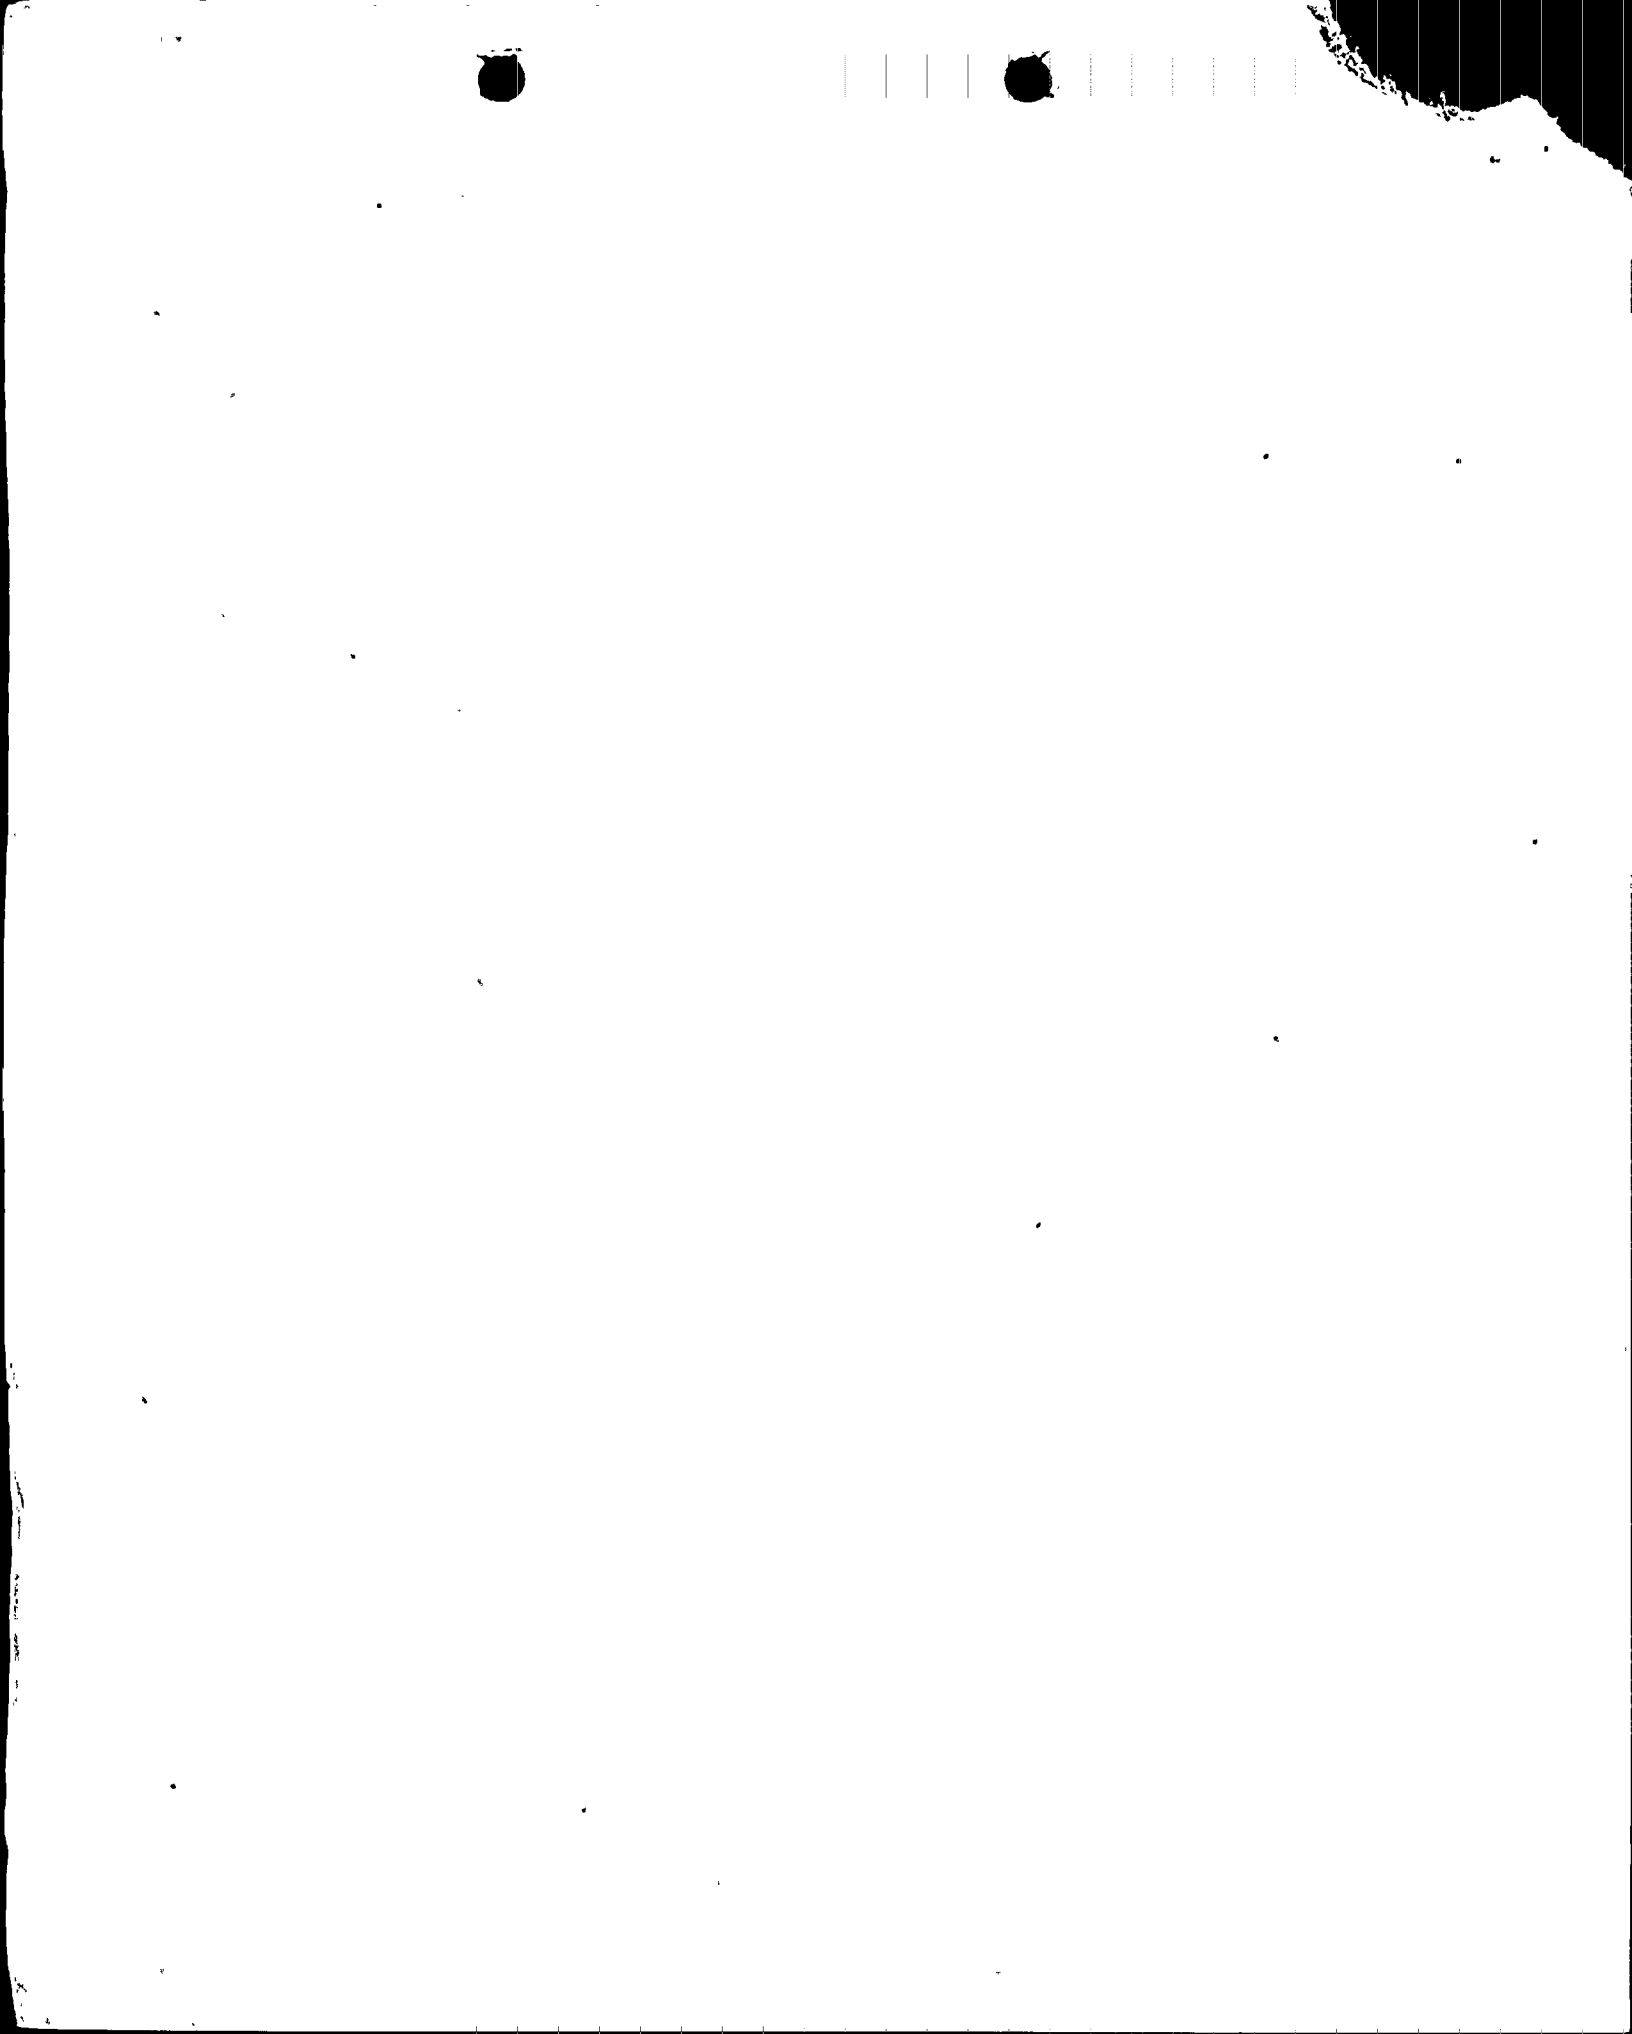

Office of Nuclear Reactor Regulation

Page 2

Should you or your staff have any additional questions on this subject, please contact us.

Very truly yours,

A handwritten signature in cursive script, appearing to read "R. E. Uhrig".

Robert E. Uhrig  
Vice President  
Advanced Systems & Technology

REU/PLP/js

cc: Mr. J. P. O'Reilly, Region II  
Harold F. Reis, Esquire

