

DEC 06 1985

Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November 13, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,


*for Jim B. Hopkins*  
Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

8512180040 851206  
PDR ADOCK 05000250  
P PDR

DISTRIBUTION

DOCKET FILE 50-250/50-251	NRC PDR	B. Grimes	Gray Files
PAD-2 r/f	Local PDR	J. Partlow	
LRUBENSTEIN	HThompson	C. Parrish	
McDONALD	OELD	ACRS (10)	
*SEE PREVIOUS CONCURRENCE	E. Jordan	Tech Branch	

OFC :ORB#1:DL	:PM:PAD-2*	:OELD*	:D:PAD-2	:	:	:
-----	-----	-----	-----	-----	-----	-----
NAME :CPARRISH:hc	:DMcDONALD	:	:LRUBENSTEIN	:	:	:
-----	-----	-----	-----	-----	-----	-----
DATE :11/ /85	:11/ /85	:11/ /85	:11/5/85	:	:	:

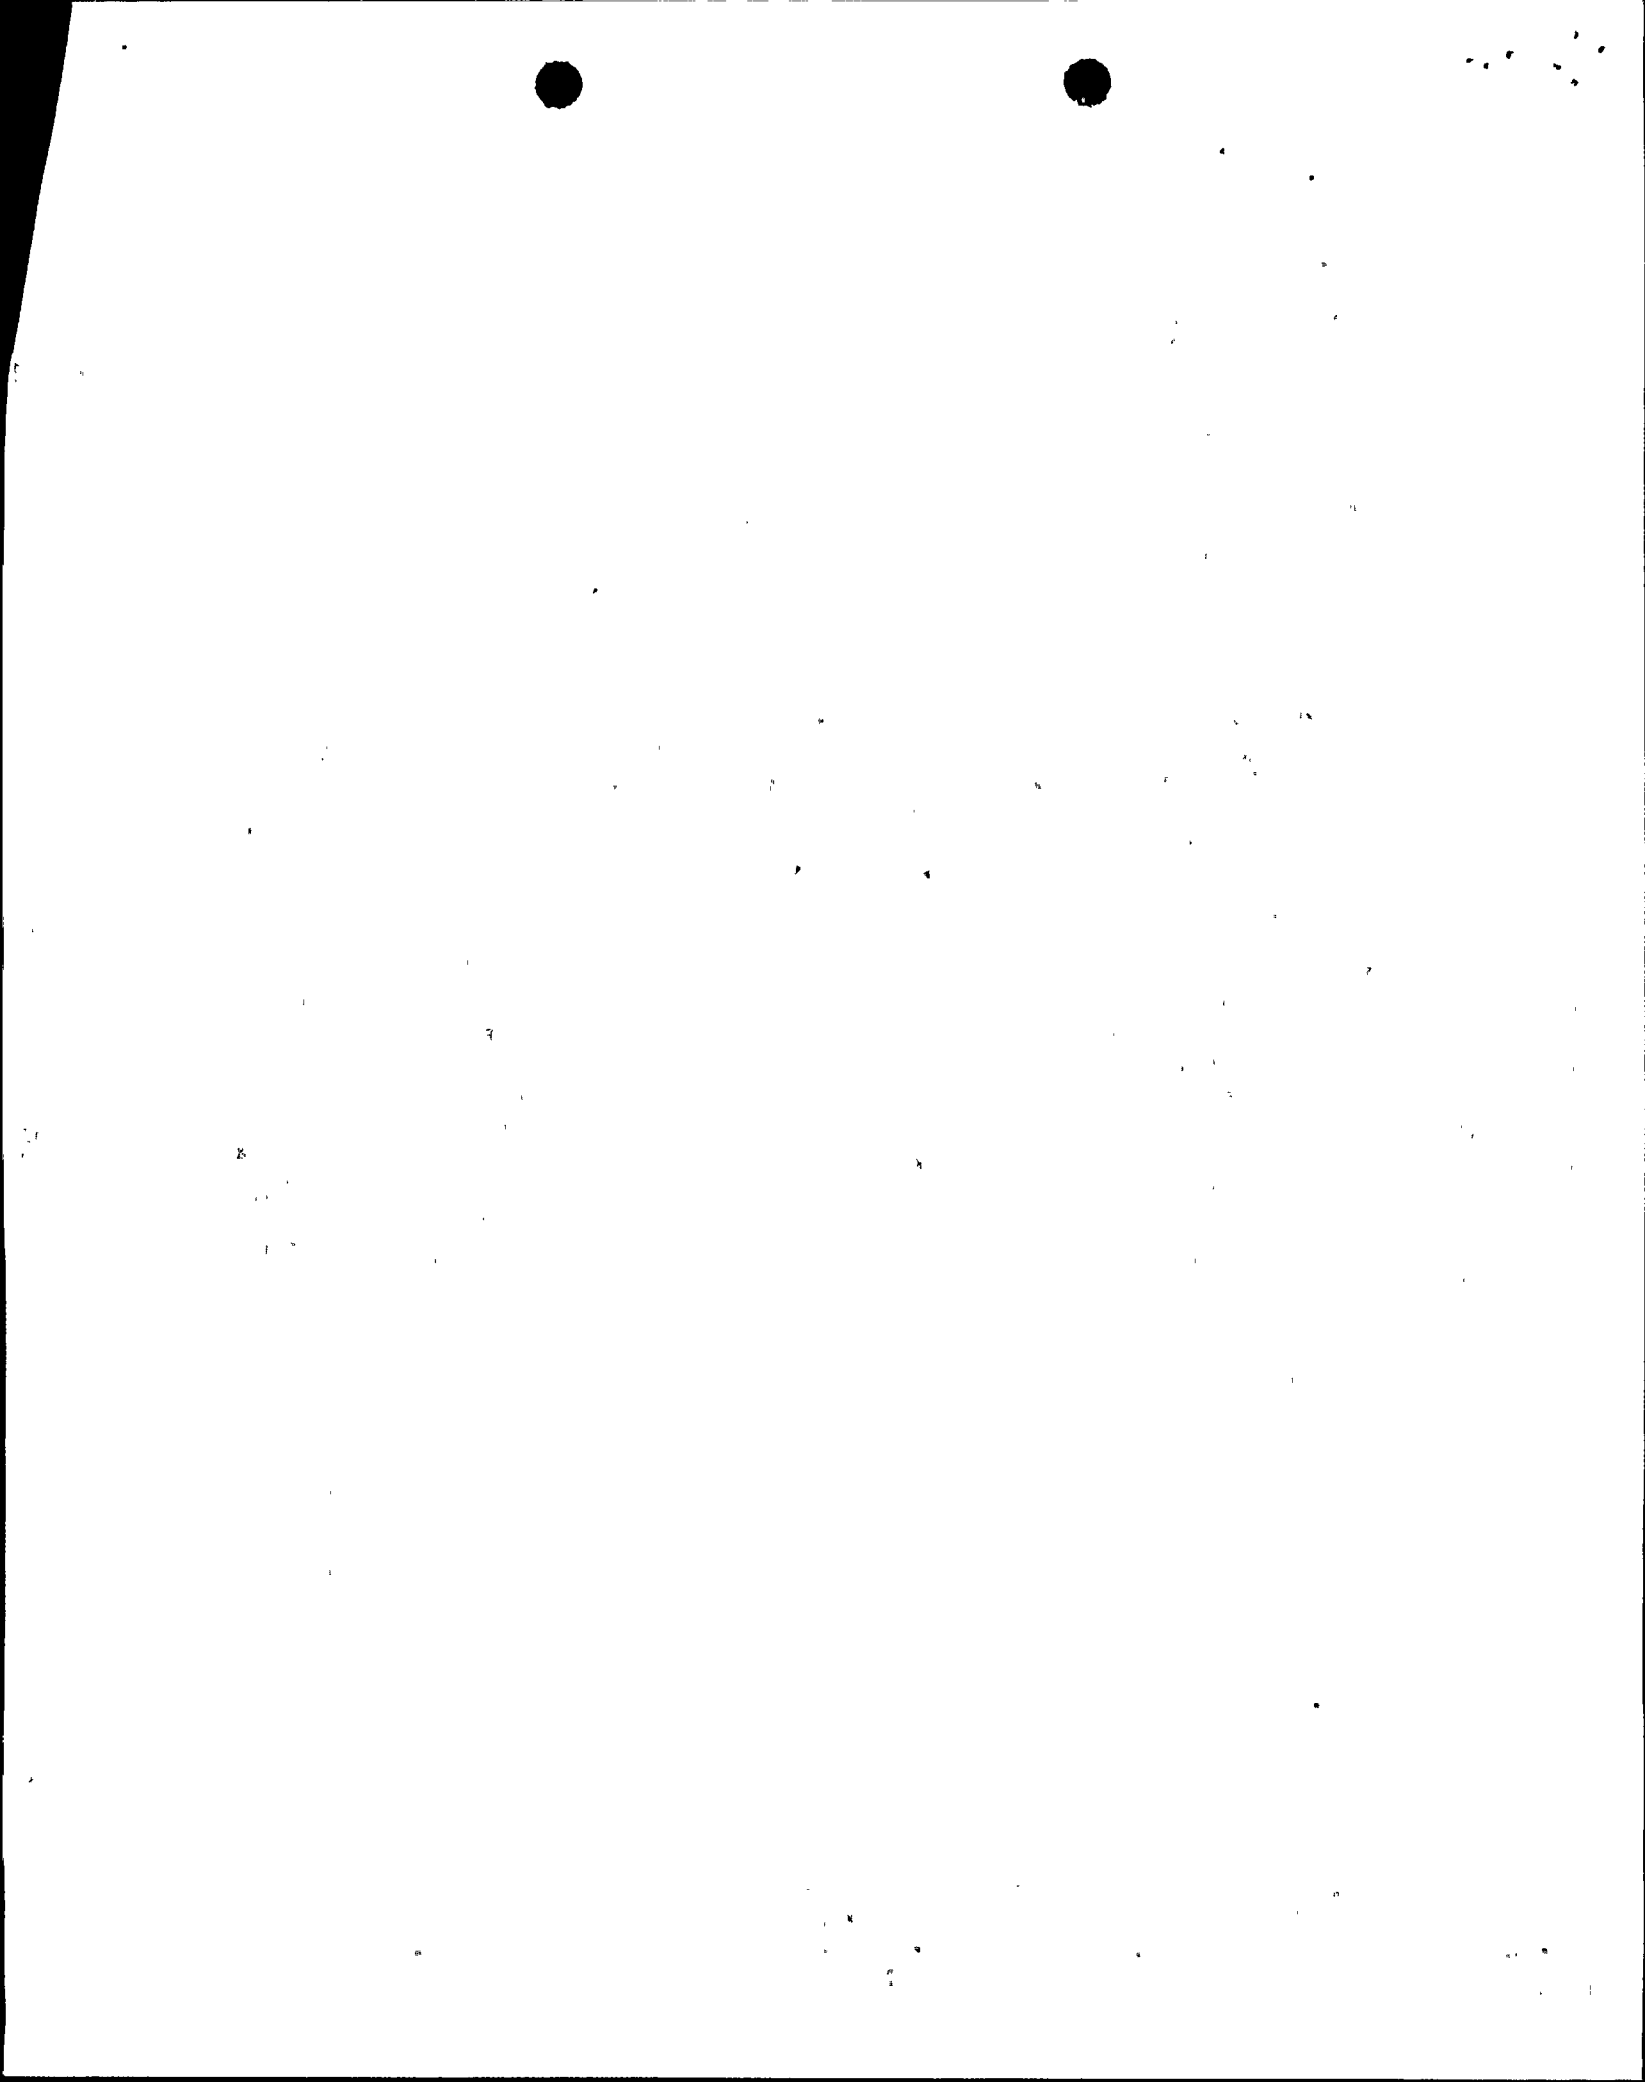

Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November <sup>13</sup>18, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,

Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

**DISTRIBUTION**

DOCKET FILE 50-250/50-251

PAD-2 r/f

LRUBENSTEIN


DMcDONALD

\*SEE PREVIOUS CONCURRENCE

OFC	:ORB#1:DL	:PM:PAD-2	:OELD	:D:PAD-2	:	:	:
NAME	:CPARRISH:hc	:DMcDONALD	:MYOUNG	:LRUBENSTEIN	:	:	:
DATE	:11/ /85	:12/03/85	:12/4/85	:11/ /85	:	:	:

*w/ noted edit*

OFFICIAL RECORD COPY

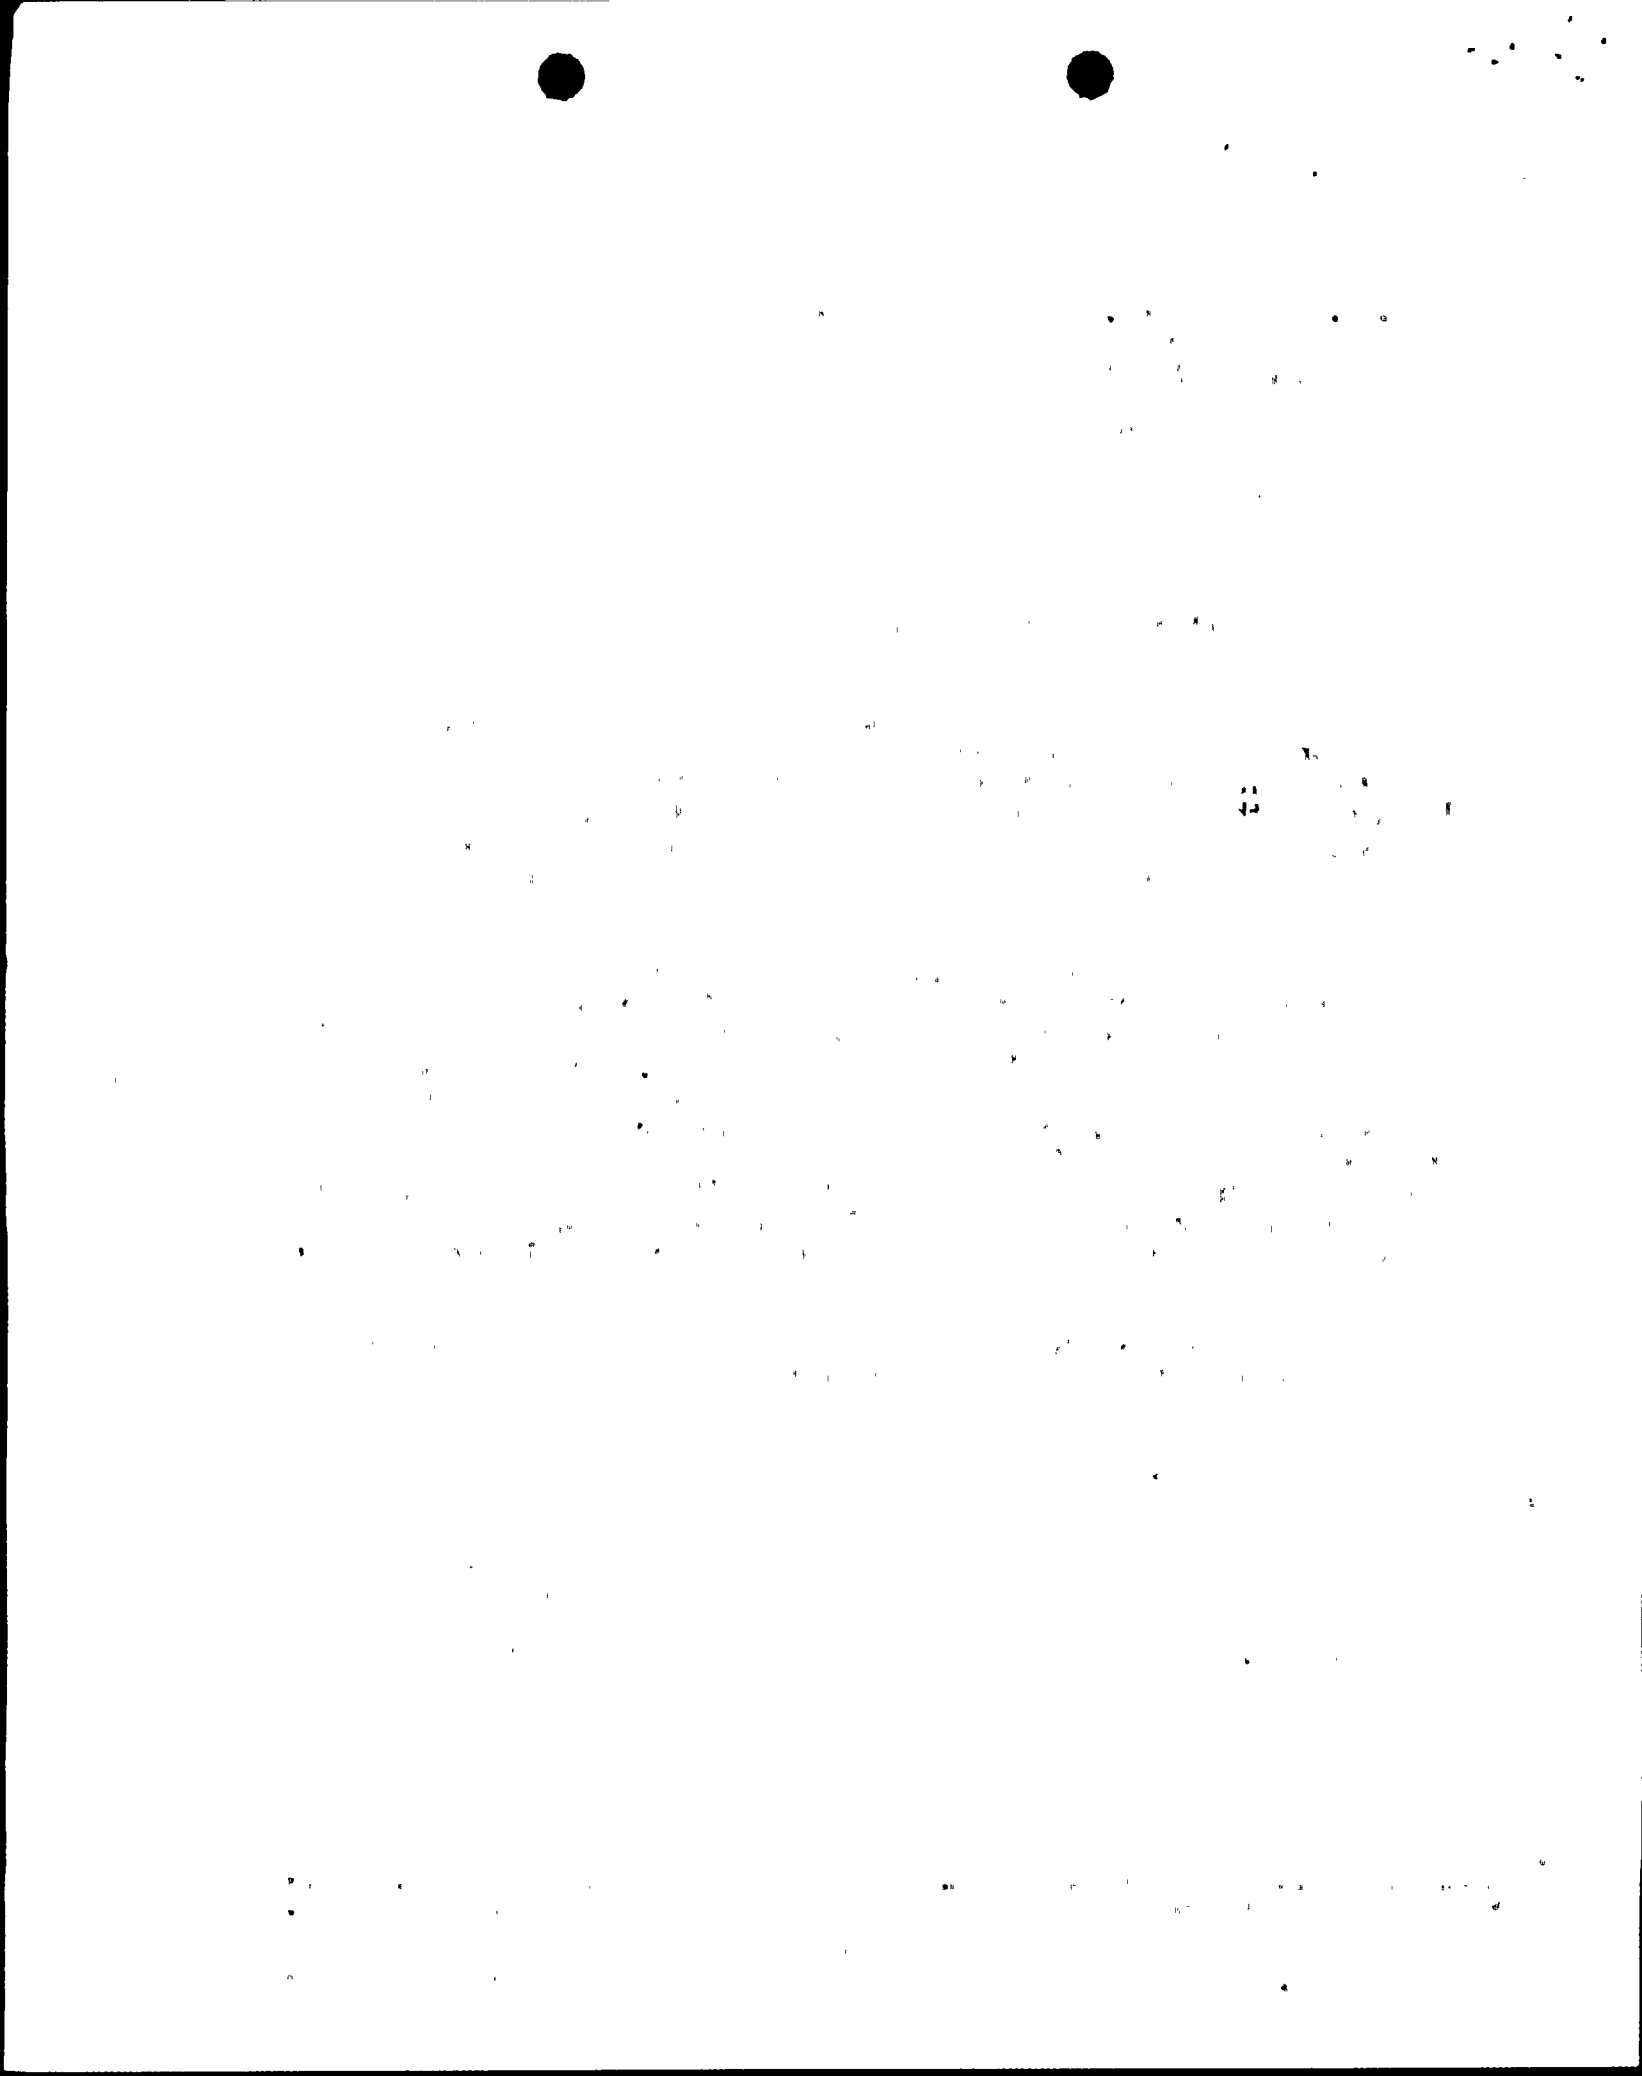

J. W. Williams, Jr.  
Florida Power and Light Company

Turkey Point Plants  
Units 3 and 4

cc: Harold F. Reis, Esquire  
Newman and Holtzinger P.C.  
1615 L Street, N.W.  
Washington, DC 10036

Mr. Jack Shreve  
Office of the Public Counsel  
Room 4, Holland Building  
Tallahassee, Florida 32304

Norman A. Coll, Esquire  
Steel, Hector and Davis  
4000 Southeast Financial  
Center  
Miami, Florida 33131-2398

Mr. Ken N. Harris, Vice President  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Mr. M. R. Stierheim  
County Manager of Metropolitan  
Dade County  
Miami, Florida 33130

Resident Inspector  
Turkey Point Nuclear Generating Station  
U.S. Nuclear Regulatory Commission  
Post Office Box 57-1185  
Miami, Florida 33257-1185

Regional Radiation Representative  
EAP Region IV  
345 Courtland Street, N.W.  
Atlanta, GA 30308

Intergovernmental Coordination  
and Review  
Office of Planning & Budget  
Executive Office of the Governor  
The Capitol Building  
Tallahassee, Florida 32301

Administrator  
Department of Environmental  
Regulation  
Power Plant Siting Section  
State of Florida  
2600 Blair Stone Road  
Tallahassee, Florida 32301

James P. O'Reilly  
Regional Administrator, Region II  
U.S. Nuclear Regulatory Commission  
Suite 2900  
101 Marietta Street  
Atlanta, GA 30303

Martin H. Hodder, Esquire  
1131 N. E. 86th Street  
Miami, Florida 33138

Joette Lorion  
7269 SW 54 Avenue  
Miami, Florida 33143

Mr. Chris J. Baker, Plant Manager  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Attorney General  
Department of Legal Affairs  
The Capitol  
Tallahassee, Florida 32304

Mr. Allan Schubert, Manager  
Public Health Physicist  
Department of Health and  
Rehabilitative Services  
1323 Winewood Blvd.  
Tallahassee, Florida 32301

DEC 06 1985

Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November 13, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,

*for* *Daniel G. McDonald*  
Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

DISTRIBUTION

DOCKET FILE 50-250/50-251	NRC-PDR	B. Grimes	Gray Files
PAD-2 r/f	Local PDR	J. Partlow	
LRUBENSTEIN	HThompson	C. Parrish	
DMcDONALD	OELD	ACRS (10)	
*SEE PREVIOUS CONCURRENCE	E.Jordan	Tech Branch	

JFC	:ORB#1:DL	:PM:PAD-2*	:OELD*	:D:PAD-2	:	:	:
NAME	:CPARRISH:hc	:DMcDONALD	:	:LRUBENSTEIN	:	:	:
DATE	:11/ /85	:11/ /85	:11/ /85	:11/5/85	:	:	:



Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November <sup>13</sup>~~18~~, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,

Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

DISTRIBUTION

DOCKET FILE 50-250/50-251

PAD-2 r/f

LRUBENSTEIN

DMcDONALD

\*SEE PREVIOUS TRANSMISSION

OFC	:ORB#1:DL	:PM:PAD-2	:OELD	:D:PAD-2	:	:
NAME	:CPARRISH:hc	:DMcDONALD	:MYOUNG	:LRUBENSTEIN	:	:
DATE	:11/ /85	:12/03/85	:12/4/85	:11/ /85	:	:



J. W. Williams, Jr.  
Florida Power and Light Company

cc: Harold F. Reis, Esquire  
Newman and Holtzinger P.C.  
1615 L Street, N.W.  
Washington, DC 10036

Mr. Jack Shreve  
Office of the Public Counsel  
Room 4, Holland Building  
Tallahassee, Florida 32304

Norman A. Coll, Esquire  
Steel, Hector and Davis  
4000 Southeast Financial  
Center  
Miami, Florida 33131-2398

Mr. Ken N. Harris, Vice President  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Mr. M. R. Stierheim  
County Manager of Metropolitan  
Dade County  
Miami, Florida 33130

Resident Inspector  
Turkey Point Nuclear Generating Station  
U.S. Nuclear Regulatory Commission  
Post Office Box 57-1185  
Miami, Florida 33257-1185

Regional Radiation Representative  
EAP Region IV  
345 Courtland Street, N.W.  
Atlanta, GA 30308

Intergovernmental Coordination  
and Review  
Office of Planning & Budget  
Executive Office of the Governor  
The Capitol Building  
Tallahassee, Florida 32301

Turkey Point Plants  
Units 3 and 4

Administrator  
Department of Environmental  
Regulation  
Power Plant Siting Section  
State of Florida  
2600 Blair Stone Road  
Tallahassee, Florida 32301

James P. O'Reilly  
Regional Administrator, Region II  
U.S. Nuclear Regulatory Commission  
Suite 2900  
101 Marietta Street  
Atlanta, GA 30303

Martin H. Hodder, Esquire  
1131 N. E. 86th Street  
Miami, Florida 33138

Joette Lorion  
7269 SW 54 Avenue  
Miami, Florida 33143

Mr. Chris J. Baker, Plant Manager  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Attorney General  
Department of Legal Affairs  
The Capitol  
Tallahassee, Florida 32304

Mr. Allan Schubert, Manager  
Public Health Physicist  
Department of Health and  
Rehabilitative Services  
1323 Winewood Blvd.  
Tallahassee, Florida 32301

DEC 06 1985

Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November 13, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,

*for* *Jm B. Hopkins*  
Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

DISTRIBUTION

DOCKET FILE 50-250/50-251	NRC PDR	B. Grimes	Gray Files
PAD-2 r/f	Local PDR	J. Partlow	:
LRUBENSTEIN	HThompson	C. Parrish	:
DMcDONALD	OELD	ACRS (10)	:
*SEE PREVIOUS CONCURRENCE	E. Jordan	Tech Branch	

OFC	:ORB#1:DL	:PM:PAD-2*	:OELD*	:D:PAD-2	:	:
NAME	:CPARRISH:hc	:DMcDONALD	:	:LRUBENSTEIN	:	:
DATE	:11/ /85	:11/ /85	:11/ /85	:11/5/85	:	:

Docket Nos. 50-250  
and 50-251

Mr. J. W. Williams, Jr., Group Vice President  
Nuclear Energy Department  
Florida Power and Light Company  
Post Office Box 14000  
Juno Beach, Florida 33408

Dear Mr. Williams:

Reference: TAC Numbers 56805 and 56808

SUBJECT: SPENT FUEL STORAGE FACILITY

By letter dated November <sup>13</sup>18, 1985, you have withdrawn your February 1, 1985, request for NRC review of a reanalysis of the spent fuel rack modules with only overhanging rows loaded with fuel. You further indicated that fuel placement in the new spent fuel racks will be controlled in accordance with the bases supporting amendments 111 and 105 to the operating licenses for the Turkey Point Plant Units 3 and 4, respectively, as stated in your February 1, 1985, letter.

As indicated in our letter of February 26, 1985, the NRC staff's Safety Evaluation and supporting Technical Evaluation Report conclusions in support of amendments 111 and 105 remain valid due to the administrative controls initiated when you became aware of the potential need for the controls. These controls, which were initiated prior to any fuel loading in the affected racks, preclude the possibility of any separation of the rack modules from the pool liner floor during a seismic event. You have indicated that any changes will be reviewed in accordance with the provisions of 10 CFR 50.59. Should your review indicate that a technical specification change is required or an unreviewed safety question exists, you will request NRC review and approval in accordance with 10 CFR 50.59(c).

Therefore, based on the above, we will take no action on your initial request and close out the above referenced TAC numbers.

Sincerely,

Daniel G. McDonald, Project Manager  
PWR Project Directorate #2, NRR

DISTRIBUTION  
DOCKET FILE 50-250/50-251  
PAD-2 r/f  
LRUBENSTEIN  
DMcDONALD

OFC	:ORB#1:DL	:PM:PAD-2	:OELD	:D:PAD-2	:	:	:
NAME	:CPARRISH:hc	:DMcDONALD	:MYOUNG	:LRUBENSTEIN	:	:	:
DATE	:11/ /85	:12/03/85	:12/4/85	:11/ /85	:	:	:

J. W. Williams, Jr.  
Florida Power and Light Company

cc: Harold F. Reis, Esquire  
Newman and Holtzinger P.C.  
1615 L Street, N.W.  
Washington, DC 10036

Mr. Jack Shreve  
Office of the Public Counsel  
Room 4, Holland Building  
Tallahassee, Florida 32304

Norman A. Coll, Esquire  
Steel, Hector and Davis  
4000 Southeast Financial  
Center  
Miami, Florida 33131-2398

Mr. Ken N. Harris, Vice President  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Mr. M. R. Stierheim  
County Manager of Metropolitan  
Dade County  
Miami, Florida 33130

Resident Inspector  
Turkey Point Nuclear Generating Station  
U.S. Nuclear Regulatory Commission  
Post Office Box 57-1185  
Miami, Florida 33257-1185

Regional Radiation Representative  
EAP Region IV  
345 Courtland Street, N.W.  
Atlanta, GA 30308

Intergovernmental Coordination  
and Review  
Office of Planning & Budget  
Executive Office of the Governor  
The Capitol Building  
Tallahassee, Florida 32301

Turkey Point Plants  
Units 3 and 4

Administrator  
Department of Environmental  
Regulation  
Power Plant Siting Section  
State of Florida  
2600 Blair Stone Road  
Tallahassee, Florida 32301

James P. O'Reilly  
Regional Administrator, Region II  
U.S. Nuclear Regulatory Commission  
Suite 2900  
101 Marietta Street  
Atlanta, GA 30303

Martin H. Hodder, Esquire  
1131 N. E. 86th Street  
Miami, Florida 33138

Joette Lorion  
7269 SW 54 Avenue  
Miami, Florida 33143

Mr. Chris J. Baker, Plant Manager  
Turkey Point Nuclear Plant  
Florida Power and Light Company  
P.O. Box 013100  
Miami, Florida 33101

Attorney General  
Department of Legal Affairs  
The Capitol  
Tallahassee, Florida 32304

Mr. Allan Schubert, Manager  
Public Health Physicist  
Department of Health and  
Rehabilitative Services  
1323 Winewood Blvd.  
Tallahassee, Florida 32301