

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8304280081 DOC. DATE: 83/04/25 NOTARIZED: NO
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 DENTON, H.R. Office of Nuclear Reactor Regulation, Director

DOCKET #
 05000250
05000251


SUBJECT: RO: on 830325, several fire barrier penetrations at new computer, cable spreading & control rooms breached for longer than Tech Spec limit. Caused by implementation of approved design changes.

DISTRIBUTION CODE: A006S COPIES RECEIVED: LTR ___/ENCL ___/ SIZE: ___/___
 TITLE: OR Submittal: Fire Protection

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	NRR ORB1 BC 01	3 3		
INTERNAL:	ELD/HDS4	1 0	IE FILE 06	1 1
	IE/WHITNEY, L	1 1	NRR FIORAVANT07	2 2
	NRR WAMBACH	1 0	NRR/DE/CEB 09	2 2
	NRR/DL DIR	1 1	<u>REG FILE</u> 04	1 1
	RGN2	1 1		
EXTERNAL:	ACRS 11	3 3	LPDR 03	1 1
	NRC PDR 02	1 1	NSIC 05	1 1
	NTIS 1	1 1		

TOTAL NUMBER OF COPIES REQUIRED: LTR 21 ENCL 19

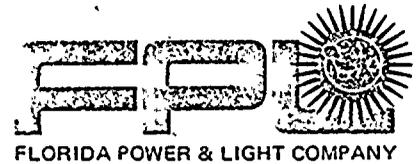

50-250
251

April 25, 1983
L-83-256

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Denton:

SPECIAL REPORT

Turkey Point Units 3 & 4

Date of Occurrence - March 25, 1983

Technical Specification - 3.14.5.b

FIRE BARRIER PENETRATIONS

This special report is being submitted in accordance with Technical Specification 6.9.3 to provide 30 days notification on the subject occurrence.

Due to the implementation of approved design changes (PC/M 82-60 and 82-114), several fire barrier penetrations were breached for longer than seven (7) days. These penetrations are located at the new computer room, cable spreading room and control room.

Our ability to return the breached penetrations to functional status depends on the time frame required to complete the implementation of the design changes. The projected duration is three (3) months from the date of this report.

In compliance with Technical Specifications, an hourly fire watch has been established.

Very truly yours,

Robert E. Uhrig
Vice President
Advanced Systems & Technology

A006

REU/JA/mj/T3

cc: J. P. O'Reilly, Region II
Harold F. Reis, Esquire

8304280081 830425
PDR ADOCK 05000250
S PDR