

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8404050293    DOC. DATE: 84/03/30    NOTARIZED: NO    DOCKET #  
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C    05000250  
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C    05000251  
 AUTH. NAME    AUTHOR AFFILIATION  
 WILLIAM, J.W.    Florida Power & Light Co.  
 RECIP. NAME    RECIPIENT AFFILIATION  
 EISENHUT, D.G.    Division of Licensing

SUBJECT: Forwards revised "Inservice Test Program for Pumps & Valves."


DISTRIBUTION CODE: A047S    *"All kepts"*    COPIES RECEIVED: LTR 1 ENCL 1    SIZE: 2+120  
 TITLE: OR Submittal: Inservice Inspection/Testing

NOTES:

	RECIPIENT				COPIES		RECIPIENT				COPIES	
	ID	CODE	NAME		L	ENCL	ID	CODE	NAME	L	ENCL	
	NRR	ORB1	BC	01	7	7						
INTERNAL:	ELD/HDS4				1	0	<del>NRR/DE/MEB</del>			15	1	
	NRR/DE/MTEB			14	1	1	<u>REG FILE</u>			04	1	
	RGN2				1	1						
EXTERNAL:	ACRS			16	10	10	LPDR			03	1	
	NRC PDR			02	1	1	NSIC			05	1	
	NTIS				1	1						

TOTAL NUMBER OF COPIES REQUIRED: LTR 26 ENCL 25



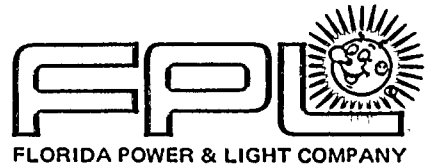

March 30, 1984  
L-84-84

Office of Nuclear Reactor Regulation  
Attention: Mr. Darrell G. Eisenhut, Director  
Division of Licensing  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Dear Mr. Eisenhut:

Re: Turkey Point Units 3 and 4  
Docket Nos. 50-250 and 50-251  
Revisions to Inservice Test  
Program for Pumps and Valves

The attached document is a revision to the current Turkey Point Unit Nos. 3 & 4 Inservice Test Program (IST) for Pumps and Valves. This revision includes Florida Power & Light's responses to questions and comments in the NRC letter dated September 20, 1983 and discussions between NRC staff and FPL representatives.

Revisions to the program include:

1. Combined Program

The two existing Turkey Point Unit Nos. 3 & 4 IST programs were combined into a single IST program covering both units, except for the IST program interval end dates.

2. Plant Changes and Modifications


The revised IST Program includes valves that were added to systems, replaced with a different type of valve body or actuator, or removed from the IST program as the result of plant changes and modifications.

3. Revised Tables

Tables Nos. I and II in the current IST programs were combined into revised Table I. A new Table II was added to address Reactor Coolant System Pressure Isolation Valves. Table I.A. was revised to provide additional information requested by the NRC staff.

8404050293 840330  
PDR ADDCK 05000250  
PDR

A047  
1/1

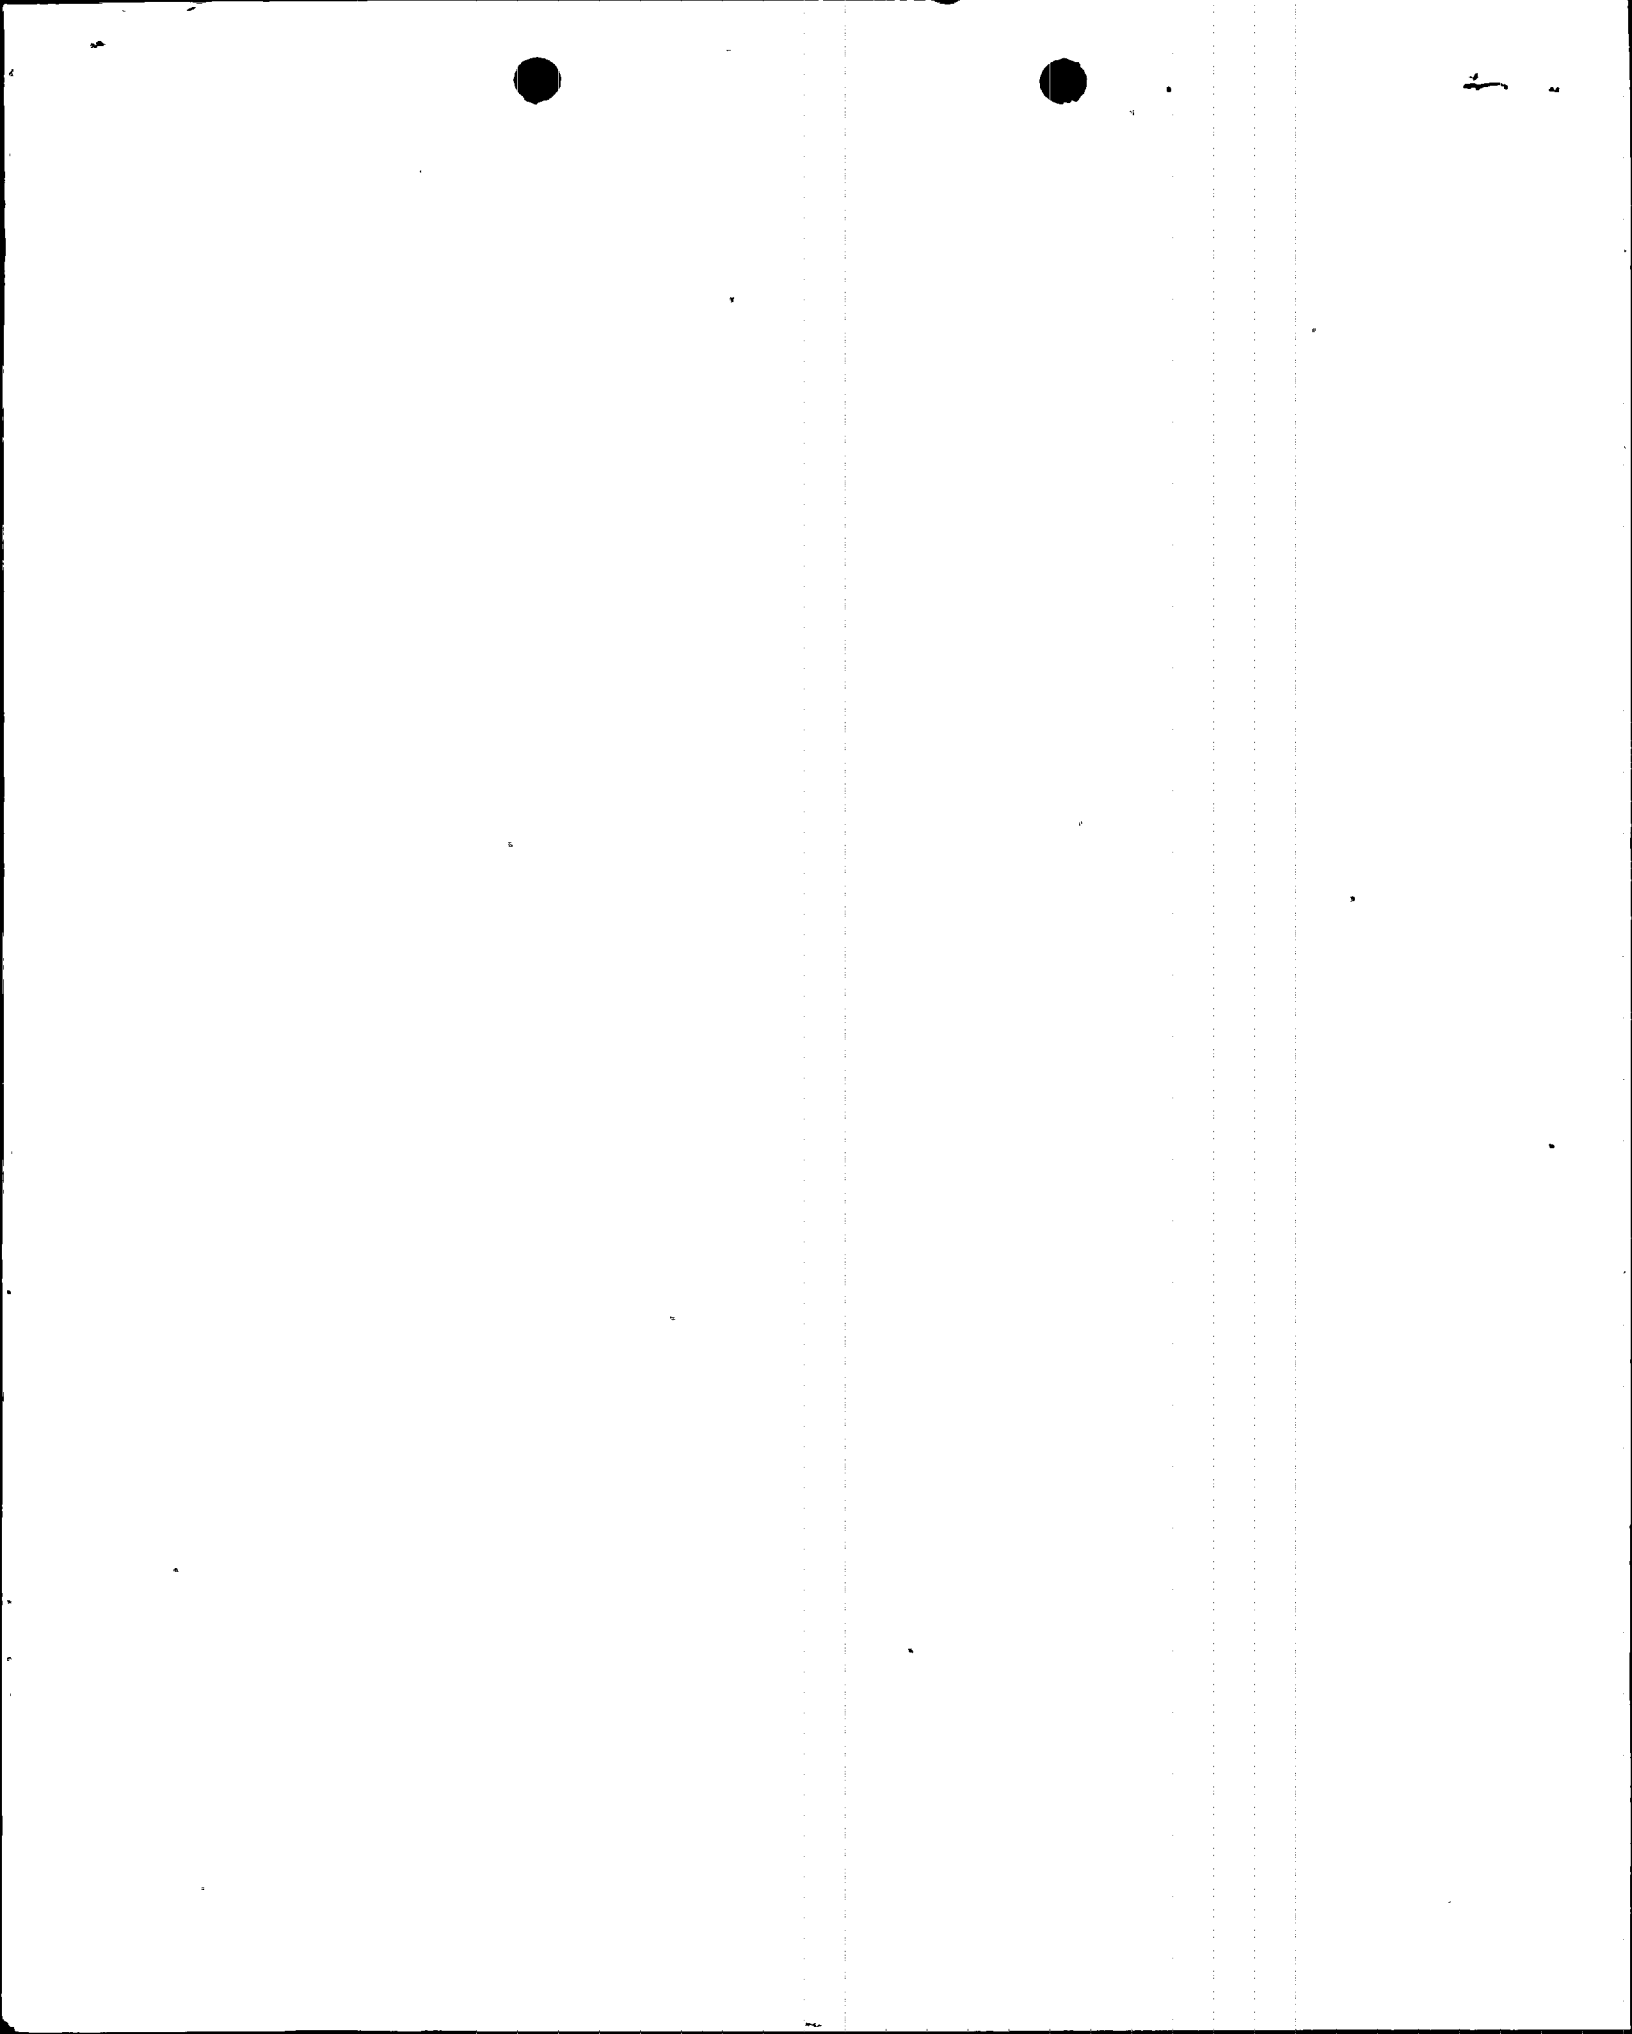


4. Updated ASME Code Addenda

The applicable ASME Code and Addenda was updated to include the 1980 Edition through Winter 1981 addenda for consistency with the revised Inservice Inspection program.

Should you or your staff have any questions on this information, please contact us.

Very truly yours,



J. W. Williams, Jr.  
Vice President  
Nuclear Energy

JWW/PLP/js

Attachment

cc Mr. James P. O'Reilly, Region II  
Harold F. Reis, Esquire  
PNS-LI-84-106

