

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8404240237 DOC. DATE: 84/04/20 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 WILLIAMS, J.W. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 VARGA, S.A. Operating Reactors Branch 1

SUBJECT: Recommends meeting to discuss current status & direction of proposed Bus C design changes. Interim electrical configurations detailed in 840221 confirmation of action ltr in effect until review of final Bus C mods complete.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	NRR ORB1 BC 01	7		
INTERNAL:	ELD/HDS4	1	NRR/DE/MTEB	1
	NRR/DL DIR	1	NRR/DL/ORAB	1
	NRR/DSI/METB	1	NRR/DSI/RAB	1
	REG FILE 04	1	RGN2	1
EXTERNAL:	ACRS 09	6	LPDR 03	1
	NRC PDR 02	1	NSIC 05	1
	NTIS	1		

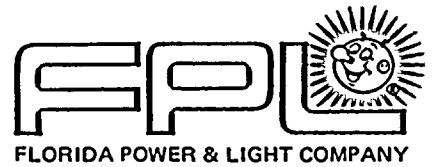

April 20, 1984
L-84-107

Office of Nuclear Reactor Regulation
Attention: Mr. S. A. Varga, Chief
Operating Reactors Branch #1
Division of Operating Reactors
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Varga:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Proposed "C" Bus Design Changes


Our letter L-84-62, dated March 7, 1984, committed to submit the proposed long term design changes and modifications to the Turkey Point Units 3 & 4 "C" Bus by April 20, 1984. We have devoted a significant amount of resources towards the completion of our reviews of the off-site and on-site electrical power supply configurations at Turkey Point. Also during this period, we have identified additional areas of review which are appropriate to assure that our design and evaluation efforts are complete. These increases in scope have caused us to delay our final submittal.

As discussed with your staff, we recommend that our electrical and technical personnel meet with your staff and NRR electrical reviewers in order to discuss the current status and direction of this major effort. We propose that this meeting be held in Miami at our General Office. This location would offer the convenience of a Turkey Point plant tour of the related electrical areas. This tour would provide your reviewers with a firsthand knowledge of the "C" Bus modifications.

The interim electrical configurations, as detailed in our Confirmation of Action letter L-84-36 dated February 21, 1984, will remain in effect until your review of our final "C" Bus modifications is complete.

8404240237 840420
PDR ADCK 05000250
P PDR


*Aool
1/0*

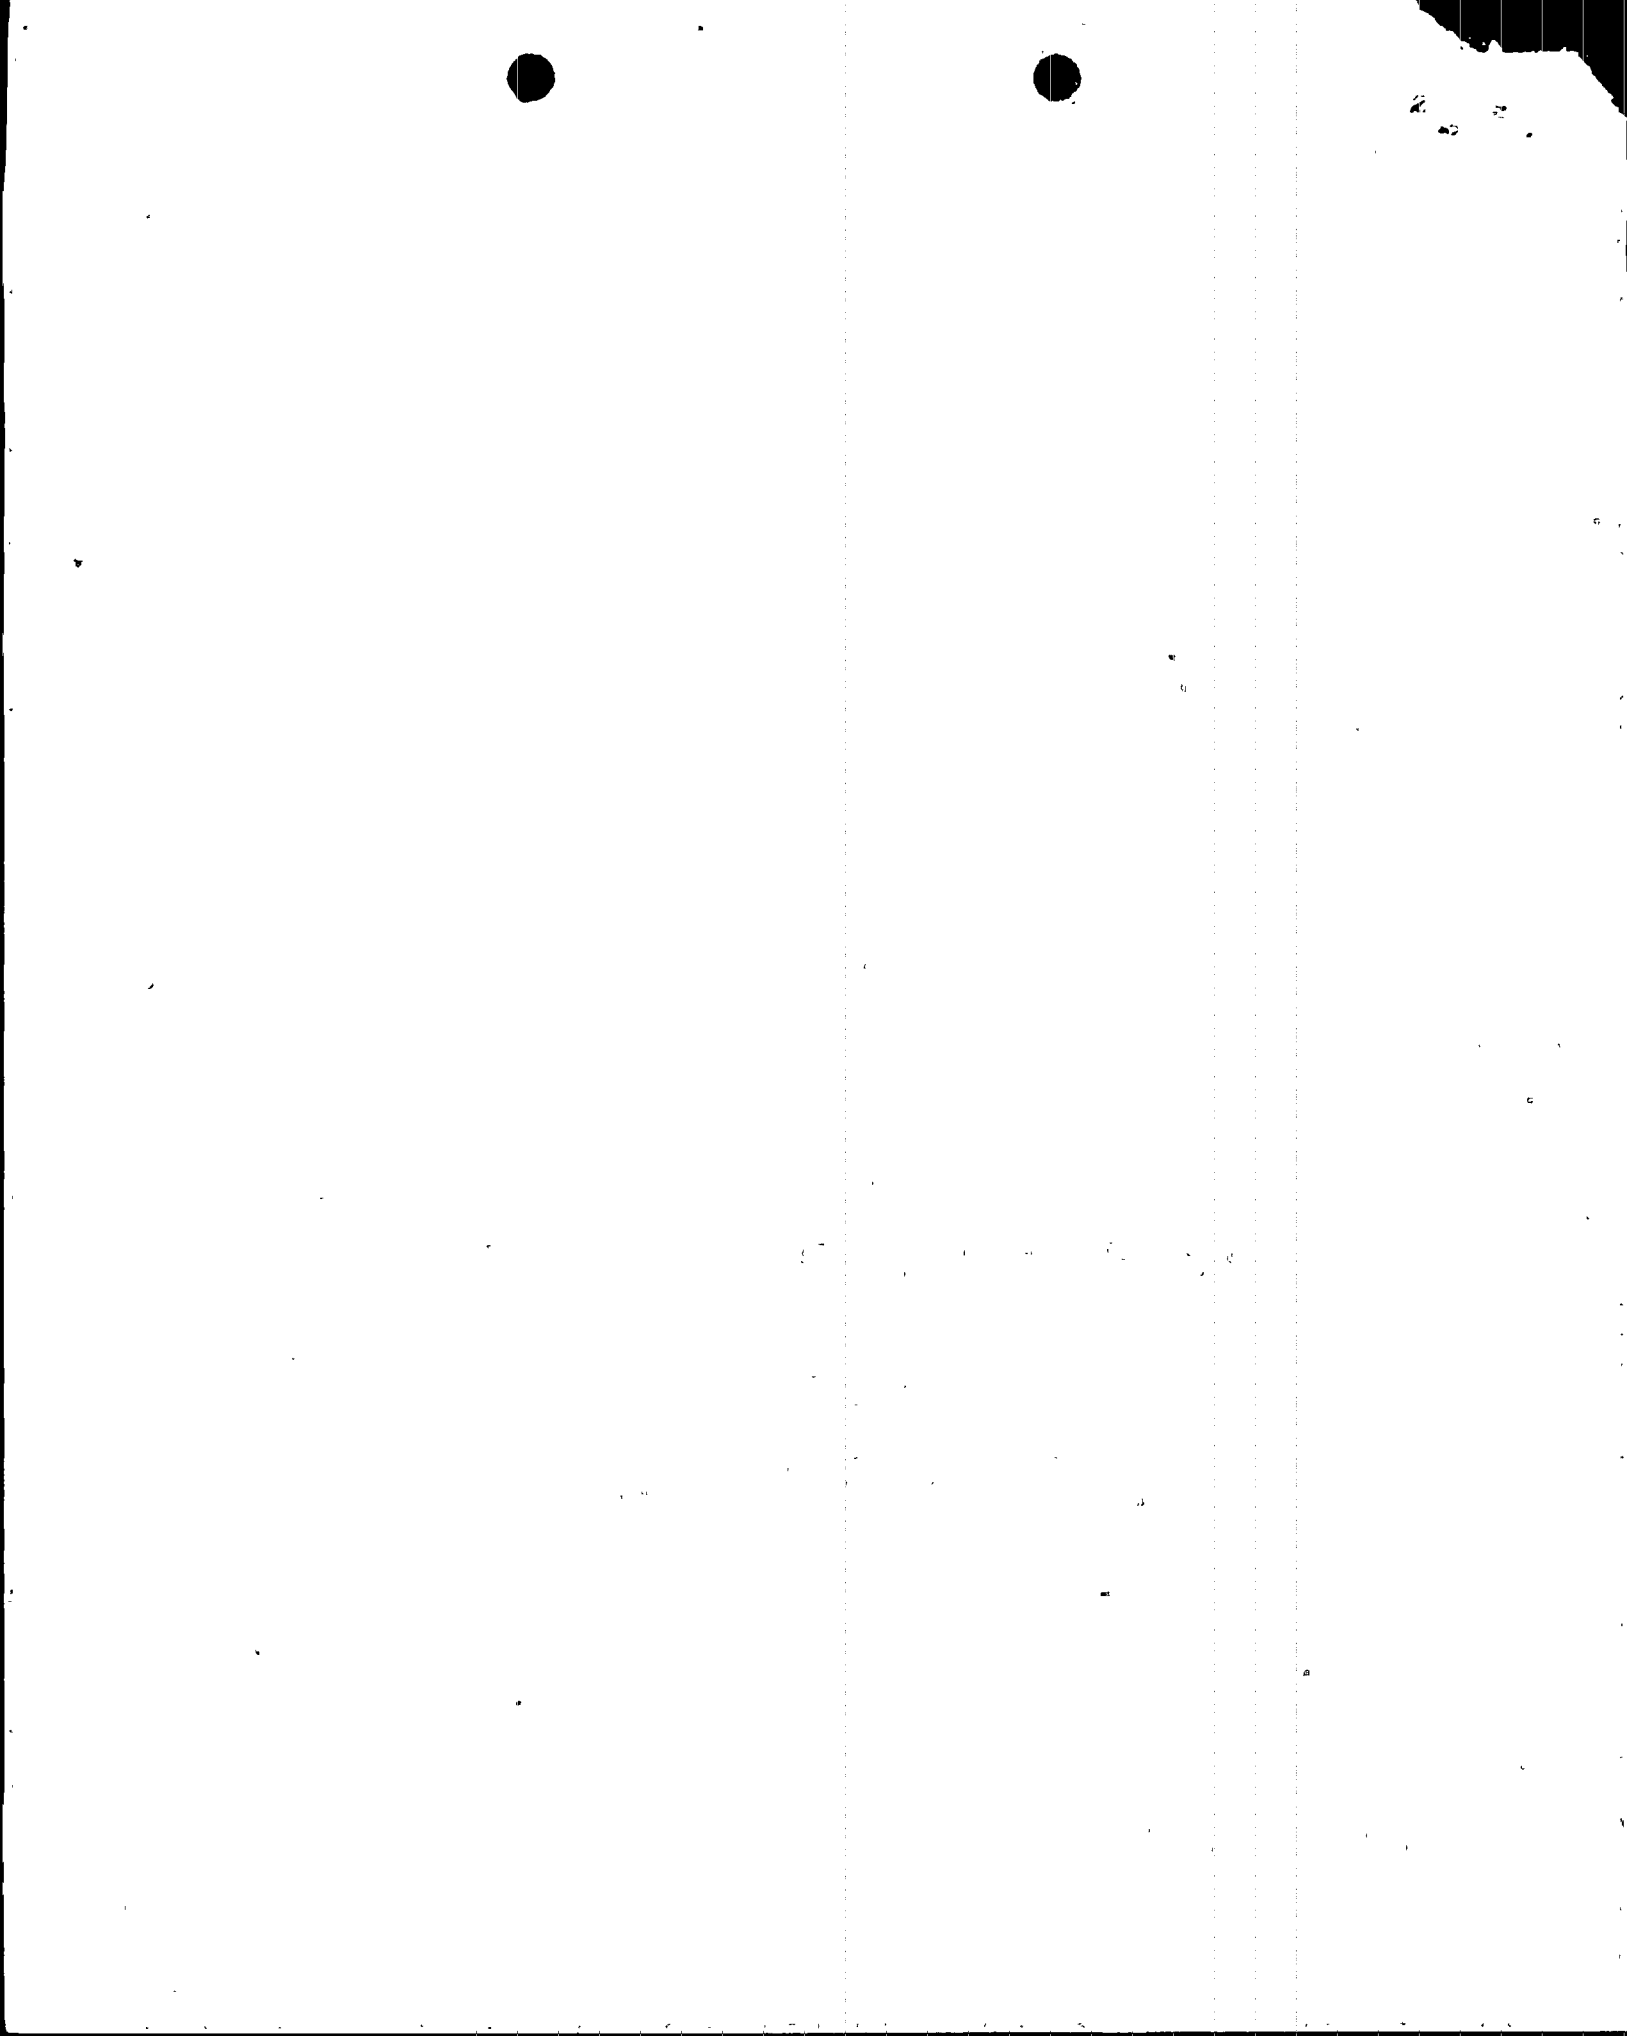

Office of Nuclear Reactor Regulation
Attention: Mr. S. A. Varga, Chief
Page 2

We will continue to coordinate the time and location for a meeting with the
NRR Project Manager for Turkey Point.

Very truly yours,



J. W. Williams, Jr.
Vice President
Nuclear Energy

JWW/SAV/JEM

cc: Harold F. Reis, Esquire
J. P. O'Reilly, Regional Administrator, Region II
PNS-LI-84-136

