

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8703160201      DOC. DATE: 87/03/06      NOTARIZED: NO      DOCKET #  
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C      05000250  
       50-251 Turkey Point Plant, Unit 4, Florida Power and Light C      05000251  
 AUTH. NAME                      AUTHOR AFFILIATION  
 WOODY, C. O.                      Florida Power & Light Co.  
 RECIPI. NAME                      RECIPIENT AFFILIATION  
                                     Document Control Branch (Document Control Desk)


SUBJECT: Special rept: nonfunctional fire barrier penetration not returned to functional status within 7 days. Caused by incomplete App R alternate shutdown work. Compensatory measurements continuing. List of breached barriers encl.

DISTRIBUTION CODE: A006D      COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 5  
 TITLE: OR/Licensing Submittal: Fire Protection

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PWR-A PD2 LA	1 0	PWR-A PD2 PD 04.	5 5
	McDONALD, D	1 1	PWR-A PSB	1 1
INTERNAL:	ADM/LFMB	1 0	IE WHITNEY, L	1 1
	NRR STANG, J 07	2 2	NRR WERMEIL, JO6.	1 0
	OGC/HDS2	1 0	<u>REG FILE</u> 01	1 1
EXTERNAL:	LPDR 03	1 1	NRC PDR 02;	1 1
	NSIC 05	1 1		

TOTAL NUMBER OF COPIES REQUIRED: LTR 18 ENCL 14

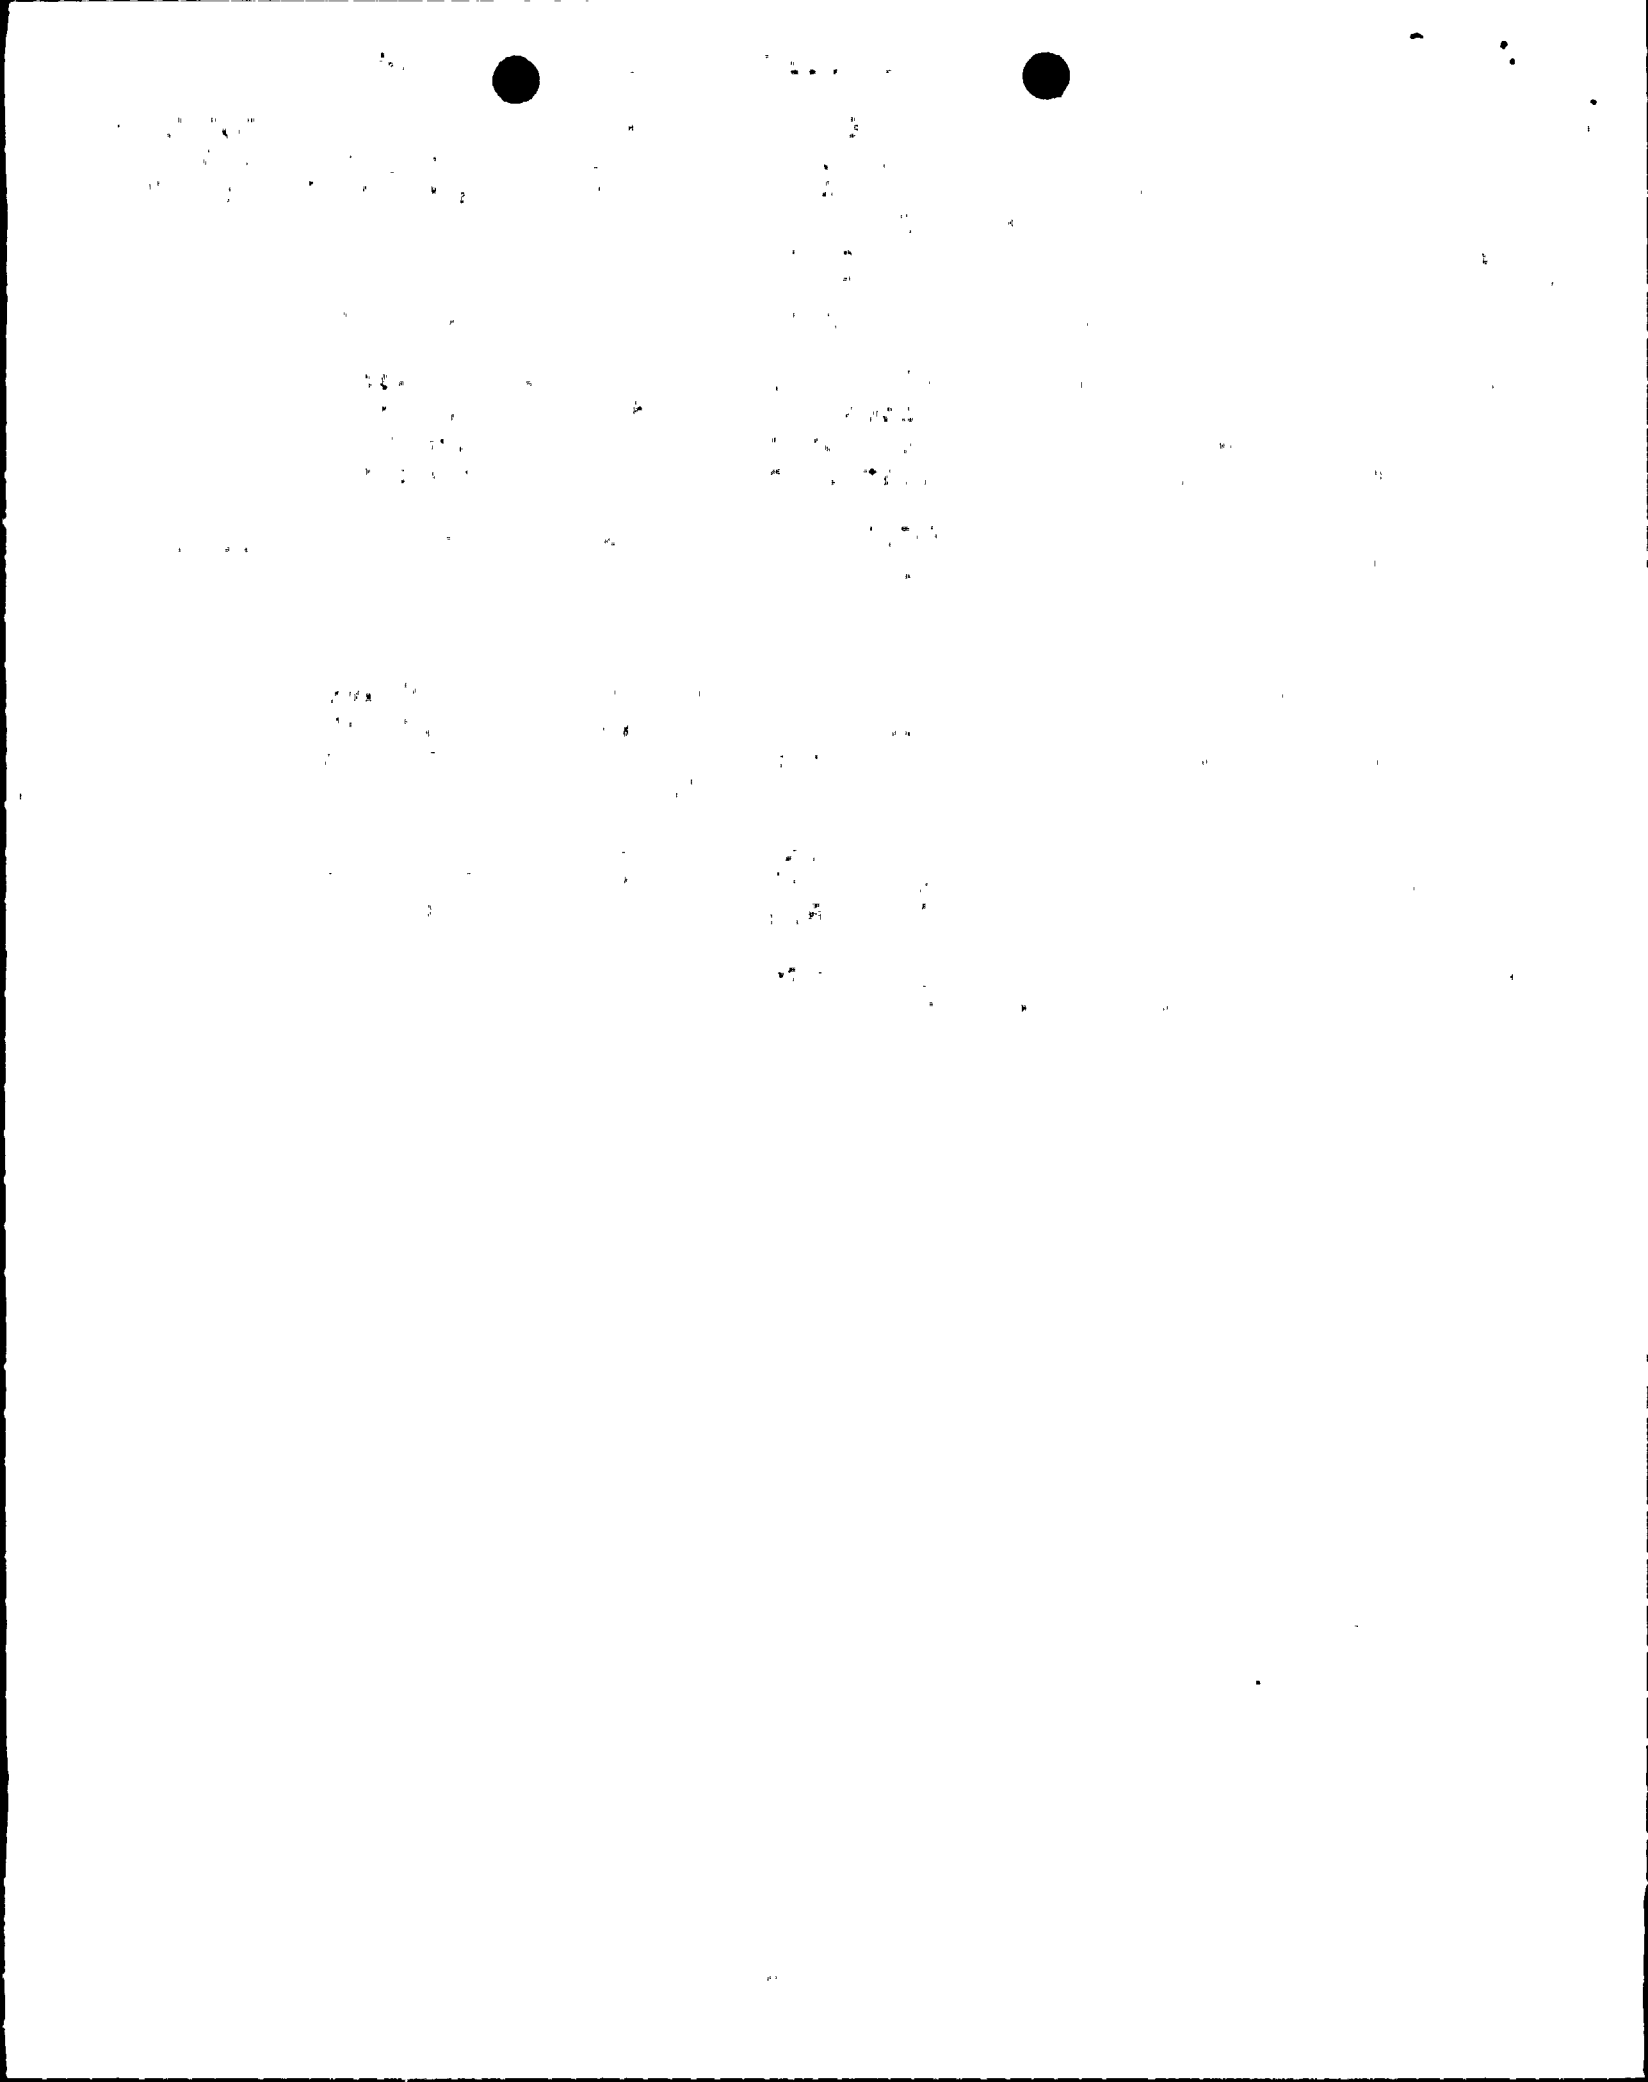



MARCH 06 1987  
L-87-110

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555


Gentlemen:

Re: Turkey Point Units 3 and 4  
Docket Nos. 50-250 and 50-251  
Special Report - Breached Fire Barriers

In accordance with Technical Specification 6.9.3 the attached Special Report is provided for your information.

Should there be any questions on this information, please contact us.

Very truly yours,

  
C. O. Woody  
Group Vice President  
Nuclear Energy

COW/RG/gp

Attachment

cc: Dr. J. Nelson Grace, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, Turkey Point Plant

8703160201 870306  
PDR ADOCK 05000250  
S PDR



A006  
||



Small, illegible marks or characters in the top right corner.

Main body of the document containing several lines of extremely faint and illegible text. The text is scattered across the page and appears to be a list or series of entries, but the characters are too light to be read.

SPECIAL REPORT

MARCH 6, 1987

FIRE BARRIERS BREACHED FOR LONGER THAN SEVEN DAYS

Purpose:

Technical Specification 3.14.5.b requires the submission of a report to the NRC if a non-functional fire barrier penetration is not returned to functional status within 7 days. In accordance with the above requirement, this special report on the breached barriers is being generated in order to notify the NRC. This report will be updated on a 30 day basis until the Appendix R associated work is complete.

Event:

The plant has been and is continuing to implement numerous modifications, mainly in accordance with Appendix R Alternate Shutdown requirements. The schedular exemptions for the Safe Shutdown modifications, which outlined the alternative compensatory measures to be taken when a barrier is breached, expired on September 30, 1986, and on October 1, 1986. Upon the expiration of the exemptions, the compensatory measures as described in Attachment 1 of our letter L-85-386 (dated October 11, 1985), are continuing to be in place until the Safe Shutdown modifications are complete. Breaches incurred during Alternate Shutdown modifications are governed by the Technical Specifications or the exemptions, as applicable.

Cause and Corrective Actions:

The major cause of the breached barriers is the Appendix R Alternate Shutdown work which remains to be completed. Due to the large volume of work being performed, the plant is reporting the breaches in this one report, rather than on a case-by-case basis. The breaches reported this month are breaches which are either open or closed, but were open for longer than 7 days (see attached list of breached barriers).

The plant continues to implement the compensatory measures as applicable.

REPORT OF PROGRESS

MARCH 6, 1987

FIELD ACTIVITIES REPORT FOR FISCAL YEAR 1986-87

Summary:

The field activities for the fiscal year 1986-87 were carried out in accordance with the plan of work approved by the Board of Directors. The major activities were the collection of data on the distribution and abundance of the various species of birds and mammals in the study area. The data were analyzed and the results are presented in the following sections.

Methods:

The data were collected using the following methods: 1) Visual observations of birds and mammals in the study area. 2) Trapping of mammals using live traps. 3) Banding of birds and mammals. 4) Collection of eggs and nestlings. 5) Collection of fecal samples. 6) Collection of blood samples. 7) Collection of skin and bone samples. 8) Collection of feathers. 9) Collection of hair samples. 10) Collection of other samples as needed.

Results and Discussion:

The results of the field activities are presented in the following sections: 1) Distribution and abundance of birds. 2) Distribution and abundance of mammals. 3) Breeding success of birds. 4) Mortality of mammals. 5) Population trends. 6) Other results.

Conclusions and Recommendations:

TURKEY POINT PLANT - NUCLEAR  
IMPAIRMENT CONTROL SYSTEM - 1986  
FILE: ICS86.WK1  
REV DATE: 03/03/87

---

IMPAIRMENT NUMBER	REQUEST NO.	DESCRIPTION	 	CLOSING       OPEN DATE    DATE
06-0280		RACEWAY PROTECTION NO:8-3J1712-4"		12/18/86    02/04/87

NOTE: BREACHES TO FIRE BARRIERS CLOSED IN FEBRUARY, BUT WERE OPENED FOR MORE THAN 7 DAYS.

TURKEY POINT PLANT - NUCLEAR  
IMPAIRMENT CONTROL SYSTEM - 1987  
FILE: ICS87.WK1  
REV DATE: 03/03/87

IMPAIRMENT NUMBER	REQUEST NO.	DESCRIPTION	OPEN DATE	CLOSING DATE
87-0028		STRUCTURAL STEEL FIREPROOFING MEMBER-W14X30	01/08/87	02/05/87
87-0065		FIRE BARRIERS NO:070N-E023	01/19/87	02/06/87
87-0066		FIRE BARRIERS NO:070N-E035	01/19/87	02/06/87
87-0067		FIRE BARRIERS NO:098N-E043	01/19/87	02/06/87
87-0069		FIRE BARRIERS NO:070E-E009	01/19/87	02/10/87
87-0071		FIRE BARRIERS NO:098E-E034	01/19/87	02/10/87
87-0073		FIRE BARRIERS NO:041E-E003	01/19/87	02/13/87

NOTE: BREACHES TO FIRE BARRIERS CLOSED IN FEBRUARY, BUT WERE OPENED FOR MORE THAN 7 DAYS.



TURKEY POINT PLANT - NUCLEAR  
IMPAIRMENT CONTROL SYSTEM - 1987  
FILE: ICS87.WK1  
REV DATE: 03/03/87

IMPAIRMENT NUMBER	REQUEST NO.	DESCRIPTION	OPEN DATE	CLOSING DATE
1038		PENETRATION DISCREPANCY PER NCR 87-0022	02/05/87	
1039		PENETRATION DISCREPANCY PER NCR 87-0022	02/05/87	
1041		PENETRATION DISCREPANCY PER NCR 87-0022	02/05/87	
1051		FIRE DOORS NO:101.1	02/10/87	
103A		FIRE DAMPER 72A	01/28/87	