

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8902170313 DOC. DATE: 89/02/06 NOTARIZED: NO DOCKET #
 FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
 50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
 AUTH. NAME AUTHOR AFFILIATION
 JULIAN, C.A. Region 2, Ofc of the Director
 RECIP. NAME RECIPIENT AFFILIATION
 CONWAY, W.F. Florida Power & Light Co.

SUBJECT: Forwards Exam Rept 50-250/OL-88-02 of exam administered on 881017-28.

DISTRIBUTION CODE: IE42D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+250
 TITLE: Operator Licensing Examination Reports

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD2-2 PD	1 0	EDISON, G	1 1
INTERNAL:	AEOD/DSP/TPAB	1 1	NRR SHANKMAN, S	1 1
	NRR/DLPQ/HFB 10	1 0	NRR/DLPQ/OLB 10	1 1
	NUDOCS-ABSTRACT	1 1	<u>REG FILE</u> 02	1 1
	RGN2 FILE 01	1 1		
EXTERNAL:	LPDR	1 1	NRC PDR	1 1
	NSIC	1 1		


Limited Dist.

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 12 ENCL 9

R
I
D
S
/
A
D
D
S

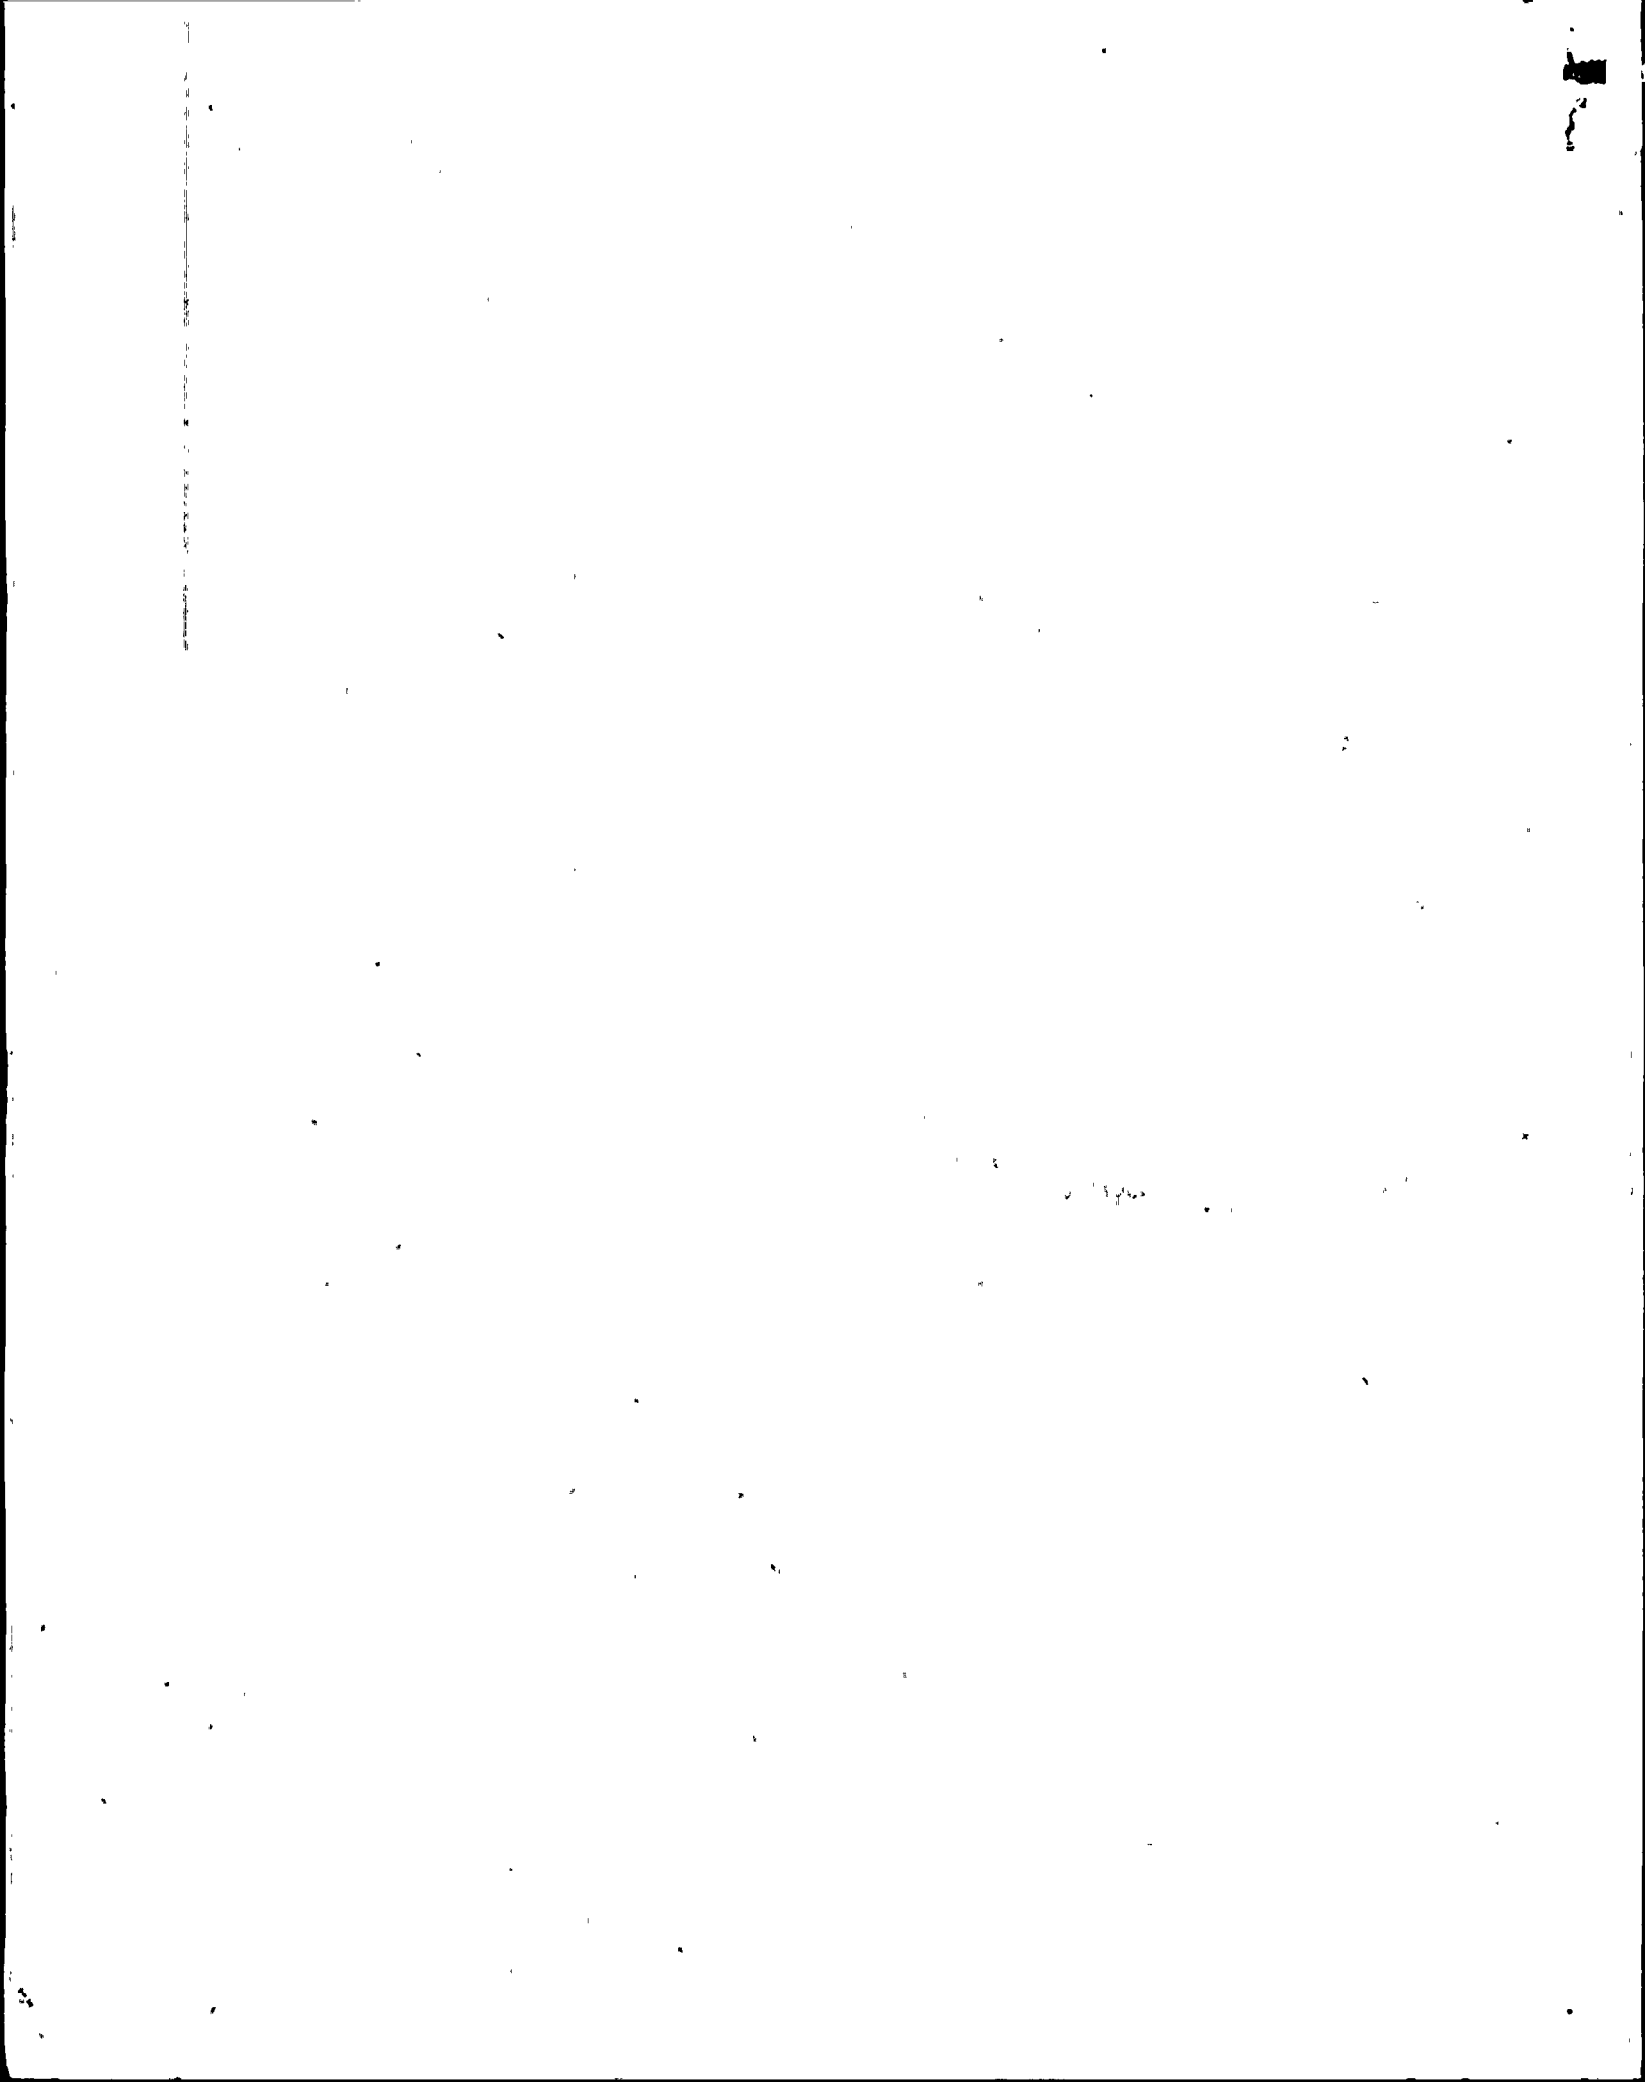

February 6, 1989

Florida Power and Light Company
ATTN: Mr. W. F. Conway
Senior Vice President
Nuclear Energy Department
P. O. Box 14000
Juno Beach, FL 33408-0420

Gentlemen:

SUBJECT: TURKEY POINT EXAMINATION REPORT - 50-250/OL-88-02

The NRC administered examinations on October 17-28, 1988 to employees of your company who had applied for licenses to operate the Turkey Point Nuclear Plant. At the conclusion of the written examination, a copy of the exam was left with your staff; at the conclusion of the site visit, preliminary findings on the operating tests were discussed with those members of your staff identified in the Examination Report, Enclosure 1.

Copies of the written examination questions and answer key are included in this report as Enclosure 2. Enclosure 3 summarizes simulator performance deficiencies observed during conduct of the simulator portion of the operating examinations.

In accordance with 10 CFR 2.790(a), a copy of this letter and its enclosures will be placed in NRC's Public Document Room.

Should you have any questions concerning this letter, please contact us.

Sincerely,

(Original signed by C. A. Julian)

Caudle A. Julian, Chief
Operations Branch
Division of Reactor Safety

Enclosures:

1. Exam Report 50-250/OL-88-02
2. RO/SRO Exam Questions & Answer Key
3. Simulation Facility Fidelity Report

cc w/encls 1 & 3:

W. Waylett, Corporate Training Dir.
J. Cross, Plant Manager

cc w/encls 1, 2 and 3:

T. Finn, Site Training Director

bcc: (See page 2)

8902170313 890206
FOR ADOCK 05000250
PLC

Florida Power & Light Co.

2

February 6, 1989

bcc w/encl 1:
G. Edison, Project Manager, NRR
R. Crlenjak, Section Chief, DRP
C. Casto, OL Examiner, DRS
State of Florida

bcc w/encls 1, 2 and 3:
Senior Resident Inspector
Operator Licensing Branch, DLPQ:NRR
Document Control Desk
Sonalysts, Contractor

RII

OBWest
01/ /89

RII

CCasto
01/ /89

RII

JFMunro
01/ /89

RII

RCrlenjak
01/ /89

RII

CAJulian
01/ /89