

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9106070245 DOC. DATE: 91/06/03 NOTARIZED: YES DOCKET #
FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251

AUTH. NAME AUTHOR AFFILIATION
BOHLKE, W.H. Florida Power & Light Co.
RECIP. NAME RECIPIENT AFFILIATION
Document Control Branch (Document Control Desk)

SUBJECT: Forwards current, revised Tech Specs to be included w/901219 application for amends to Licenses DPR-31 & DPR-41 re reactor protection sys setpoints.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR / ENCL / SIZE: 2+26
TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTTR	ENCL	ID	CODE/NAME	LTTR	ENCL
	PD2-2	LA	1	1	PD2-2	PD	1	1
	AULUCK,	R	2	2				
INTERNAL:	NRR/DET/ECMB	7D	1	1	NRR/DET/ESGB		1	1
	NRR/DOEA/OTSB11		1	1	NRR/DST 8E2		1	1
	NRR/DST/SELB	7E	1	1	NRR/DST/SICB8H7		1	1
	NRR/DST/SRXB	8E	1	1	NUDOCS-ABSTRACT		1	1
	OG/LFMB		1	0	OGC/HDS3		1	0
	REG FILE	01	1	1	RES/DSIR/EIB		1	1
EXTERNAL:	NRC	PDR	1	1	NSIC		1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 18 ENCL 16

AA 2/wt

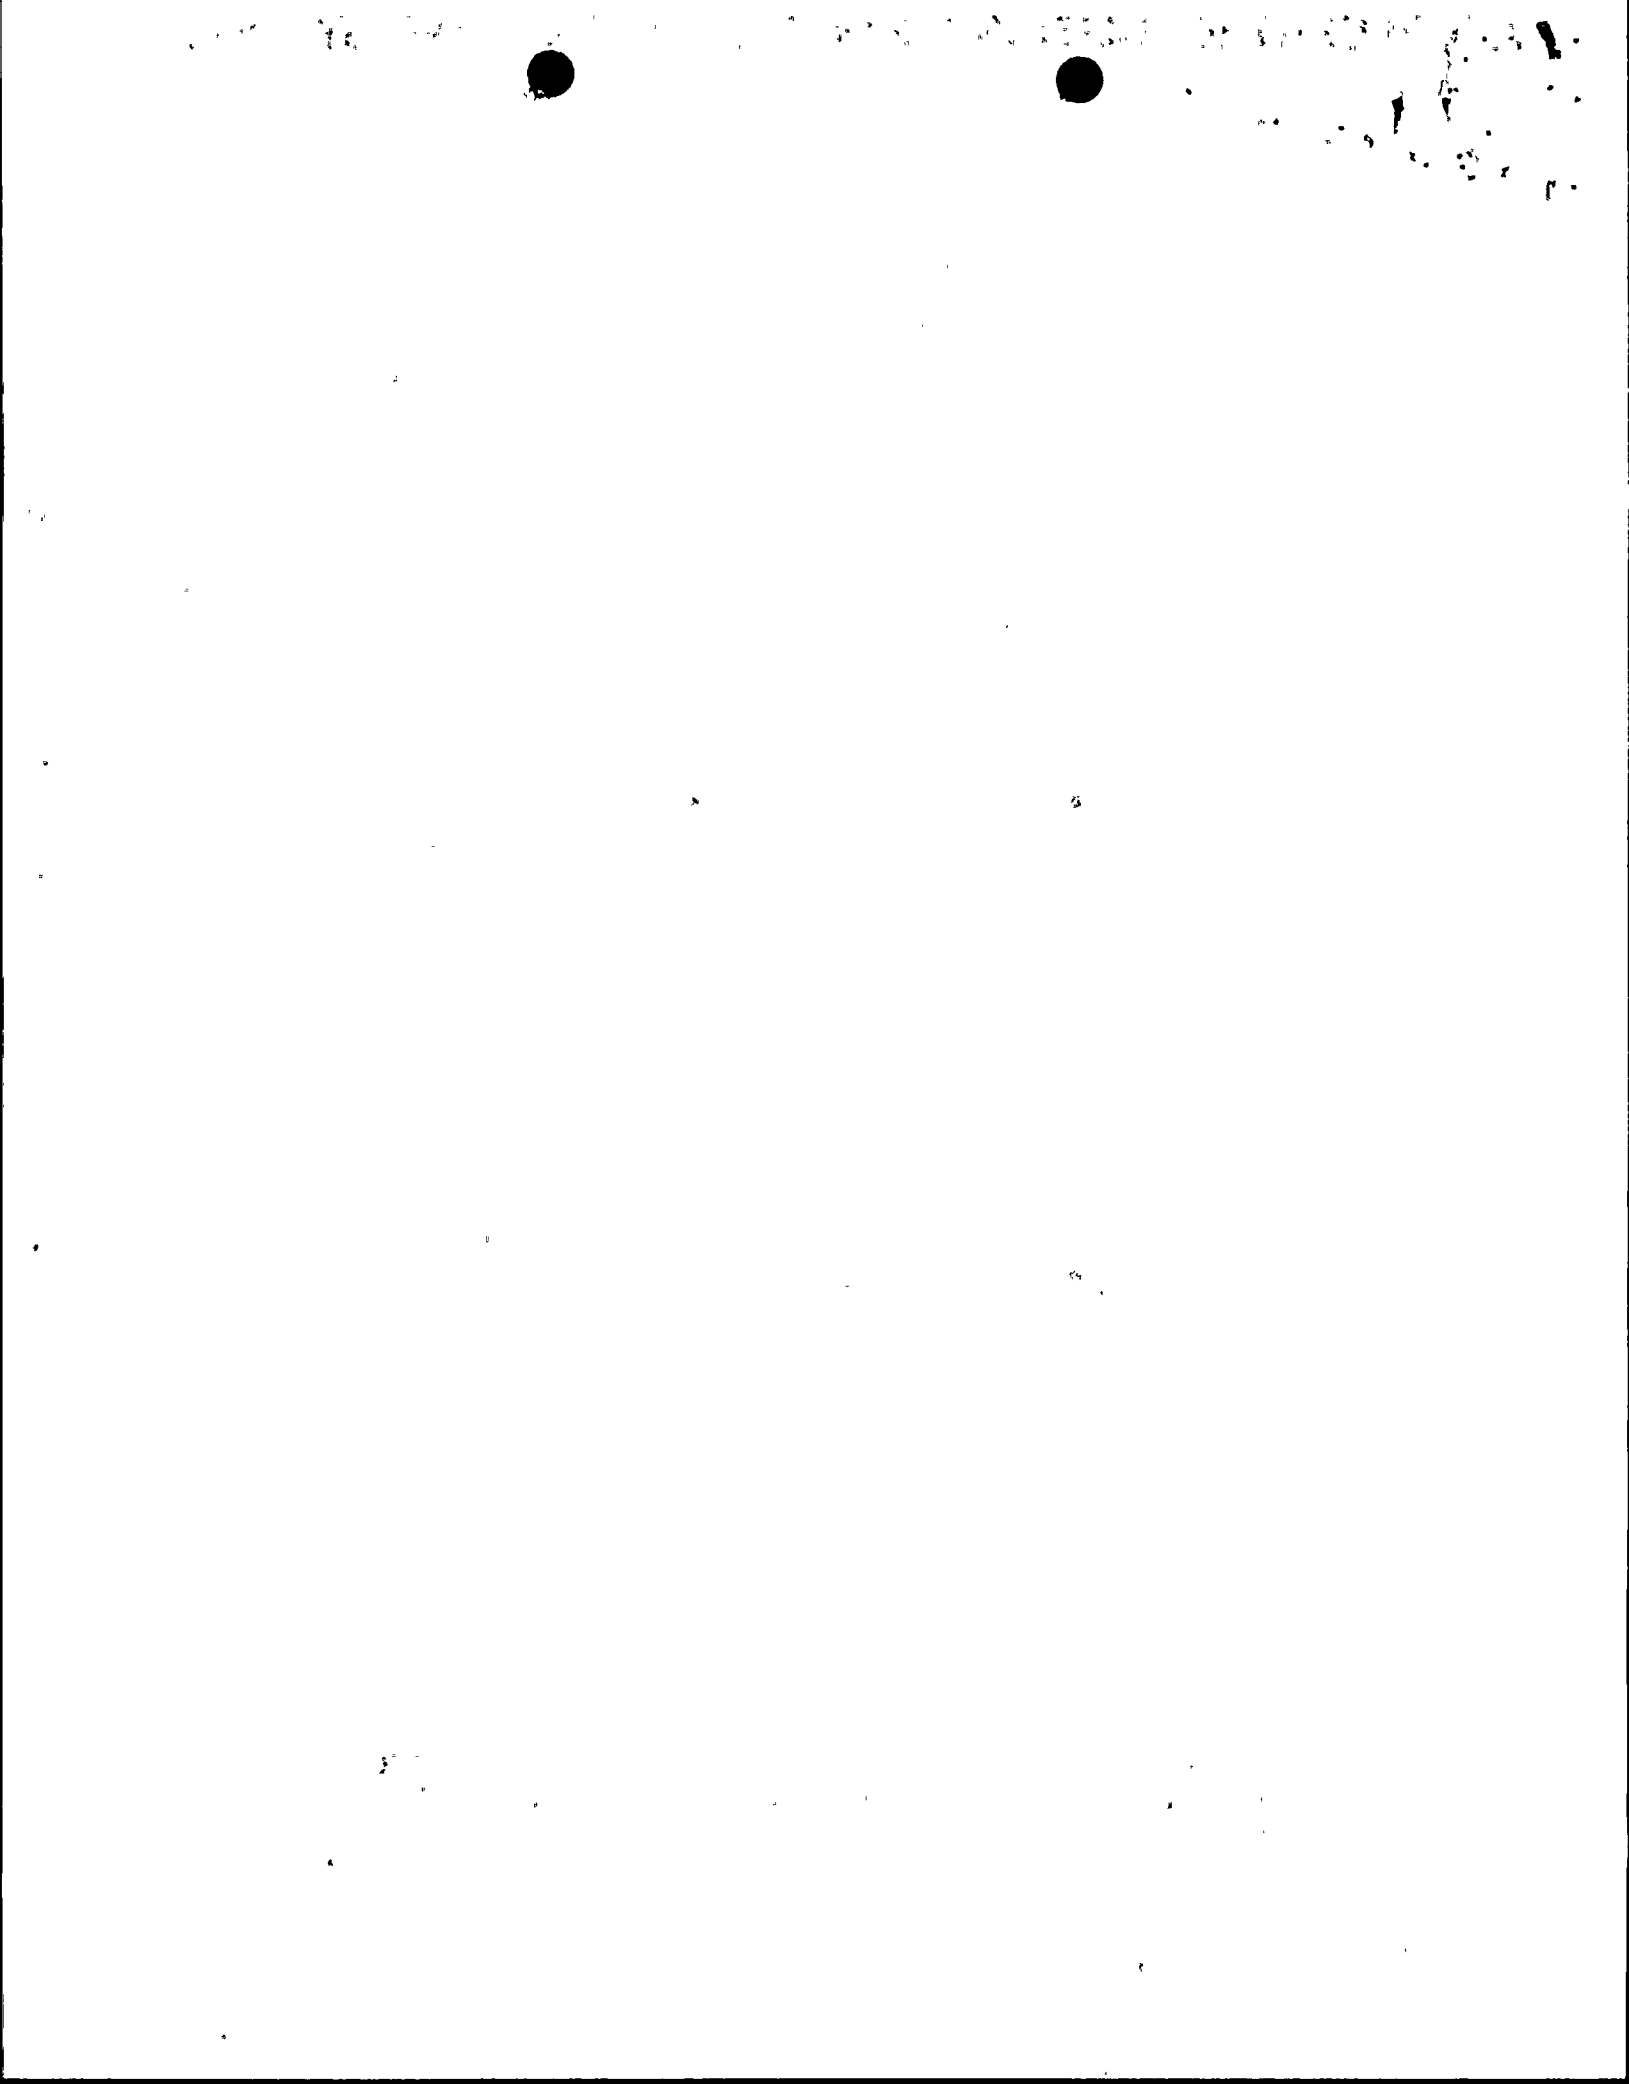



JUNE 3 1991

L-91-152

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Gentlemen:

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Reactor Protection System Setpoints

The NRC requires that Proposed License Amendments (PLAs) be accompanied by a markup of the current revision of the affected pages of the license. By letter L-90-417 dated December 19, 1990, Florida Power and Light (FPL) submitted a request to amend the Turkey Point Technical Specifications (TS). The PLA was accompanied by a markup of the TS revision current at that time (through amendment 137/132), showing the proposed changes.

Subsequently, the NRC issued amendments 138/133 on December 28, 1990, 139/134 on April 12, 1991, 140/135 on April 23, 1991, 141/136 on April 30, 1991, and 142/137 on May 20, 1991. Keeping with the requirement to provide a markup of the current revision of the license, please find attached a markup of the affected pages of the current revision (through amendment 142/137) of FPL's Turkey Point TS and an explanation of the differences between the markup submitted December 19, 1990, and the attached markup. This markup is being submitted to reflect the latest approved TS.

Should there be any questions, please contact us.

Very truly yours,

W. H. Bohlke by R. E. Strain

W. H. Bohlke
Vice President
Nuclear Engineering and Licensing

WHB/DRP/ds

Attachments

cc (w/o attachment):

Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, Turkey Point Plant

9106070245 910603
PDR ADOCK 05000250
P PDR

Adol



12
11
10
9
8
7
6
5
4
3
2
1

12
11
10
9
8
7
6
5
4
3
2
1



Faint, illegible text or markings in the top right corner.

Faint, illegible text or markings in the middle left area.

RECEIVED
U.S. DEPARTMENT OF JUSTICE
FEDERAL BUREAU OF INVESTIGATION
WASHINGTON, D.C.