

# ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9212160019      DOC. DATE: 92/12/09      NOTARIZED: NO      DOCKET #  
FACIL: 50-250 Turkey Point Plant, Unit 3, Florida Power and Light C      05000250  
50-251 Turkey Point Plant, Unit 4, Florida Power and Light C      05000251

AUTH. NAME      AUTHOR AFFILIATION  
PLUNKETT, T.F.      Florida Power & Light Co.  
RECIP. NAME      RECIPIENT AFFILIATION  
EBNETER, S.D.      Region 2 (Post 820201)

SUBJECT: Describes changes to Turkey Point Licensed Operator Training Program. Program change as described, discussed during 921124 telcon w/ listed individuals.

DISTRIBUTION CODE: M003D      COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1  
TITLE: Operator Requalification Program

NOTES: NRR RAGHAVAN, L      05000250  
NRR RAGHAVAN, L      05000251 /


	RECIPIENT		COPIES		
	ID CODE/NAME	LTR	ENCL		
	PD2-2 LA	1	0		
	AULUCK, R	1	1		
INTERNAL:	AEOD/DOA	1	1		
	NRR/DLPQ/LOLB10	1	1		
	RGN2	1	1		
EXTERNAL:	NRC PDR	1	1		
NOTES:		1	1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK. ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 11 ENCL ~~10~~

R  
I  
D  
S  
/  
A  
D  
D  
S

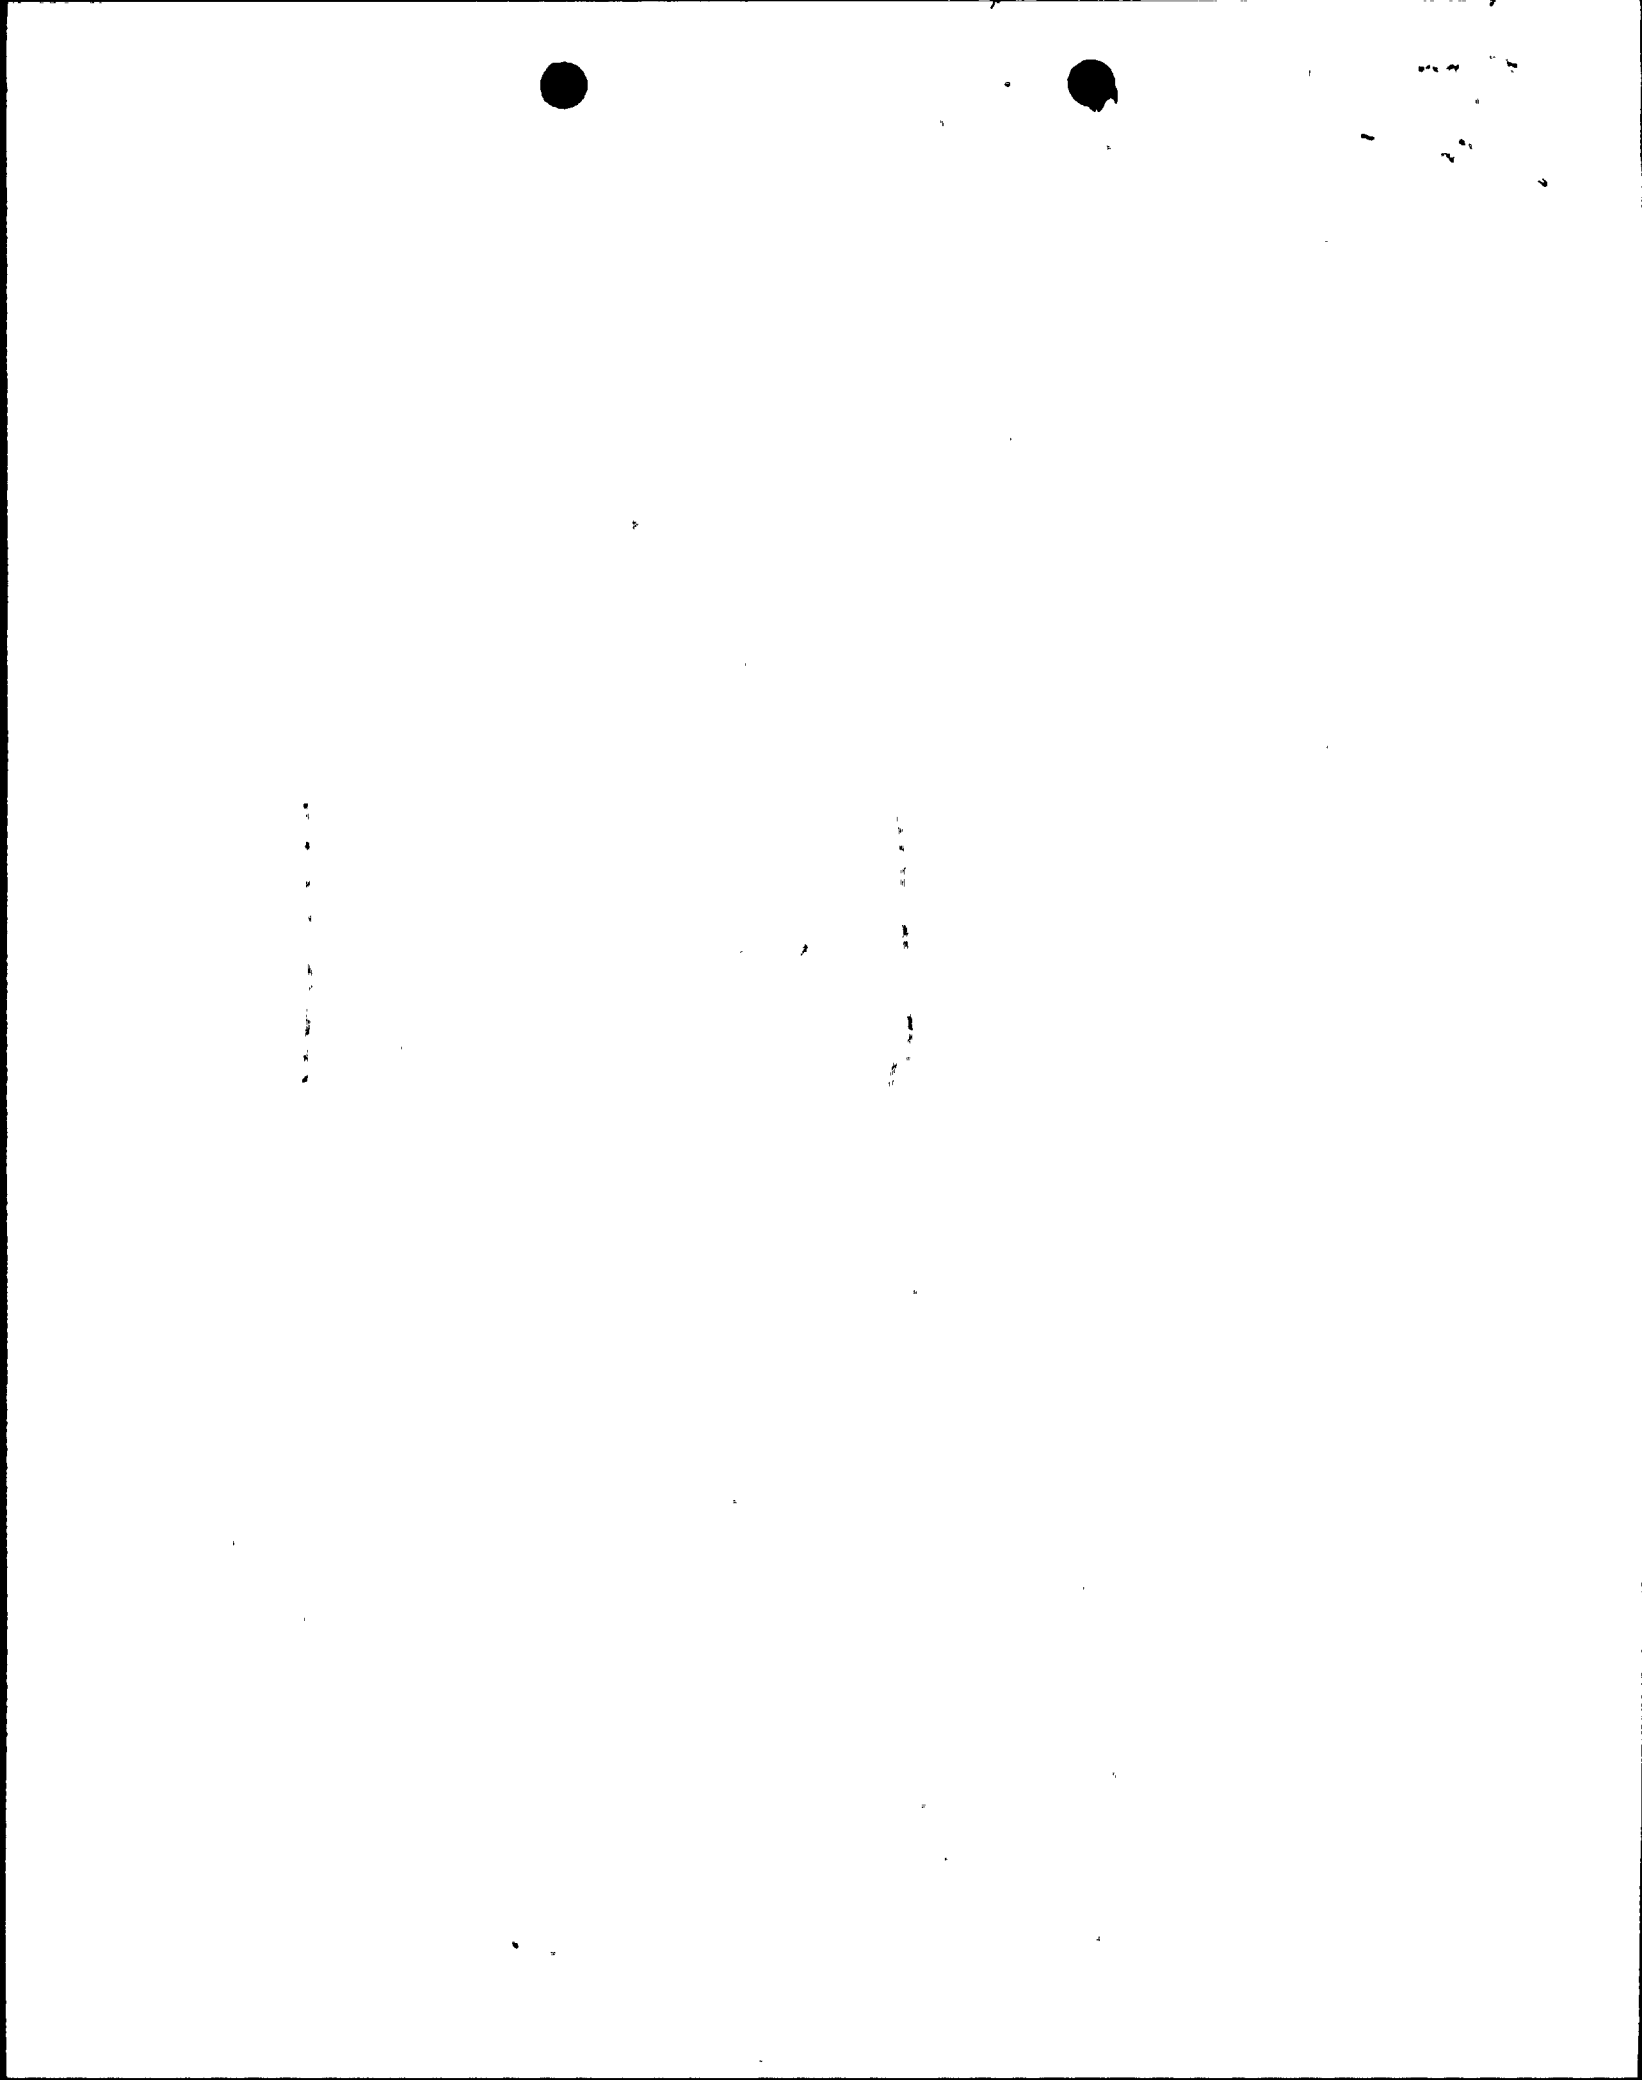



DEC 09 1992

L-92-328  
10 CFR 50.55a

Stewart D. Ebnetter  
U. S. Nuclear Regulatory Commission  
101 Marietta St., N.W., Suite 2900  
Atlanta, GA 30323

Mr. Ebnetter:

Re: Turkey Point Units 3 and 4  
Docket Nos. 50-250/50-251  
Licensed Operator Instructor On-Shift Time

The purpose of this letter is to describe a change to the Turkey Point Licensed Operator Training Program. In 1987, the program was revised to include 56 hours of on-shift time each quarter for licensed operator instructors. The purpose of the on-shift time was for the instructors to keep abreast of plant conditions and modifications.

At the present time, the program is being revised to eliminate this requirement. Subsequent to the dual unit outage, the number of plant changes have been minimized, and plant conditions have stabilized, as demonstrated by the uninterrupted periods of plant operation. Additionally, since the implementation of the on-shift time requirement, Turkey Point has acquired a plant specific simulator. All licensed operator instructors attend license requalification classes. The instructors maintain awareness of current plant configuration through the instruction which they both receive and evaluate, on the simulator. The program change, as described above, was discussed during a telephone call on November 24, 1992, between Messrs. Ross Butcher and Michael Ernstes of the NRC, and Gary Hollinger and Gabe Salamon of Florida Power and Light Company.

Should there be any questions, please contact us.

Very truly yours,

T. F. Plunkett  
Vice President  
Turkey Point Nuclear

cc: Michael E. Ernstes, Region II, USNRC  
Thomas A. Peebles, Region II, USNRC  
Ross C. Butcher, USNRC, Turkey Point Plant  
USNRC, Document Control Desk, Washington D.C.

9212160019 921209  
PDR ADOCK 05000250  
V PDR

M003  
110

11

180000

11