

WCAP-13718

Rev. 2

WESTINGHOUSE REVISED THERMAL

DESIGN PROCEDURE

INSTRUMENT UNCERTAINTY METHODOLOGY

For Florida Power & Light Company

Turkey Point Units 3 & 4

September 1995

C. F. CIOCCA

9512270314 951218
PDR ADDCK 05000250
P PDR

WESTINGHOUSE ELECTRIC CORPORATION
Nuclear Technology Division
P.O. Box 355
Pittsburgh, Pennsylvania 15230-0355



TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
I.	INTRODUCTION	1
II.	METHODOLOGY	3
III.	INSTRUMENTATION UNCERTAINTIES	7
IV.	CONCLUSIONS	32
V.	REFERENCES	33

LIST OF TABLES

<u>Table Number</u>	<u>Title</u>	<u>Page</u>
1	Pressurizer Pressure Control System Accuracy	8
2	Rod Control System Accuracy	11
3	Flow Calorimetric Instrumentation Uncertainties	21
4	Flow Calorimetric Sensitivities	22
5	Calorimetric RCS Flow Measurement Uncertainties	23
6	Cold Leg Elbow Tap Flow Uncertainty	26
7	Power Calorimetric Instrumentation Uncertainties	30
8	Secondary Side Power Calorimetric Measurement Uncertainties	31

LIST OF FIGURES

<u>Figure Number</u>	<u>Title</u>	<u>Page</u>
1	RCS Flow Calorimetric Schematic	35
2	Power Calorimetric Schematic	36

WESTINGHOUSE REVISED THERMAL DESIGN PROCEDURE
INSTRUMENT UNCERTAINTY METHODOLOGY

I. INTRODUCTION

Four operating parameter uncertainties are used in the uncertainty analysis of the Revised Thermal Design Procedure (RTDP). These parameters are Pressurizer Pressure, Primary Coolant Temperature (T_{avg}), Reactor Power, and Reactor Coolant System Flow. They are frequently monitored and several are used for control purposes. Reactor power is monitored by the performance of a secondary side heat balance (power calorimetric) once every 24 hours. RCS flow is monitored by the performance of a precision flow calorimetric at the beginning of each cycle. The RCS Cold Leg elbow taps are evaluated against the precision calorimetric and used for daily surveillance (with a small increase in uncertainty). Pressurizer pressure is a controlled parameter and the uncertainty reflects the control system. T_{avg} is a controlled parameter via the temperature input to the rod control system for insertion only, and the uncertainty reflects this control system. This report is based on the elimination of RTD Bypass Loops, that was implemented at Turkey Point in 1991, in the design to measure hot and cold leg reactor coolant system temperatures. The RTDP⁽¹⁾ is used to predict the plant's DNBR design limit. The RTDP methodology considers the uncertainties in the system operating plant parameters, fuel fabrication and nuclear and thermal parameters and includes the use of various DNB correlations. Use of the RTDP methodology requires that variances in the plant operating parameters be justified. The purpose of the following evaluation is to define the specific Turkey Point Units 3 & 4 Nuclear Plant instrument uncertainties for the four primary system operating parameters.

Westinghouse has been involved with the development of several techniques to treat instrumentation uncertainties. An early version (for D. C. Cook 2 and Trojan) used the methodology



outlined in WCAP-8567 "Improved Thermal Design Procedure",^(2,3,4) which is based on the conservative assumption that the uncertainties can be described with uniform probability distributions. Another approach is based on the more realistic assumption that the uncertainties can be described with random, normal, two sided probability distributions.⁽⁵⁾ This approach is used to substantiate the acceptability of the protection system setpoints for many Westinghouse plants, e.g., D. C. Cook 2⁽⁶⁾, V. C. Summer, Wolf Creek, Millstone Unit 3 and others. The second approach is now utilized for the determination of all instrumentation errors for the RTDP parameters and protection functions.

The RTDP methodology has been previously approved by the NRC in Westinghouse topical report WCAP-11397-P-A⁽¹⁵⁾. By letter L-95-131, dated May 5, 1995⁽¹⁶⁾, FPL submitted a proposed revision to the Turkey Point Units 3 and 4 Technical Specifications to include the implementation of Westinghouse NRC approved Revised Thermal Design Procedure. The proposed changes to the instrument uncertainties are based on the use of the RTDP methodology as documented in Revision 1 of this WCAP. In support of the thermal power up-rate project, Westinghouse generated this revision to address only the changes to the instrument uncertainties affected as a result of an increase in the core power level.

II. METHODOLOGY

The methodology used to combine the error components for a channel is the square root of the sum of the squares of those groups of components which are statistically independent. Those errors that are dependent are combined arithmetically into independent groups, which are then systematically combined. The uncertainties used are considered to be random, two sided distributions. The sum of both sides is equal to the range for that parameter, e.g., Rack Drift is typically []^{+a,c}, the range for this parameter is []^{+a,c}. This technique has been utilized before as noted above, and has been endorsed by the NRC staff^(7,8,9,10) and various industry standards^(11,12).

The relationships between the error components and the channel instrument error allowance are variations of the basic Westinghouse Setpoint Methodology⁽¹³⁾ and are defined as follows:

1. For precision parameter indication using Special Test Equipment or a digital voltmeter (DVM) at the input to the racks, and no trending of transmitter calibration and drift;

$$CSA = \{(SD + SMTE)^2 + (SRA)^2 + (SPE)^2 + (STE)^2 + (RDOUT)^2\}^{1/2} + \{(SCA + SMTE)^2\}^{1/2} + BIAS \quad \text{Eq. 1}$$

2. For parameter indication utilizing the plant process computer and no trending of transmitter calibration and drift;

$$CSA = \{(SD + SMTE)^2 + (SRA)^2 + (SPE)^2 + (STE)^2 + (RCA + RMTE)^2 + (RD + RMTE)^2 + (RTE)^2 + (ID)^2 + (A/D)^2\}^{1/2} + \{(SCA + SMTE)^2\}^{1/2} + BIAS \quad \text{Eq. 2}$$

3. For parameters which have control systems and no trending of transmitter calibration and drift;



$$CSA = \{(PMA)^2 + (PEA)^2 + (SD + SMTE)^2 + (SRA)^2 + (SPE)^2 + (STE)^2 + (RCA + RMTE)^2 + (RD + RMTE)^2 + (RTE)^2\}^{1/2} + \{(SCA + SMTE)^2\}^{1/2} + BIAS \quad \text{Eq. 3}$$

PMA and PEA terms are not included in equations 1 and 2 since the equations are to determine instrumentation uncertainties only. PMA and PEA terms are included in the determination of control system uncertainties.

where:

CSA	=	Channel Statistical Allowance
PMA	=	Process Measurement Accuracy
PEA	=	Primary Element Accuracy
SCA	=	Sensor Calibration Accuracy
SRA	=	Sensor Reference Accuracy
SMTE	=	Sensor Measurement and Test Equipment Accuracy
SPE	=	Sensor Pressure Effects
STE	=	Sensor Temperature Effects
SD	=	Sensor Drift
RCA	=	Rack Calibration Accuracy
RMTE	=	Rack Measurement and Test Equipment Accuracy
RTE	=	Rack Temperature Effects
RD	=	Rack Drift
RDOUT	=	Readout Device Accuracy
CA	=	Controller Allowance
ID	=	Computer Isolator Drift
A/D	=	Analog to Digital Conversion Accuracy

The parameters above are as defined in references 5 and 12 and are based on SAMA Standard PMC 20.1, 1973⁽¹⁴⁾. However, for ease in understanding they are paraphrased below:

- PMA - non-instrument related measurement errors, e.g., temperature stratification of a fluid in a pipe.
- PEA - errors due to a metering device, e.g., elbow, venturi, orifice.
- SCA - calibration tolerance for a sensor/transmitter.

- SRA - reference (calibration) accuracy for a sensor/transmitter.
- SPE - change in input-output relationship due to a change in static pressure for a differential pressure (d/p) cell.
- STE - change in input-output relationship due to a change in ambient temperature for a sensor or transmitter.
- SD - change in input-output relationship over a period of time at reference conditions for a sensor or transmitter.
- RCA - calibration accuracy for all rack modules in loop or channel assuming the loop or channel is string calibrated, or tuned, to this accuracy.
- RTE - change in input-output relationship due to a change in ambient temperature for the rack modules.
- RD - change in input-output relationship over a period of time at reference conditions for the rack modules.
- RDOUT - the measurement accuracy of a special test local gauge, digital voltmeter or multimeter on it's most accurate applicable range for the parameter measured, or 1/2 the smallest increment on an indicator (readability).
- CA - allowance for the accuracy of the median signal selector and the controller circuitry.
- ID - change in input-output relationship over a period of time at reference conditions for a control or protection signal isolating device.
- A/D - allowance for conversion accuracy of an analog signal to a digital signal for process computer use.
- BIAS - a non-random uncertainty for a sensor or transmitter or a process parameter.



A more detailed explanation of the Westinghouse methodology noting the interaction of several parameters is provided in references 6 and 13.

III. INSTRUMENTATION UNCERTAINTIES

The instrumentation uncertainties will be discussed first for the two parameters which are controlled by automatic systems, Pressurizer Pressure, and T_{avg} (through Rod Control).

1. PRESSURIZER PRESSURE

Pressurizer Pressure is controlled by comparison of the measured vapor space pressure and a reference value. Allowances are made for the transmitter and the process racks/indicators and controller. As noted on Table 1, the controller uncertainty for this function is $[\pm \quad]^{+a,c}$ which corresponds to an accuracy of $[\quad]^{+a,c}$ for the average of 3 indicators. In addition to the controller accuracy, an allowance is made for pressure overshoot or undershoot due to the interaction and thermal inertia of the heaters and spray. Based on an evaluation of plant operation, an allowance of $[\quad]^{+a,c}$ was made for this effect. Therefore, a total control system uncertainty of $[\quad]^{+a,c}$ is calculated, which results in a standard deviation of $[\quad]^{+a,c}$ (assuming a normal, two sided probability distribution).

TABLE 1
PRESSURIZER PRESSURE CONTROL SYSTEM ACCURACY

SCA	=	[]	+a,c
SRA	=			
SMTE	=			
STE	=			
SD	=			
BIAS	=			
RCA _{IND}	=			
RMTE _{IND}	=			
RTE _{IND}	=			
RD _{IND}	=			
RDOUT _{IND}	=			
RCA _{CNTL}	=			

ELECTRONICS UNCERTAINTY = PLUS	[]	+a,c
ELECTRONICS UNCERTAINTY = PLUS			
CONTROLLER UNCERTAINTY = (Average of 3 Indicators)			

2. T_{avg}

T_{avg} is controlled by a system that compares the median T_{avg} from the loops with a reference derived from the First Stage Turbine Impulse Chamber Pressure. T_{avg} is the average of the narrow range T_H and T_C values. The median loop T_{avg} is then used for rod control. Allowances are made (as noted on Table 2) for the RTDs, transmitter and the process racks/indicators and controller. The CSA for this function is dependent on the type of RTD, pressure transmitter, and the location of the RTDs, i.e., in the Hot and Cold Legs. Based on the assumption that two T_H and one T_C cross-calibrated RTDs are used to calculate T_{avg} and the RTDs are located in the hot and cold leg piping, the CSA for the electronics is []^{+a,c}. Assuming a normal, two sided probability distribution results in an electronics standard deviation (σ₁) of []^{+a,c}.

However, this does not include the deadband for control i.e, auto or manual of ± 1.5 °F. For T_{avg} the controller accuracy is the combination of the instrumentation accuracy and the deadband. The probability distribution for the deadband has been determined to be []^{+a,c}

The variance for the deadband uncertainty is then:

$$(\sigma_2)^2 = []^{+a,c}.$$

Combining the variance for instrumentation and deadband results in a controller variance of:

$$(\sigma_T)^2 = (\sigma_1)^2 + (\sigma_2)^2 = []^{+a,c}$$

The controller σ_T = []^{+a,c} for a total random uncertainty of []^{+a,c}.



With the incorporation of T_{cold} streaming, an additional bias of 1°F is included in Table 2. Therefore, the total uncertainty of the controller with the T_{cold} streaming included is []^{+a,c} random and []^{+a,c} bias.



TABLE 2
 ROD CONTROL SYSTEM ACCURACY

SENSOR/TRANSMITTER		Tavg in °F	Turbine Pressure in % span ^{+a,c}
PMA =	[
SCA =			
SRA =			
SMTE=			
STE =			
SD =			
BIAS=			

PROCESS RACKS		ERI	EAO	INDICATOR	CONTROLLER	TURBINE
Tavg						
Span		150°F	75°F	75°F	75°F	630 psig ^{+a,c}
RCA =	[
RMTE =						
RTE =						
RD =						
RDOUT=						
CA =						

HOT LEG RTDs = 2

COLD LEG RTDs = 1

ROD CONTROL SYSTEM ACCURACY

SENSOR/TRANSMITTER		Tavg	Turbine Pressure
			All values in % span
Span		75°F	630 psig ^{+a,c}
PMA =	[
SRA =			
SCA =			
SMTE=			
STE =			
SD =			
BIAS=			

TABLE 2 (Continued)
ROD CONTROL SYSTEM ACCURACY

PROCESS RACKS

Tavg	ERI	EAO	INDICATION		TURBINE
All values in % span					
Span	75°F	75°F	75°F	630	psig
RCA =	[] +a,c
RMTE=					
RTE =					
RD =					
ELECTRONICS CSA	=	[] +a,c
ELECTRONICS SIGMA	=				
CONTROLLER SIGMA	=				
CONTROLLER BIAS	=				
CONTROLLER CSA	=				



3. RCS FLOW

RTDP and Turkey Point's Technical Specifications require an RCS flow measurement with a high degree of accuracy. Six month drift effects have been included for feedwater temperature, feedwater flow, steam pressure, and pressurizer pressure. It is assumed for this error analysis that the flow measurement is performed within ninety days of completing the cross-calibration of the hot leg and cold leg narrow range RTDs. Therefore, partial drift effects are included. It is also assumed that the calorimetric flow measurement is performed at the beginning of a cycle, i.e., no allowances have been made for Feedwater venturi fouling, and the calorimetric is performed above 90% RTP.

The flow measurement is performed by determining the Steam Generator thermal output (corrected for the RCP heat input and the loop's share of primary system heat losses) and the enthalpy rise (Δh) of the primary coolant. Assuming that the primary and secondary sides are in equilibrium, the RCS total vessel flow is the sum of the individual primary loop flows, i.e.,

$$W_{RCS} = N(W_L). \quad \text{Eq. 4}$$

The individual primary loop volumetric flows are determined by correcting the thermal output of the Steam Generator for Steam Generator blowdown (if not secured), subtracting the RCP heat addition, adding the loop's share of the primary side system losses, dividing by the primary side enthalpy rise and multiplying by the Cold Leg specific volume. The equation for this calculation is:

$$W_L = \frac{(A)[Q_{SG} - Q_P + (\frac{Q_L}{N})](V_C)}{(h_H - h_C)} \quad \text{Eq. 5}$$



where;

- W_L = Loop flow (gpm)
- A = Constant conversion factor 0.1247 gpm/(ft³/hr)
- Q_{SG} = Steam Generator thermal output (Btu/hr)
- Q_P = RCP heat addition (Btu/hr)
- Q_L = Primary system net heat losses (Btu/hr)
- V_C = Specific volume of the Cold Leg at T_c (ft³/lb)
- N = Number of primary side loops
- h_H = Hot Leg enthalpy (Btu/lb)
- h_C = Cold Leg enthalpy (Btu/lb).

The thermal output of the Steam Generator is determined by a precision secondary side calorimetric measurement, which is defined as:

$$Q_{SG} = (h_s - h_f)W_f \quad \text{Eq. 6}$$

- where;
- h_s = Steam enthalpy (Btu/lb)
 - h_f = Feedwater enthalpy (Btu/lb)
 - W_f = Feedwater flow (lb/hr).

The Steam enthalpy is based on the measurement of Steam Generator outlet Steam pressure, assuming saturated conditions. The Feedwater enthalpy is based on the measurement of Feedwater temperature and nominal Feedwater pressure. The Feedwater flow is determined by multiple measurements and the following calculation:

$$W_f = (K)(F_a)\{(p_f)(d/p)\}^{1/2} \quad \text{Eq. 7}$$

- where;
- K = Feedwater venturi flow coefficient
 - F_a = Feedwater venturi correction for thermal expansion
 - p_f = Feedwater density (lb/ft³)
 - d/p = Feedwater venturi pressure drop (inches H₂O).



The Feedwater venturi flow coefficient is the product of a number of constants including as-built dimensions of the venturi and calibration tests performed by the vendor. The thermal expansion correction is based on the coefficient of expansion of the venturi material and the difference between Feedwater temperature and calibration temperature. Feedwater density is based on the measurement of Feedwater temperature and Feedwater pressure. The venturi pressure drop is obtained from the output of the differential pressure cell connected to the venturi.

RCP heat addition is determined by calculation, based on the best estimate of coolant flow, pump head, and pump hydraulic efficiency.

The primary system net heat losses are determined by calculation, considering the following system heat inputs and heat losses:

- Charging flow
- Letdown flow
- Seal injection flow
- RCP thermal barrier cooler heat removal
- Pressurizer spray flow
- Pressurizer surge line flow
- Component insulation heat losses
- Component support heat losses
- CRDM heat losses.

A single calculated sum for 100% RTP operation is used for these losses or heat inputs.

The Hot Leg and Cold Leg enthalpies are based on the measurement of the Hot Leg temperature, Cold Leg temperature and the nominal Pressurizer pressure. The Cold Leg specific volume is based on measurement of the Cold Leg temperature and nominal Pressurizer pressure.

The RCS flow measurement is thus based on the following plant measurements:

- Steamline pressure (P_s)
- Feedwater temperature (T_f)
- Feedwater venturi differential pressure (d/p)
- Hot Leg temperature (T_H)
- Cold Leg temperature (T_C)
- Steam Generator blowdown flow (if not secured)
- Pressurizer pressure (P_p)

and on the following calculated values:

- Feedwater venturi flow coefficients (K)
- Feedwater venturi thermal expansion correction (F_a)
- Feedwater density (ρ_f)
- Feedwater enthalpy (h_f)
- Feedwater pressure (P_f)
- Steam enthalpy (h_s)
- Moisture carryover (impacts h_s)
- Primary system net heat losses (Q_L)
- RCP heat addition (Q_p)
- Hot Leg enthalpy (h_H)
- Cold Leg enthalpy (h_C).

These measurements and calculations are presented schematically in Figure 1.

The derivation of the measurement errors and flow uncertainties on Table 5 are noted below.

Secondary Side

The secondary side uncertainties are in four principal areas, Feedwater flow, Feedwater enthalpy, Steam enthalpy and RCP heat addition. These four areas are specifically identified on Table 5.

For the measurement of Feedwater flow, each Feedwater venturi is calibrated by the vendor in a hydraulics laboratory under controlled conditions to an accuracy of []^{+a,b,c}. The calibration data which substantiates this accuracy is provided to the plant by the vendor. An additional uncertainty factor of []^{+a,c} is included for installation effects, resulting in a conservative overall flow coefficient (K) uncertainty of []^{+a,c}. Since RCS loop flow is proportional to Steam Generator thermal output which is proportional to Feedwater flow, the flow coefficient uncertainty is expressed as []^{+a,c}. It should be noted that no allowance is made for venturi fouling. The venturis should be inspected, and cleaned if necessary, prior to performance of the precision measurement. If fouling is present but not removed, its effects must be treated as a flow bias.

The uncertainty applied to the Feedwater venturi thermal expansion correction (F_a) is based on the uncertainties of the measured Feedwater temperature and the coefficient of thermal expansion for the venturi material, typically 304 stainless steel. For this material, a change of $\pm 1^\circ\text{F}$ in the nominal Feedwater temperature range changes F_a by $\pm 0.002 \%$ and the Steam Generator thermal output by the same amount.

An uncertainty in F_a of $\pm 5 \%$ for 304 stainless steel is used in this analysis. This results in an additional uncertainty of []^{+a,c} in Feedwater flow. Westinghouse uses the conservative value of []^{+a,c}.

Using the NBS/NRC Steam Tables it is possible to determine the sensitivities of various parameters to changes in Feedwater temperature and pressure. Table 4 notes the instrument uncertainties for the hardware used to perform the measurements. Table 5 lists the various sensitivities. As can be seen on Table 5, Feedwater temperature uncertainties have an impact on venturi



F_a, Feedwater density and Feedwater enthalpy. Feedwater pressure uncertainties impact Feedwater density and Feedwater enthalpy.

Feedwater venturi d/p uncertainties are converted to % Feedwater flow using the following conversion factor:

$$\% \text{ flow} = (\text{d/p uncertainty})(1/2)(\text{transmitter span}/100)^2$$

The Feedwater flow transmitter span is 120 % of nominal flow.

Using the NBS/NRC Steam Tables, it is possible to determine the sensitivity of Steam enthalpy to changes in Steam pressure and Steam quality. Table 3 notes the uncertainty in Steam pressure and Table 4 provides the sensitivity. For Steam quality, the Steam Tables were used to determine the sensitivity at a moisture content of []^{+a,c}. This value is noted on Table 4.

The net pump heat uncertainty is derived from the combination of the primary system net heat losses and pump heat addition and are summarized for a three loop plant as follows:

System heat losses	- 2.0 MWt
Component conduction and convection losses	- 1.4
Pump heat adder	<u>+11.4</u>
Net Heat input to RCS	+ 8.0 MWt

The uncertainty on system heat losses, which is essentially all due to charging and letdown flows, has been estimated to be []^{+a,c} of the calculated value. Since direct measurements are not possible, the uncertainty on component conduction and convection losses has been assumed to be []^{+a,c} of the calculated value. Reactor coolant pump hydraulics are known to a relatively high confidence level, supported by system hydraulics



tests performed at Prairie Island Unit 2 and by input power measurements from several other plants, therefore, the uncertainty for the pump heat addition is estimated to be []^{+a,c} of the best estimate value. Considering these parameters as one quantity, which is designated the net pump heat uncertainty, the combined uncertainties are less than []^{+a,c} of the total, which is []^{+a,c} of core power.

Primary Side

The primary side uncertainties are in three principal areas, hot leg enthalpy, cold leg enthalpy and cold leg specific volume. These are specifically noted on Table 5. Three primary side parameters are actually measured, T_h , T_c and Pressurizer pressure. Hot Leg enthalpy is influenced by T_h , Pressurizer pressure and Hot Leg temperature streaming. The uncertainties for the instrumentation are noted on Table 3 and the sensitivities are provided on Table 4. The hot leg streaming is split into random and bias (systematic) components. For Turkey Point Units 3 & 4, the RTDs are located in thermowells placed in the loops (bypass manifolds eliminated). A plant specific evaluation has been performed which resulted in a streaming uncertainty of []^{+a,c} for random and []^{+a,c} for systematic components.

The cold leg enthalpy and specific volume uncertainties are impacted by T_c and Pressurizer pressure. Table 3 notes the T_c instrument uncertainty and Table 4 provides the sensitivities.

Noted on Table 5 is the plant specific RTD cross-calibration systematic allowance. When necessary, an allowance is made for a systematic temperature error due to the RTD cross-calibration procedure. No allowance was necessary for Turkey Point.

Parameter dependent effects are identified on Table 5. Westinghouse has determined the dependent sets in the calculation



and the direction of interaction, i.e., whether components in a dependent set are additive or subtractive with respect to a conservative calculation of RCS flow. The same work was performed for the instrument bias values. As a result, the calculation explicitly accounts for dependent effects and biases with credit taken for sign (or direction of impact).

Using Table 5, the 3 loop uncertainty equation (with biases) is as follows:

$$\left[\begin{array}{c} \text{ } \end{array} \right]^{+a,c}$$

Based on the number of loops; number, type and measurement method of RTDs, and the vessel Delta-T, the flow uncertainty is:

# of loops	flow uncertainty (% flow)
3	$\left[\begin{array}{c} \text{ } \end{array} \right]^{+a,c}$



TABLE 3
FLOW CALORIMETRIC INSTRUMENTATION UNCERTAINTIES
(% Span)

	FW TEMP	FW PRES	FW d/p	STM PRESS	T _H	T _C	PRZ PRESS	
SCA =	[] ^{+a,c}
SRA =								
SMTE =								
SPE =								
STE =								
SD =								
RDOU=								
RCA =								
RMTE =								
RTE =								
RD =								
BIAS =								
CSA =								
# OF INST USED				1	3	1	3	
	°F	psi	% d/p	psi	°F	°F	psi	
			120% Flow					
INST SPAN =	500	1500	120	1200	120	120	1000	
INST UNC. (RANDOM) =	[] ^{+a,c}
INST UNC. (BIAS) =								
NOMINAL =	432°F	879psia		779psia	607.8°F	546.6°F	2250psia	



FEEDWATER FLOW

F _a	TEMPERATURE	=	[+a,c
	MATERIAL	=		
DENSITY	TEMPERATURE	=		
	PRESSURE	=		
DELTA P		=		
FEEDWATER ENTHALPY		=		
	TEMPERATURE	=		
	PRESSURE	=		
		=]	
	h _s	=	1199.7	BTU/LBM
	h _f	=	410.5	BTU/LBM
	Dh (SG)	=	789.2	BTU/LBM

STEAM ENTHALPY

PRESSURE	=	[+a,c
MOISTURE	=		
HOT LEG ENTHALPY	=		
TEMPERATURE	=		
PRESSURE	=		
h _H	=	624.0 BTU/LBM	
h _C	=	542.6 BTU/LBM	
Dh(VESS)	=	81.4 BTU/LBM	
Cp(T _H)	=	1.465 BTU/LBM-°F	

COLD LEG ENTHALPY

$$\begin{aligned} \text{TEMPERATURE} &= \left[\begin{array}{c} \text{ } \\ \text{ } \end{array} \right]^{+a,c} \\ \text{PRESSURE} &= \left[\begin{array}{c} \text{ } \\ \text{ } \end{array} \right] \\ C_p(T_c) &= 1.233 \text{ BTU/LBM-}^\circ\text{F} \end{aligned}$$

COLD LEG SPECIFIC VOLUME

$$\begin{matrix} \text{TEMPERATURE} \\ \text{PRESSURE} \end{matrix} = \left[\begin{matrix} \\ \\ \end{matrix} \right]^{\text{+a,c}}$$



TABLE 5
CALORIMETRIC RCS FLOW MEASUREMENT UNCERTAINTIES

COMPONENT	INSTRUMENT ERROR	FLOW UNCERTAINTY
FEEDWATER FLOW	[] ^{+a,c}
VENTURI		
THERMAL EXPANSION COEFFICIENT		
TEMPERATURE		
MATERIAL		
DENSITY		
TEMPERATURE		
PRESSURE		
DELTA P		
FEEDWATER ENTHALPY		
TEMPERATURE		
PRESSURE		
STEAM ENTHALPY		
PRESSURE		
MOISTURE		
NET PUMP HEAT ADDITION		
HOT LEG ENTHALPY		
TEMPERATURE		
STREAMING, RANDOM		
STREAMING, SYSTEMATIC		
PRESSURE		
COLD LEG ENTHALPY		
TEMPERATURE		
PRESSURE		
COLD LEG SPECIFIC VOLUME		
TEMPERATURE		
PRESSURE		

*, **, +, ++ INDICATE SETS OF DEPENDENT PARAMETERS



TABLE 5 (CONTINUED)
CALORIMETRIC RCS FLOW MEASUREMENT UNCERTAINTIES

COMPONENT	FLOW UNCERTAINTY
BIAS VALUES	
FEEDWATER PRESSURE	[] ^{+a,c}
DENSITY	
ENTHALPY	
STEAM PRESSURE	
ENTHALPY	
PRESSURIZER PRESSURE	
ENTHALPY - HOT LEG	
ENTHALPY - COLD LEG	
SPECIFIC VOLUME - COLD LEG	
FLOW BIAS TOTAL VALUE	
SINGLE LOOP UNCERTAINTY (WITHOUT BIAS VALUES)	[] ^{+a,c}
N LOOP UNCERTAINTY (WITHOUT BIAS VALUES)	
N LOOP UNCERTAINTY (WITH BIAS VALUES)	



As noted earlier, the precision flow calorimetric is used as the reference for determining the accuracy of the Cold Leg elbow taps. Since the elbow tap ΔP transmitters feed the control board indicators, it is a simple matter to perform Technical Specification required surveillance. Table 6 notes the instrument uncertainties for determining flow by using the elbow taps, assuming three elbow taps per loop. The ΔP transmitter uncertainties are converted to percent flow on the same basis as the Feedwater venturi ΔP . The elbow tap uncertainty is then combined with the precision flow calorimetric uncertainty. This combination of uncertainties results in the following total flow uncertainty:

# of loops	flow uncertainty (% flow)
------------	---------------------------

3	$\pm 3.6^*$
---	-------------

The corresponding values used in RTDP are:

# of loops	standard deviation (% flow)
------------	-----------------------------

3	$\pm 1.8^*$
---	-------------

*Based on Florida Power & Light procedures and information.

TABLE 6
COLD LEG ELBOW TAP FLOW UNCERTAINTY
INSTRUMENT UNCERTAINTIES

PEA = []^{+a,c} ALL VALUES IN % d/p SPAN

SCA* = 0.50
SMTE* = 0.34
SPE* = 1.12
STE* = 1.44
SD* = 0.51
BIAS* = 0.00

RTE = []^{+a,c}
A/D = []

RCA = []^{+a,c} ALL VALUES IN % FLOW
RD = []
RMTE = []
RDOUT = []

OF LOOP = 3
FLOW CALORIMETRIC = []^{+a,c}
FLOW CAL. BIAS = []
PRESS. CONTROL = []
TEMP. CONTROL = []
FLOW SPAN = []

ACCURACY OF INDICATED RCS FLOW FROM CONTROL BOARD INDICATION

PMA = []^{+a,c} ALL VALUES IN % FLOW*
PMA = []
PEA = []

SCA = 0.36
SMTE = 0.24
SPE = 0.37
STE = 1.04
SD = 0.37
BIAS = 0.00

RCA = []^{+a,c}
RMTE = []
RTE = []
RD = []
A/D = []
RDOUT = []

LOOP ELBOW TAP = 2.6 % FLOW*
N LOOP ELBOW TAP = 1.5 % FLOW*
N LOOP RCS FLOW (NO BIAS) = 3.6 % FLOW*

* Based on Florida Power & Light procedures and information.



4. REACTOR POWER

Generally a plant performs a primary/secondary side heat balance once every 24 hours when power is above 15% Rated Thermal Power. This heat balance is used to verify that the plant is operating within the limits of the Operating License and to adjust the Power Range Neutron Flux channels when the difference between the NIS and the heat balance is greater than that required by the plant Technical Specifications.

Assuming that the primary and secondary sides are in equilibrium; the core power is determined by summing the thermal output of the steam generators, correcting the total secondary power for Steam Generator blowdown (if not secured), subtracting the RCP heat addition, adding the primary side system losses, and dividing by the core rated Btu/hr at full power. The equation for this calculation is:

$$RP = \frac{\{(M)[Q_{SG} - Q_P + (\frac{Q_L}{N})]\}(100)}{H} \quad \text{Eq. 8}$$

where;

- RP = Core power (% RTP)
- N = Number of primary side loops
- Q_{SG} = Steam Generator thermal output (BTU/hr) as defined in Eq. 6
- Q_P = RCP heat addition (Btu/hr) as defined in Eq. 5
- Q_L = Primary system net heat losses (Btu/hr) as defined in Eq. 5
- H = Core rated Btu/hr at full power.

For the purposes of this uncertainty analysis (and based on H noted above) it is assumed that the plant is at 100% RTP when the measurement is taken. Measurements performed at lower power levels

will result in different uncertainty values. However, operation at lower power levels results in increased margin to DNB far in excess of any margin losses due to increased measurement uncertainty.

The secondary side power calorimetric equations and effects are the same as those noted for the precision flow calorimetric (secondary side portion), equations 6 and 7. The measurements and calculations are presented schematically on Figure 2. Table 7 provides the instrument uncertainties for those measurements performed. Since it is necessary to make this determination daily, it has been assumed that the main control board indicators will be used for the calculations. The sensitivities calculated are the same as those noted for the secondary side in Table 4. As noted in Table 8, Westinghouse has determined the dependent sets in the calculation and the direction of interaction. This is the same as that performed for the RCS flow calorimetric, but applicable only to power. The same was performed for the bias values noted. It should be noted that Westinghouse does not include any allowance for Feedwater venturi fouling. The effect of fouling results in an indicated power higher than actual, which is conservative.

Using the power uncertainty values noted on Table 8, the 3 loop uncertainty (with bias values) equation is as follows:

$$\left[\begin{array}{c} \\ \\ \\ \end{array} \right]^{+a,c}$$

Based on the number of loops and the instrument uncertainties for the four parameters, the power measurement uncertainty for the secondary side power calorimetric is:

of loops

3

power uncertainty (% RTP)

[]^{+a,c}



TABLE 7
POWER CALORIMETRIC INSTRUMENTATION UNCERTAINTIES

(% SPAN)	FW TEMP	FW PRES	FW d/p	STM PRESS
SCA =	[] ^{+a,c}
SRA =				
SMTE=				
SPE =				
STE =				
SD =				
BIAS=				
RCA =				
RMTE=				
RTE =				
RD =				
ID =				
A/D =				
CSA =				
	°F	psi	% d/p	psi
			120% Flow	
INST SPAN =	500	1500	120	1200
INST UNC	[] ^{+a,c}
(RANDOM) =				
INST UNC	[] ^{+a,c}
(BIAS) =				
NOMINAL =	432°F	879 psia		779 psia



TABLE 8
SECONDARY SIDE POWER CALORIMETRIC MEASUREMENT UNCERTAINTIES

COMPONENT	INSTRUMENT ERROR	POWER UNCERTAINTY
FEEDWATER FLOW VENTURI		+a,c
THERMAL EXPANSION COEFFICIENT TEMPERATURE MATERIAL		
DENSITY TEMPERATURE PRESSURE		
DELTA P		
FEEDWATER ENTHALPY TEMPERATURE PRESSURE		
STEAM ENTHALPY PRESSURE MOISTURE		
NET PUMP HEAT ADDITION		
BIAS VALUES		
FEEDWATER DELTA P FEEDWATER PRESSURE		
STEAM PRESSURE POWER BIAS TOTAL VALUE		
*, ** INDICATE SETS OF DEPENDENT PARAMETERS		
SINGLE LOOP UNCERTAINTY (WITHOUT BIAS VALUES)		
N LOOP UNCERTAINTY	(WITHOUT BIAS VALUES)	
N LOOP UNCERTAINTY	(WITH BIAS VALUES)	

IV. CONCLUSIONS

The preceding sections provide the methodology to account for pressure, temperature, power and RCS flow uncertainties for the RTDP analysis. The plant specific instrumentation data and procedures have been reviewed for Turkey Point Units 3 & 4 and the uncertainty calculations completed. These uncertainty values or more conservative values are used in the RTDP analysis.

V. REFERENCES

1. Westinghouse WCAP-11397-P-A, "Revised Thermal Design Procedure", dated April 1989.
2. Westinghouse letter NS-CE-1583, C. Eicheldinger to J. F. Stolz, NRC, dated 10/25/77.
3. Westinghouse letter NS-PLC-5111, T. M. Anderson to E. Case, NRC, dated 5/30/78.
4. Westinghouse letter NS-TMA-1837, T. M. Anderson to S. Varga, NRC, dated 6/23/78.
5. Westinghouse letter NS-EPR-2577, E. P. Rahe Jr. to C. H. Berlinger, NRC, dated 3/31/82.
6. Westinghouse Letter NS-TMA-1835, T. M. Anderson to E. Case, NRC, dated 6/22/78.
7. NRC letter, S. A. Varga to J. Dolan, Indiana and Michigan Electric Company, dated 2/12/81.
8. NUREG-0717 Supplement No. 4, Safety Evaluation Report related to the operation of Virgil C. Summer Nuclear Station Unit No. 1, Docket 50-395, August, 1982.
9. Regulatory Guide 1.105 Rev. 2, "Instrument Setpoints for Safety-Related Systems", dated 2/86.
10. NUREG/CR-3659 (PNL-4973), "A Mathematical Model for Assessing the Uncertainties of Instrumentation Measurements for Power and Flow of PWR Reactors", 2/85.
11. ANSI/ANS Standard 58.4-1979, "Criteria for Technical Specifications for Nuclear Power Stations".



12. ISA Standard S67.04, 1994, "Setpoints for Nuclear Safety-Related Instrumentation Used in Nuclear Power Plants".
13. Tuley, C. R., Williams T. P., "The Significance of Verifying the SAMA PMC 20.1-1973 Defined Reference Accuracy for the Westinghouse Setpoint Methodology", Instrumentation, Controls, and Automation in the Power Industry, June 1992, Vol.35, pp. 497-508.
14. Scientific Apparatus Manufacturers Association, Standard PMC 20.1, 1973, "Process Measurement and Control Terminology".
15. WCAP-11397-P-A, "Revised Thermal Design Procedure", dated April 1989.
16. Letter T. F. Plunket (FPL) to USNRC, "Proposed License Amendments - Implementation of the Revised Thermal Procedure and Steam Generator Water Level Low-Low Setpoint", L-95-131, dated May 5, 1995.

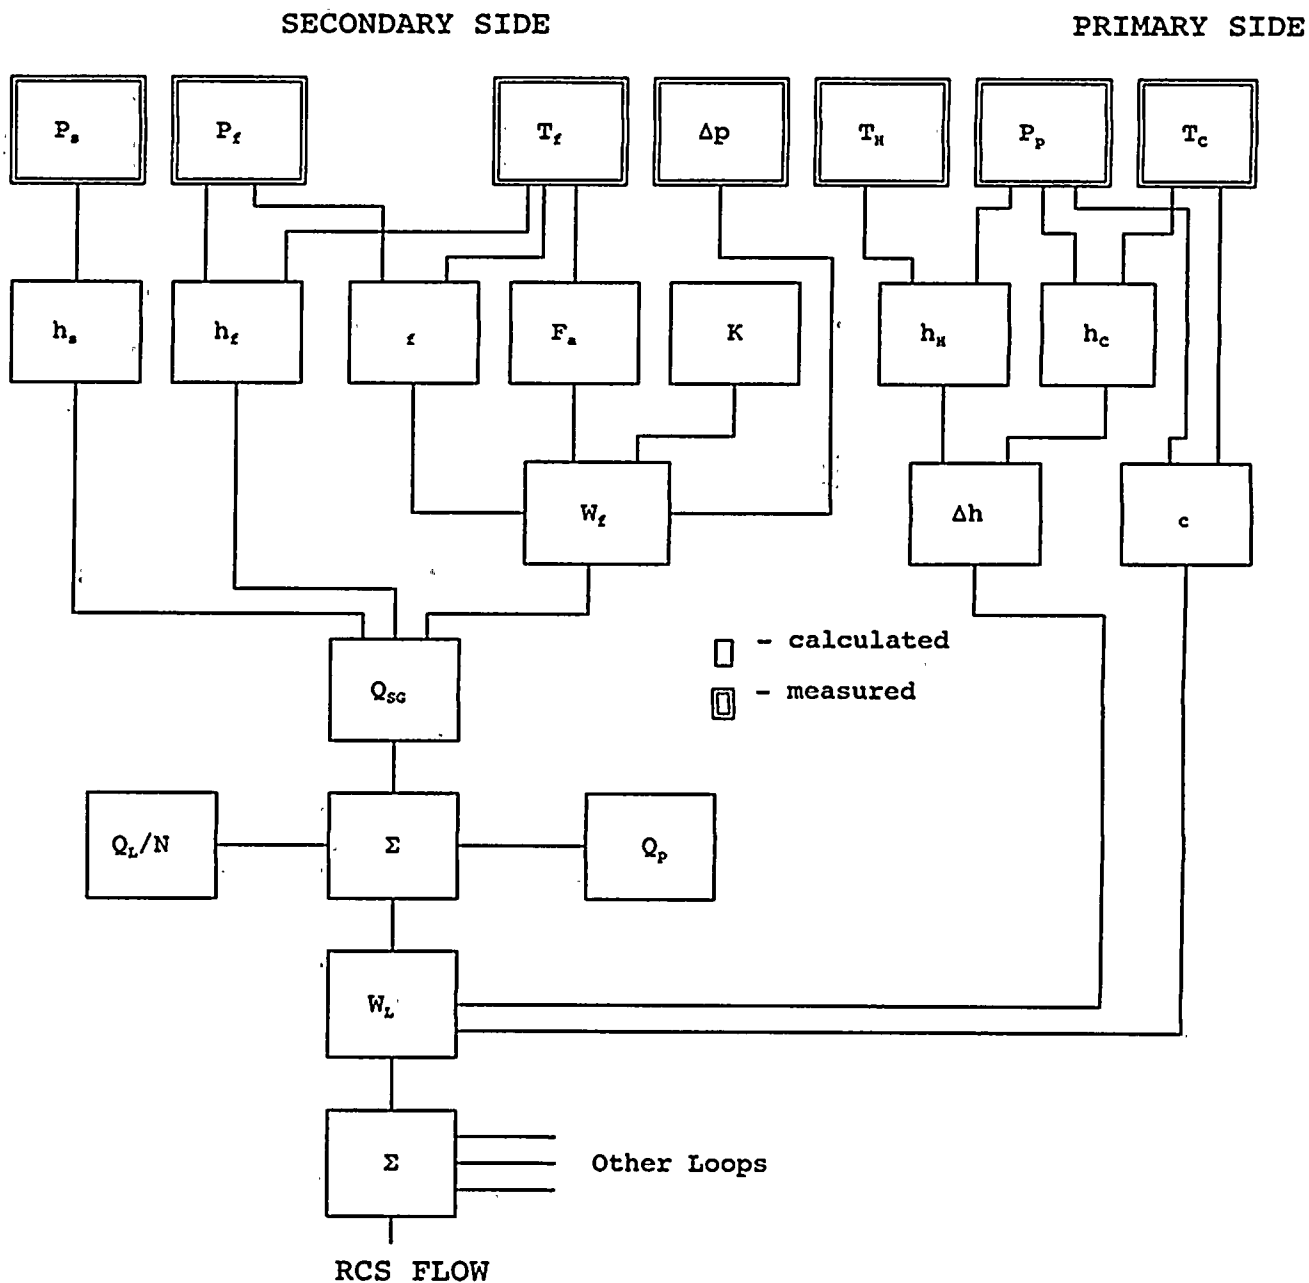


Figure 1
RCS Flow Calorimetric Schematic



SECONDARY SIDE

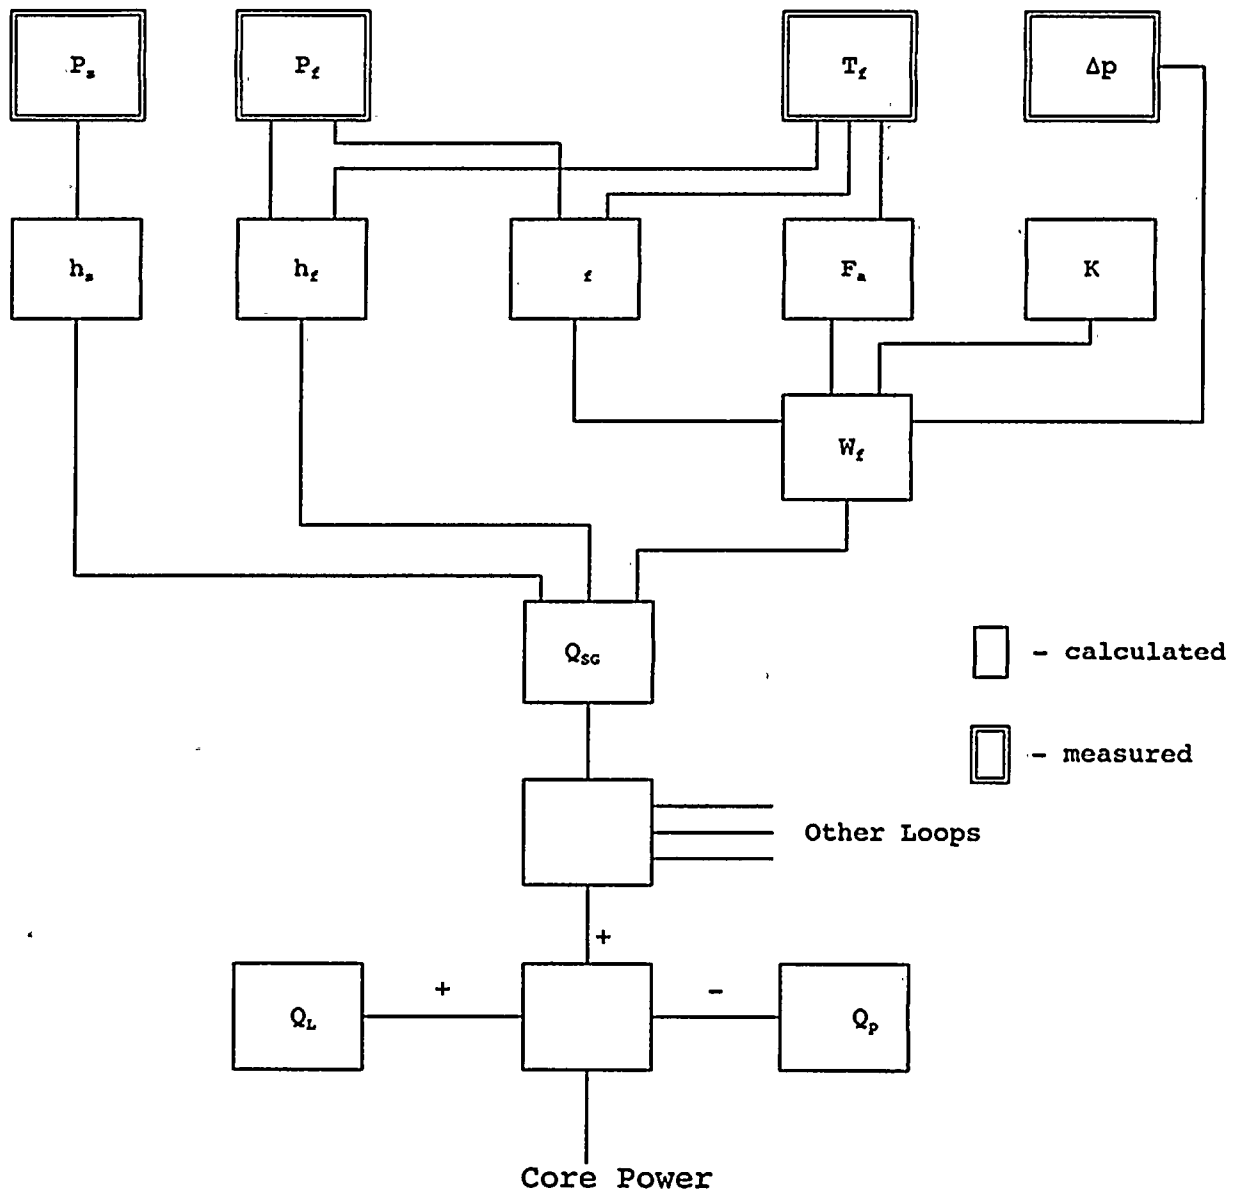


Figure 2
Power Calorimetric Schematic

