

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9802190040 DOC.DATE: 98/01/31 NOTARIZED: NO DOCKET #
FACIL:50-250 Turkey Point Plant, Unit 3, Florida Power and Light C 05000250
50-251 Turkey Point Plant, Unit 4, Florida Power and Light C 05000251
AUTH.NAME AUTHOR AFFILIATION
MOWREY,C.L. Florida Power & Light Co.
HOVEY,R.J. Florida Power & Light Co.
RECIP.NAME RECIPIENT AFFILIATION

SUBJECT: Monthly operating repts for Jan 1998 for Turkey Point, Units
3 & 4.W/980209 ltr.

DISTRIBUTION CODE: IE24D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 9
TITLE: Monthly Operating Report (per Tech Specs)

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD2-3 PD	1 1	CROTEAU, R	1 1
INTERNAL:	AEOD/SPD/RRAB	1 1	<u>FILE CENTER 01</u>	1 1
	OC/DBA/PAD	1 1	RGN2	1 1
EXTERNAL:	LITCO BRYCE, J H	1 1	NOAC	1 1
	NRC PDR	1 1		


NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS
OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL
DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 9 ENCL 9

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

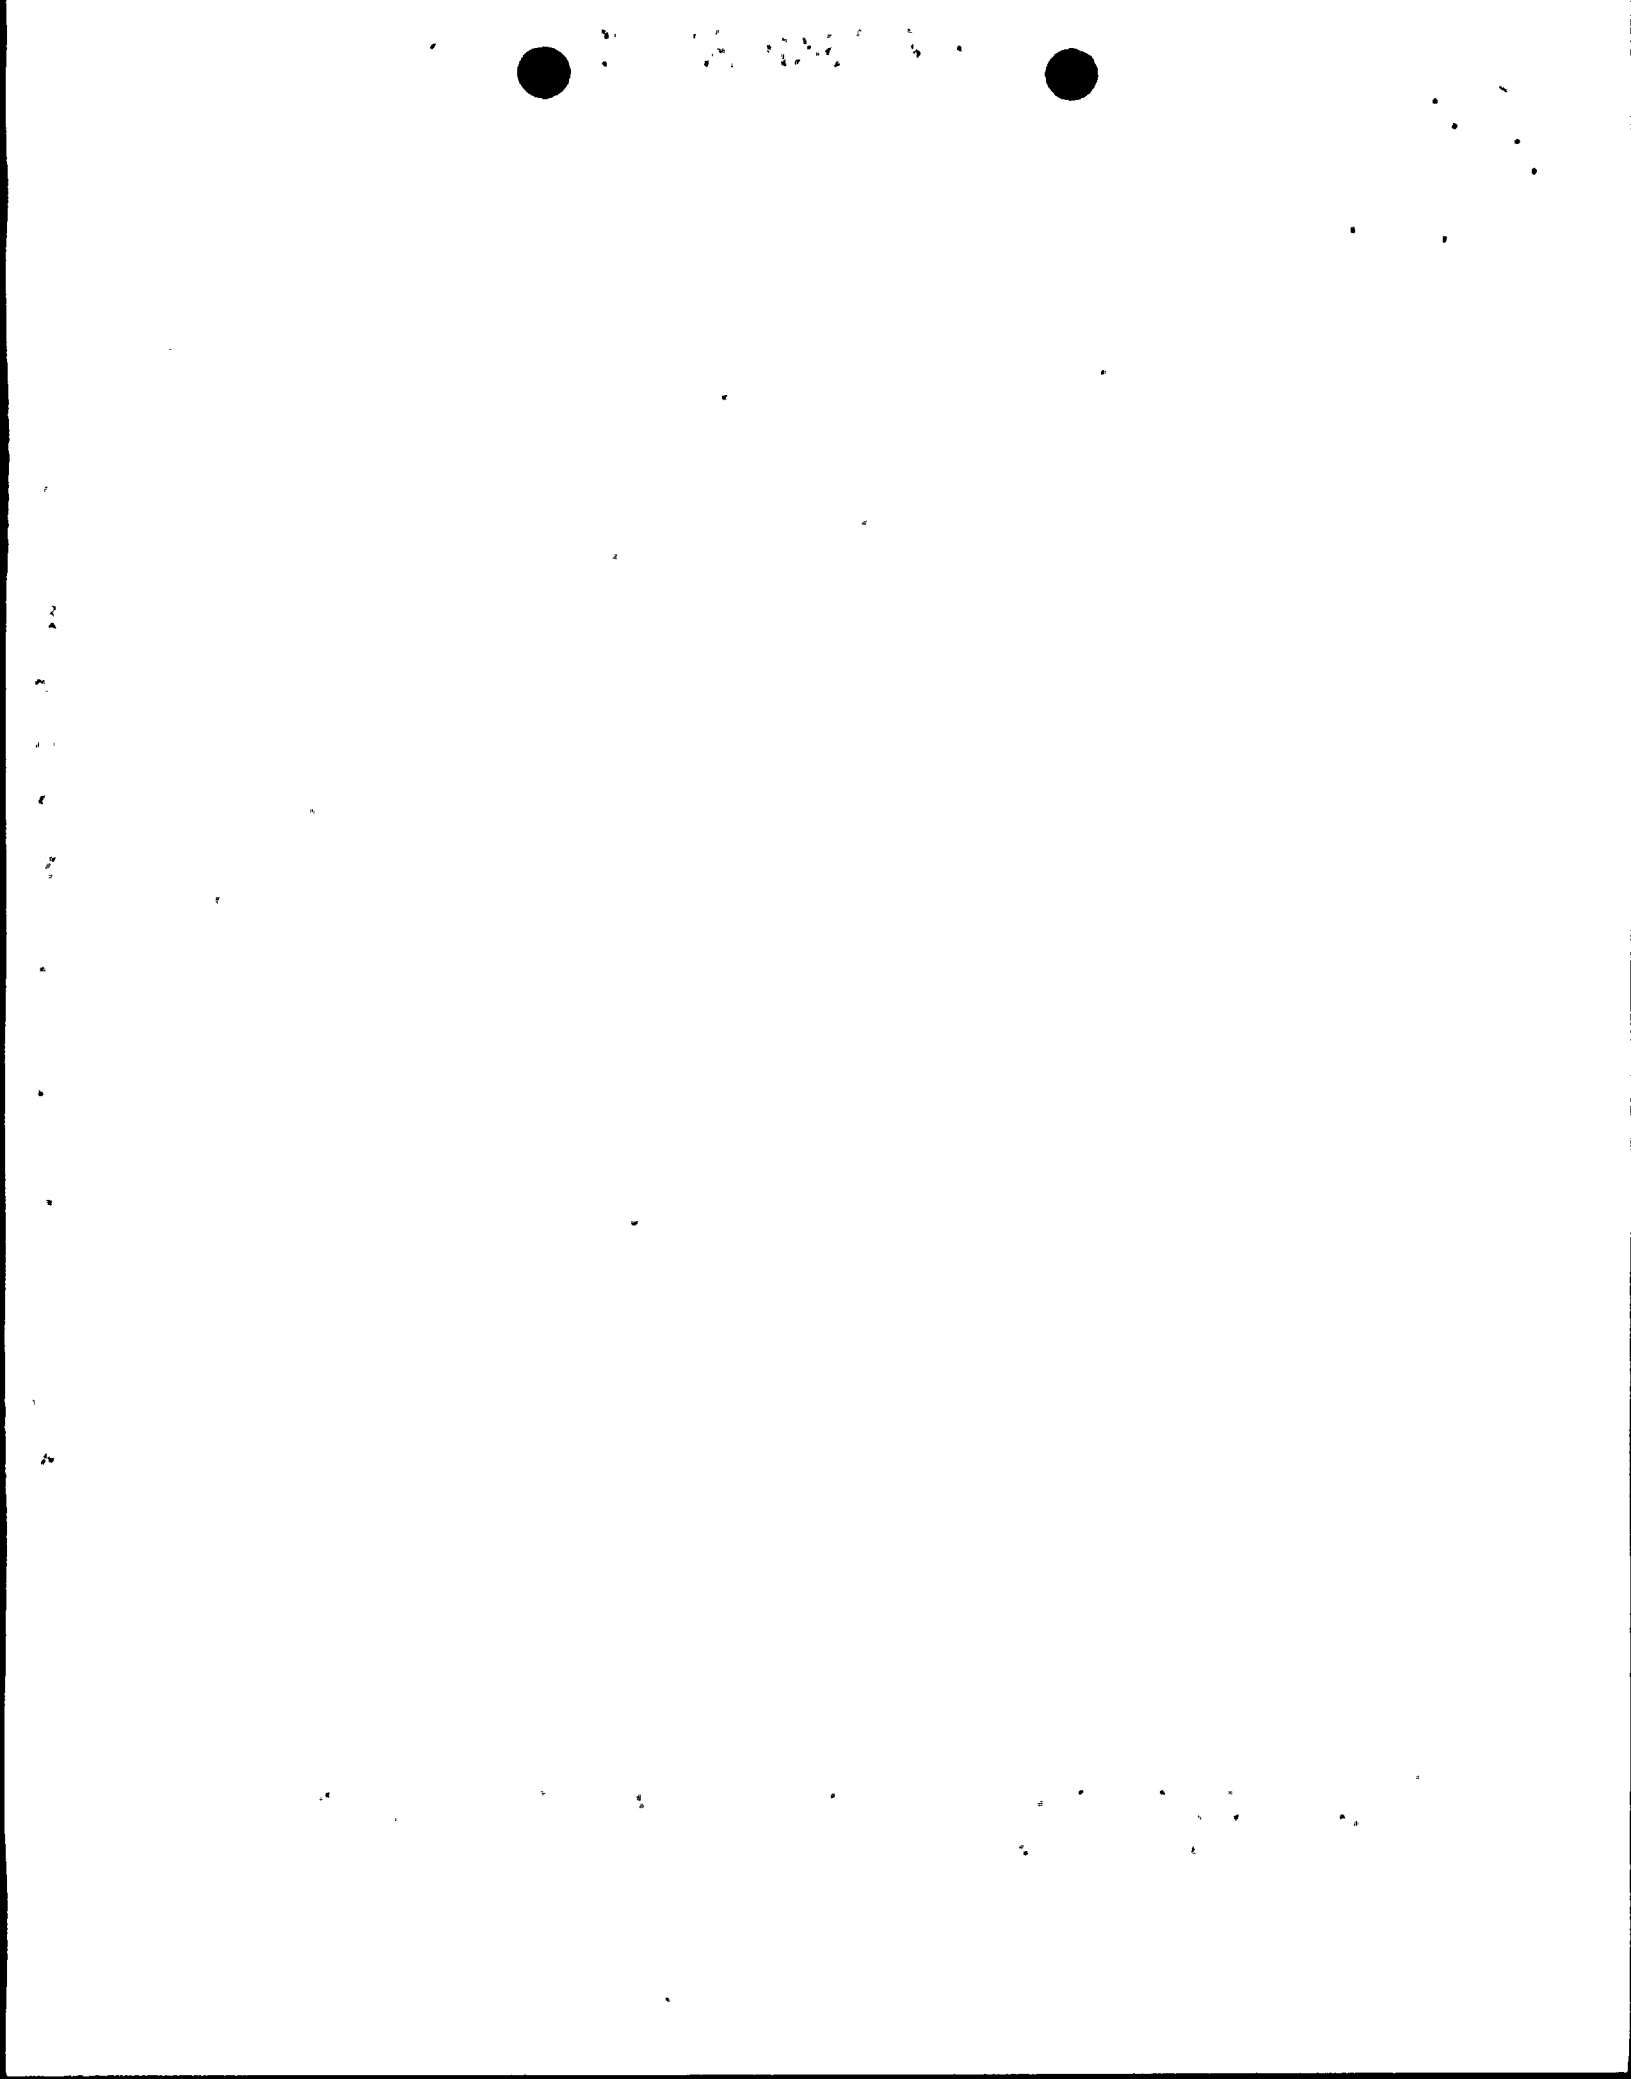



FEB 09 1998

L-98-024

10 CFR §50.36

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Re: Turkey Point Units 3 and 4
Docket Nos. 50-250 and 50-251
Monthly Operating Report

In accordance with the requirements of Turkey Point Units 3 and 4 Technical Specification 6.9.1.5, and the guidance of Generic Letter 97-02, attached are the January 1998 Operating Status and Summary of Operating Experience Reports for Turkey Point Units 3 and 4.

Very truly yours,

R. J. Hovey
Vice President
Turkey Point Plant

CLM

Attachments

cc: Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, Turkey Point Plant

9802190040 980131
PDR ADOCK 05000250
R PDR



1/1
1E24



1952

AVERAGE DAILY UNIT POWER LEVEL

DOCKET NO. 50 - 250
UNIT Turkey Point #3
DATE Feb 03, 1998
COMPLETED BY C. L. Mowrey
TELEPHONE (305) 246 - 6204

MONTH January, 1998

DAY AVERAGE DAILY POWER LEVEL
(MWe-Net)

01/01/98	736
01/02/98	737
01/03/98	734
01/04/98	730
01/05/98	725
01/06/98	723
01/07/98	721
01/08/98	718
01/09/98	717
01/10/98	720
01/11/98	728
01/12/98	728
01/13/98	725
01/14/98	724
01/15/98	725
01/16/98	724
01/17/98	731
01/18/98	731
01/19/98	730
01/20/98	727
01/21/98	723
01/22/98	721
01/23/98	722
01/24/98	720
01/25/98	728
01/26/98	730
01/27/98	728
01/28/98	731
01/29/98	730
01/30/98	728
01/31/98	731

DOCKET NO. 50-250
UNIT NAME TURKEY POINT UNIT 3
DATE February 5, 1998
COMPLETED BY C. L. Mowrey
TELEPHONE (305) 246-6204

REPORTING PERIOD January, 1998
(Month/Year)

1. Design Electrical Rating (MWe-Net) _____ 720
2. Maximum Dependable Capacity (MWe-Net) _____ 693

	<u>MONTH</u>	<u>-YTD-</u>	<u>CUMULATIVE</u>
3. Number of Hours Reactor Was Critical _____	744.0	744.0	153861.8
4. Number of Hours Generator Was On Line _____	744.0	744.0	151702.9
5. Unit Reserve Shutdown Hours _____	0.0	0.0	121.8
6. Net Electrical Energy (MWH) _____	540534.0	540534.0	96953090.0

UNIT SHUTDOWNS AND POWER REDUCTIONS

DOCKET NO. 50-250
 UNIT NAME: Turkey Point #3
 DATE: February 5, 1998
 COMPLETED BY: C. L. Mowrey
 TELEPHONE: (305) 246-6204

REPORT MONTH January 1998

No.	Date	Type ¹	Duration (Hours)	Reason ²	Method of Shutting Down Reactor ³	Cause & Corrective Action Comments
N/A						

1

F - Forced
S - Scheduled

2

Reason
 A - Equipment Failure
 B - Maintenance or Test
 C - Refueling
 D - Regulatory restriction
 E - Operator Training & License Examination
 F - Administrative
 G - Operational Error
 (Explain)
 H - Other (Explain)

3

Method
 1 - Manual
 2 - Manual Scram
 3 - Automatic Scram
 4 - Continued
 5 - Load Reduction
 9 - Other (Explain)

SUMMARY OF OPERATING EXPERIENCE

DOCKET NO. 50-250
UNIT: Turkey Point #3
DATE: February 5, 1998
COMPLETED BY: C. L. Mowrey
TELEPHONE: (305) 246-6204

REPORT MONTH January 1998

Unit 3 operated at essentially 100% power for the entire month.

AVERAGE DAILY UNIT POWER LEVEL

DOCKET NO. 50 - 251
UNIT Turkey Point #4
DATE Feb 03, 1998
COMPLETED BY C. L. Mowrey
TELEPHONE (305) 246 - 6204

MONTH January, 1998

DAY AVERAGE DAILY POWER LEVEL
(MWe-Net)

01/01/98	733
01/02/98	733
01/03/98	732
01/04/98	727
01/05/98	723
01/06/98	721
01/07/98	719
01/08/98	718
01/09/98	712
01/10/98	719
01/11/98	725
01/12/98	725
01/13/98	723
01/14/98	721
01/15/98	716
01/16/98	718
01/17/98	728
01/18/98	729
01/19/98	728
01/20/98	724
01/21/98	721
01/22/98	720
01/23/98	720
01/24/98	721
01/25/98	727
01/26/98	661
01/27/98	264
01/28/98	711
01/29/98	732
01/30/98	731
01/31/98	730

OPERATING DATA REPORT

DOCKET NO. 50-251
UNIT NAME TURKEY POINT UNIT 4
DATE February 5, 1998
COMPLETED BY C. L. Mowrey
TELEPHONE (305) 246-6204

REPORTING PERIOD January, 1998
(Month/Year)

1. Design Electrical Rating (MWe-Net)_____ 720
2. Maximum Dependable Capacity (MWe-Net)_____ 693

	<u>MONTH</u>	<u>-YTD-</u>	<u>CUMULATIVE</u>
3. Number of Hours Reactor Was Critical_____	744.0	744.0	150051.5
4. Number of Hours Generator Was On Line_____	744.0	744.0	145720.5
5. Unit Reserve Shutdown Hours_____	0.0	0.0	577.2
6. Net Electrical Energy (MWH)_____	525959.0	525959.0	94017596.0

UNIT SHUTDOWNS AND POWER REDUCTIONS

DOCKET NO. 50-251
 UNIT NAME: Turkey Point #4
 DATE: February 5, 1998
 COMPLETED BY: C. L. Mowrey
 TELEPHONE: (305) 246-6204

REPORT MONTH January 1998

No.	Date	Type ¹	Duration (Hours)	Reason ²	Method of Shutting Down Reactor ³	Cause & Corrective Action to Prevent Recurrence
1059	1/26/98	S	0.0	B	5	Turbine valve testing; #3 turbine control valve failed to close during test. Problem determined to be in the test device.

1

F - Forced
S - Scheduled

2

Reason
 A - Equipment Failure
 B - Maintenance or Test
 C - Refueling
 D - Regulatory restriction
 E - Operator Training & License Examination
 F - Administrative
 G - Operational Error (Explain)
 H - Other (Explain)

3

Method
 1 - Manual
 2 - Manual Scram
 3 - Automatic Scram
 4 - Continued
 5 - Load Reduction
 9 - Other (Explain)

SUMMARY OF OPERATING EXPERIENCE

DOCKET NO. 50-251
UNIT: Turkey Point #4
DATE: February 5, 1998
COMPLETE BY: C. L. Mowrey
TELEPHONE: (305)246-6204

REPORT MONTH January 1998

Unit 4 operated at essentially 100% power until January 26, when power was reduced for turbine valve testing. The #3 turbine control valve failed to close during the test; power was reduced further to allow repairs. Power was returned to 100% on January 28, and remained there for the rest of the month.