

6.2.3 SHIFT TECHNICAL ADVISOR

6.2.3.1 The Shift Technical Advisor shall provide advisory technical support to the Nuclear Plant Supervisor in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the unit and the opposite unit. The Shift Technical Advisor shall have a bachelor's degree or equivalent in a scientific or engineering discipline and shall have received specific training in the response and analysis of the unit for transients and accidents, and in unit design and layout, including the capabilities of instrumentation and controls in the control room.

6.3 FACILITY STAFF QUALIFICATIONS

Replace with attached INSERT

~~6.3.1 Each member of the facility staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971 for comparable positions, except for the Health Physics Supervisor who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975, and the Operations Manager whose requirement for a Senior Reactor Operator License is as stated in Specification 6.2.2.1. The licensed Operators and Senior Operators shall also meet or exceed the minimum qualifications of the supplemental requirements specified in 10 CFR Part 55 and ANSI 3.1, 1981.~~

6.3.2 When the Health Physics Supervisor does not meet the above requirements, compensatory action shall be taken which the Plant Nuclear Safety Committee determines and the NRC office of Nuclear Reactor Regulation concurs that the action meets the intent of Specification 6.3.1.

6.4 TRAINING

6.4.1 A retraining and replacement training program for the facility staff shall be maintained under the direction of the Training Manager and shall meet or exceed the requirements and recommendations of Section 5.5 of ANSI N18.1-1971, 10 CFR Part 55 and ANSI 3.1, 1981 and shall include familiarization with relevant industry operational experience.


6.4.2 A training program for the fire brigade shall be maintained under the direction of the Fire Protection Supervisor and shall meet or exceed the requirements of 10 CFR 50.48 and 10 CFR 50 Appendix R.

6.5 REVIEW AND AUDIT

6.5.1 PLANT NUCLEAR SAFETY COMMITTEE (PNSC)

FUNCTION

6.5.1.1 The PNSC shall function to advise the Plant General Manager on all matters related to nuclear safety.

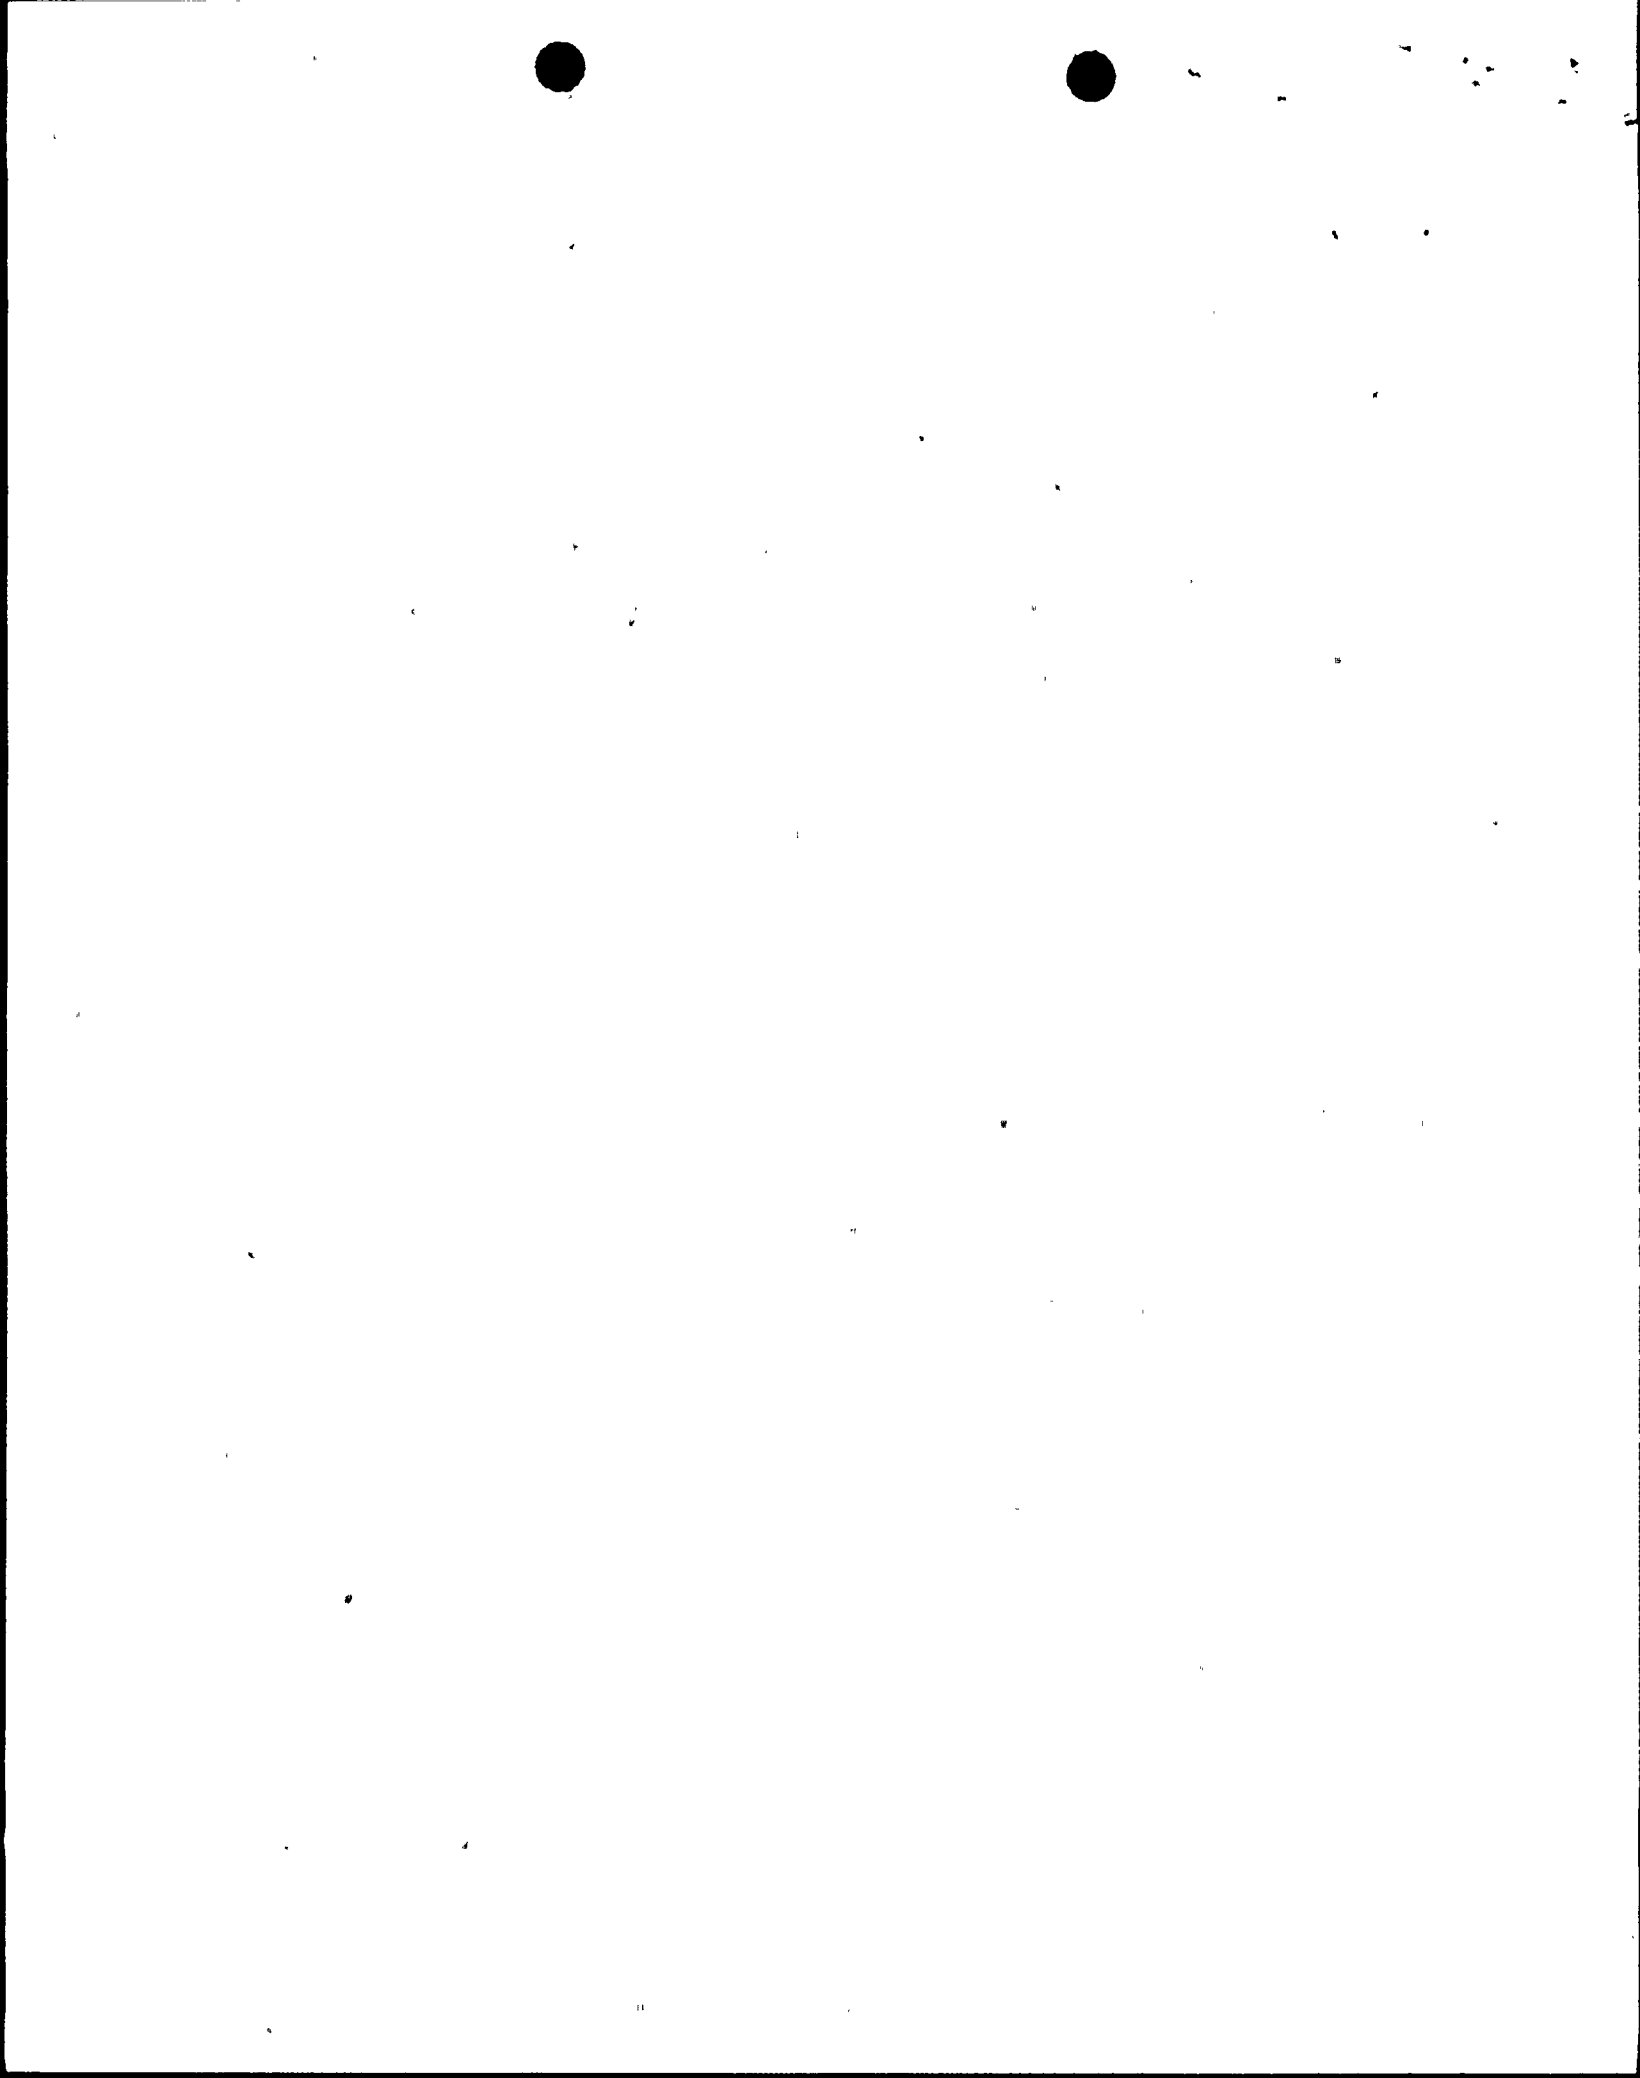

## INSERT

6.3.1 Each member of the facility staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971 for comparable positions except for

- 6.3.1.1 The Health Physics Supervisor who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975,
- 6.3.1.2 The Operations Manager whose requirement for a Senior Reactor Operator License is as stated in Specification 6.2.2.i,
- 6.3.1.3 The licensed Operators and Senior Operators who shall also meet or exceed the minimum qualifications of the supplemental requirements specified in 10 CFR Part 55 and ANSI 3.1, 1981,
- 6.3.1.4 The Multi-Discipline Supervisors who shall meet or exceed the following requirements:
  - a. Education: Minimum of a high school diploma or equivalent
  - b. Experience: Minimum of four years of related technical experience, which shall include three years power plant experience of which one year is at a nuclear power plant
  - c. Training: Complete the Multi-Discipline Supervisor training program

