

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9212290318 DOC. DATE: 92/12/23 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH. NAME AUTHOR AFFILIATION
 KEISER, H.W. Pennsylvania Power & Light Co.
 RECIPIENT AFFILIATION
 RECIP. NAME RECIPIENT AFFILIATION
 MILLER, C.L. Project Directorate I-2

SUBJECT: Provides understanding that as long as licensees retain documented technical adequacy evaluations of deviations, w/ respect to deviation from Rev 4 of BWROG EPGs, NRC approval prior to implementation not required, in ref to 921006 ltr.

DISTRIBUTION CODE: A045D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: Emergency Preparedness Plans, Implement'g Procedures, C /

NOTES: Maxwell, G 05000387 A
 Maxwell, G 05000388

	RECIPIENT		COPIES		
	ID CODE/NAME		LTR	ENCL	
	PD1-2 PD		1	1	
INTERNAL:	AEOD/DOA/IRB		1	1	
	NUDOCS-ABSTRACT		1	1	
EXTERNAL:	NRC PDR.		1	1	
NOTES:			1	1	


		RECIPIENT		COPIES	
		ID CODE/NAME		LTR	ENCL
		RALEIGH, J.		1	1
		<u>NRR/DREP/PEPB9D</u>		1	1
		<u>REG FILE</u> 01		1	1
		NSIC		1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 9 ENCL 0

MA-4

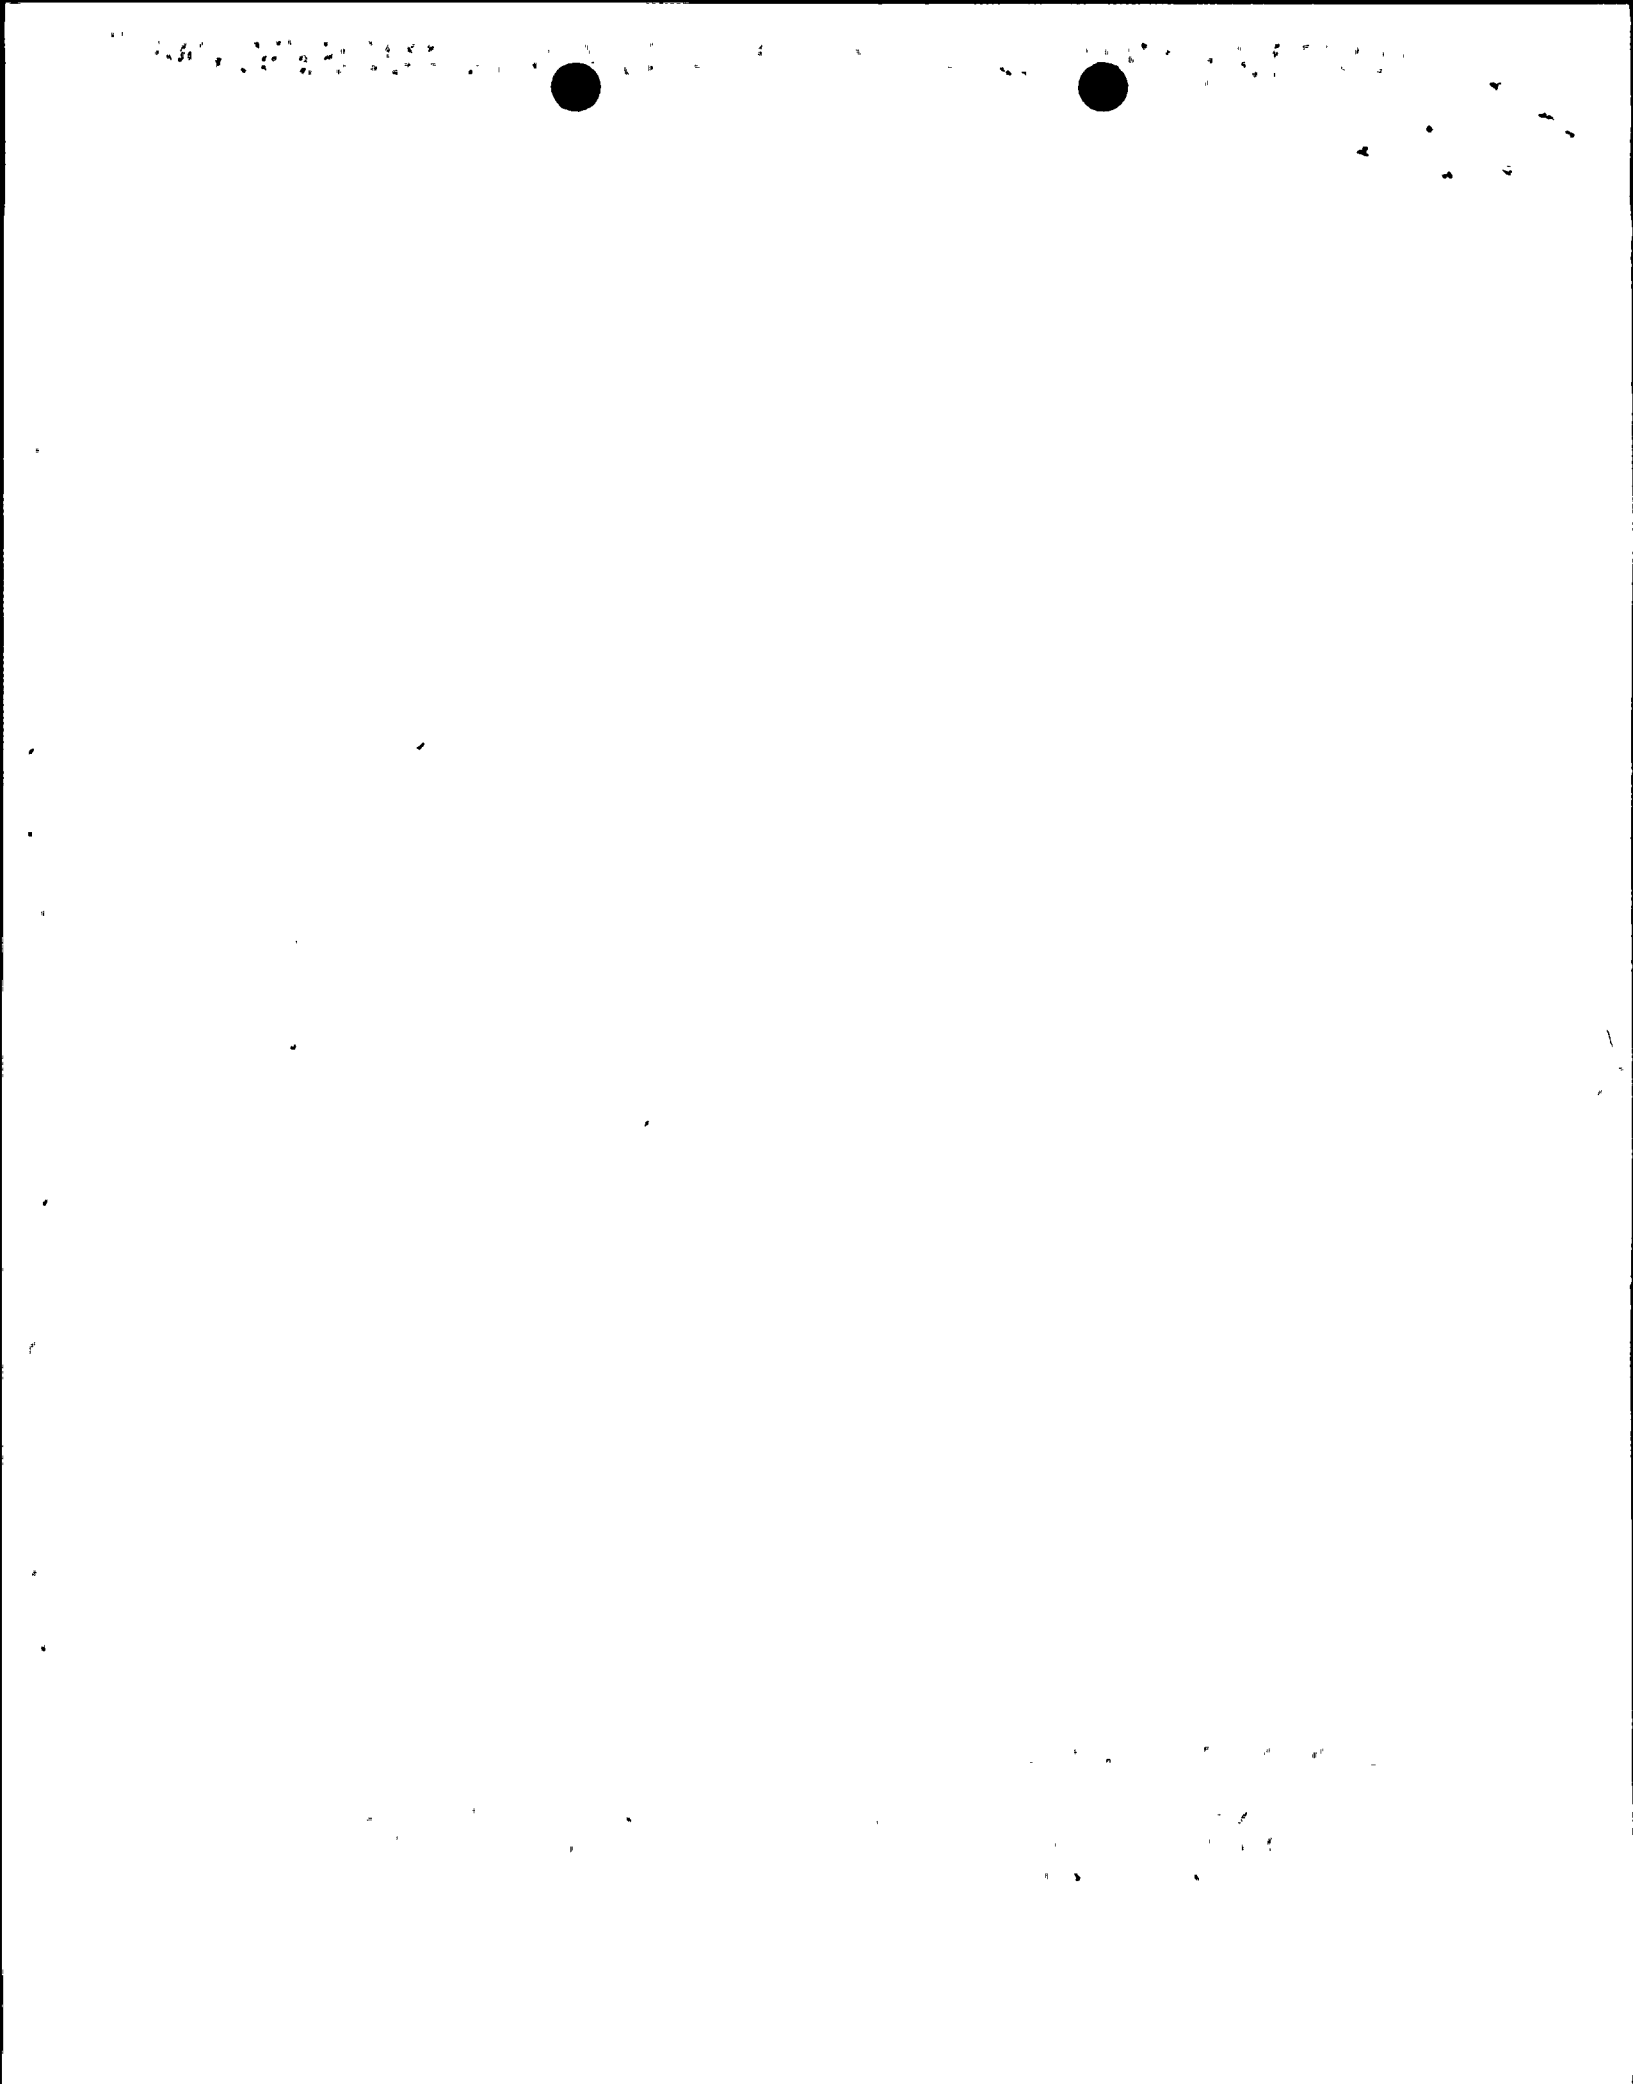



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

Harold W. Keiser
Senior Vice President-Nuclear
215/774-4194

DEC 23 1992

Director of Nuclear Reactor Regulation
Attention: Mr. C.L. Miller, Project Director
Project Directorate I-2
Division of Reactor Projects
U.S. Nuclear Regulatory Commission
Washington, DC 20555

SUSQUEHANNA STEAM ELECTRIC STATION
REVISION TO EPG DEVIATION REVIEW REQUEST
PLA-3895 **FILE R41-2**

Docket Nos. 50-387
and 50-388

Reference: PLA-3828, H.W. Keiser to C.L. Miller, "Deviation From EPG, Revision 4",
dated October 6, 1992.

Dear Mr. Miller:

The referenced letter requested your concurrence with our use of certain deviations from Revision 4 of the BWROG Emergency Procedure Guidelines (EPGs). Please be advised that our purpose was to solicit your input, should you have any, on these issues. It is our understanding that as long as licensees retain documented technical adequacy evaluations of the deviations, NRC approval prior to implementation is not required.

Very truly yours,



H.W. Keiser

cc: NRC Document Control Desk (original)
NRC Region I
Mr. G. S. Barber, NRC Sr. Resident Inspector, SSES
Mr. R. J. Clark, NRC Sr. Project Manager, OWFN

9212290318 921223
PDR ADCK 05000387
F PDR

A045/10



11-11-11

11-11-11

11-11-11

11-11-11

11-11-11