

MA/4

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8005070402 DOC. DATE: 80/04/29 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388

AUTH. NAME AUTHOR AFFILIATION
 CURTIS, N.W. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 PARR, O.O. Auxiliary Systems Branch

SUBJECT: Notifies that date & location of meeting, to resolve open items in FSAR Sections 3, 6, 10, will be provided by 800515. Agenda will be provided by 800615.

DISTRIBUTION CODE: 8001B COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: SEND I & E 3 CYS FSAR & ALL AMDTS.

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID	CODE/NAME	LTR	ENCL		ID	CODE/NAME	LTR	ENCL
ACTION:	05 PM	MINER	1	1	AD	LWR	1	0	
	BC	LWR #3	1	0	LA	LWR #3	1	0	
INTERNAL:	01	REG FILE	1	1	02	NRC PDR	1	1	
	06	I & E	3	3	08	OPERA LIC BR	1	1	
	09	GEOSCIEN BR	4	4	10	QAB	1	1	
	11	MECH ENG BR	1	1	12	STRUC ENG BR	1	1	
	13	MATL ENG BR	2	2	15	REAC SYS BR	1	1	
	16	ANALYSIS BR	1	1	17	CORE PERF BR	1	1	
	18	AUX SYS BR	1	1	19	CONTAIN SYS	1	1	
	20	I & C SYS BR	1	1	21	POWER SYS BR	1	1	
	22	AD SITE TECH	1	0	26	ACCDNT ANLYS	1	1	
	27	EFFL TRT SYS	1	1	28	RAD ASMT BR	1	1	
	29	KIRKWOOD	1	1		AD FOR ENG	1	0	
		AD PLANT SYS	1	1		AD REAC SAFETY	1	0	
		AD SITE ANLYSIS	1	1		DIRECTOR NRR	1	0	
		HYDRO-METEOR BR	2	2		MPA	1	0	
		OELD	1	0					
EXTERNAL:	03	LPDR	1	1	04	NSIC	1	1	
	30	ACRS	10	10					

Ltr
 MOORE
 EPB # 2 BC
 S. BAJWA
 EPB # 2 LA

MAY 8 1980



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

388/MA/4

April 25, 1980

ALL POWER REACTOR LICENSEES

Gentlemen:


SUBJECT: CLARIFICATION OF NRC REQUIREMENTS FOR EMERGENCY RESPONSE
FACILITIES AT EACH SITE

Over the past several months the NRC staff has been conducting reviews of each licensee's proposal to upgrade their plant to cope with emergencies. The lessons learned and emergency planning review teams have identified areas where clarification of the NRC position is necessary. Our previous requirements for the TSC have been modified to allow an onsite TSC in close proximity to the control room that would not meet the habitability requirements, provided that a backup, habitable TSC is located near the site.


It is the purpose of this letter to set forth clarification of NRR's requirements for the three emergency response facilities defined in my September 13, 1979 letter to "All Operating Nuclear Power Plants". Additional specific criteria for these facilities is under development. The schedule for implementing these requirements has not changed.

If you have any questions regarding this clarification, please contact the NRC Project Manager for your facility.


Sincerely,

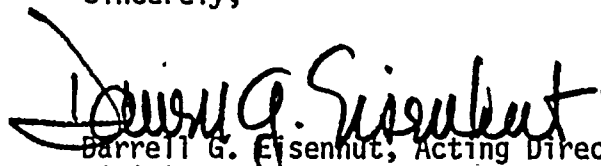
Barrell G. Eisenhut, Acting Director
Division of Operating Reactors
Office of Nuclear Reactor Regulation

Enclosure:
Emergency Response
Facilities



EMERGENCY RESPONSE FACILITIES

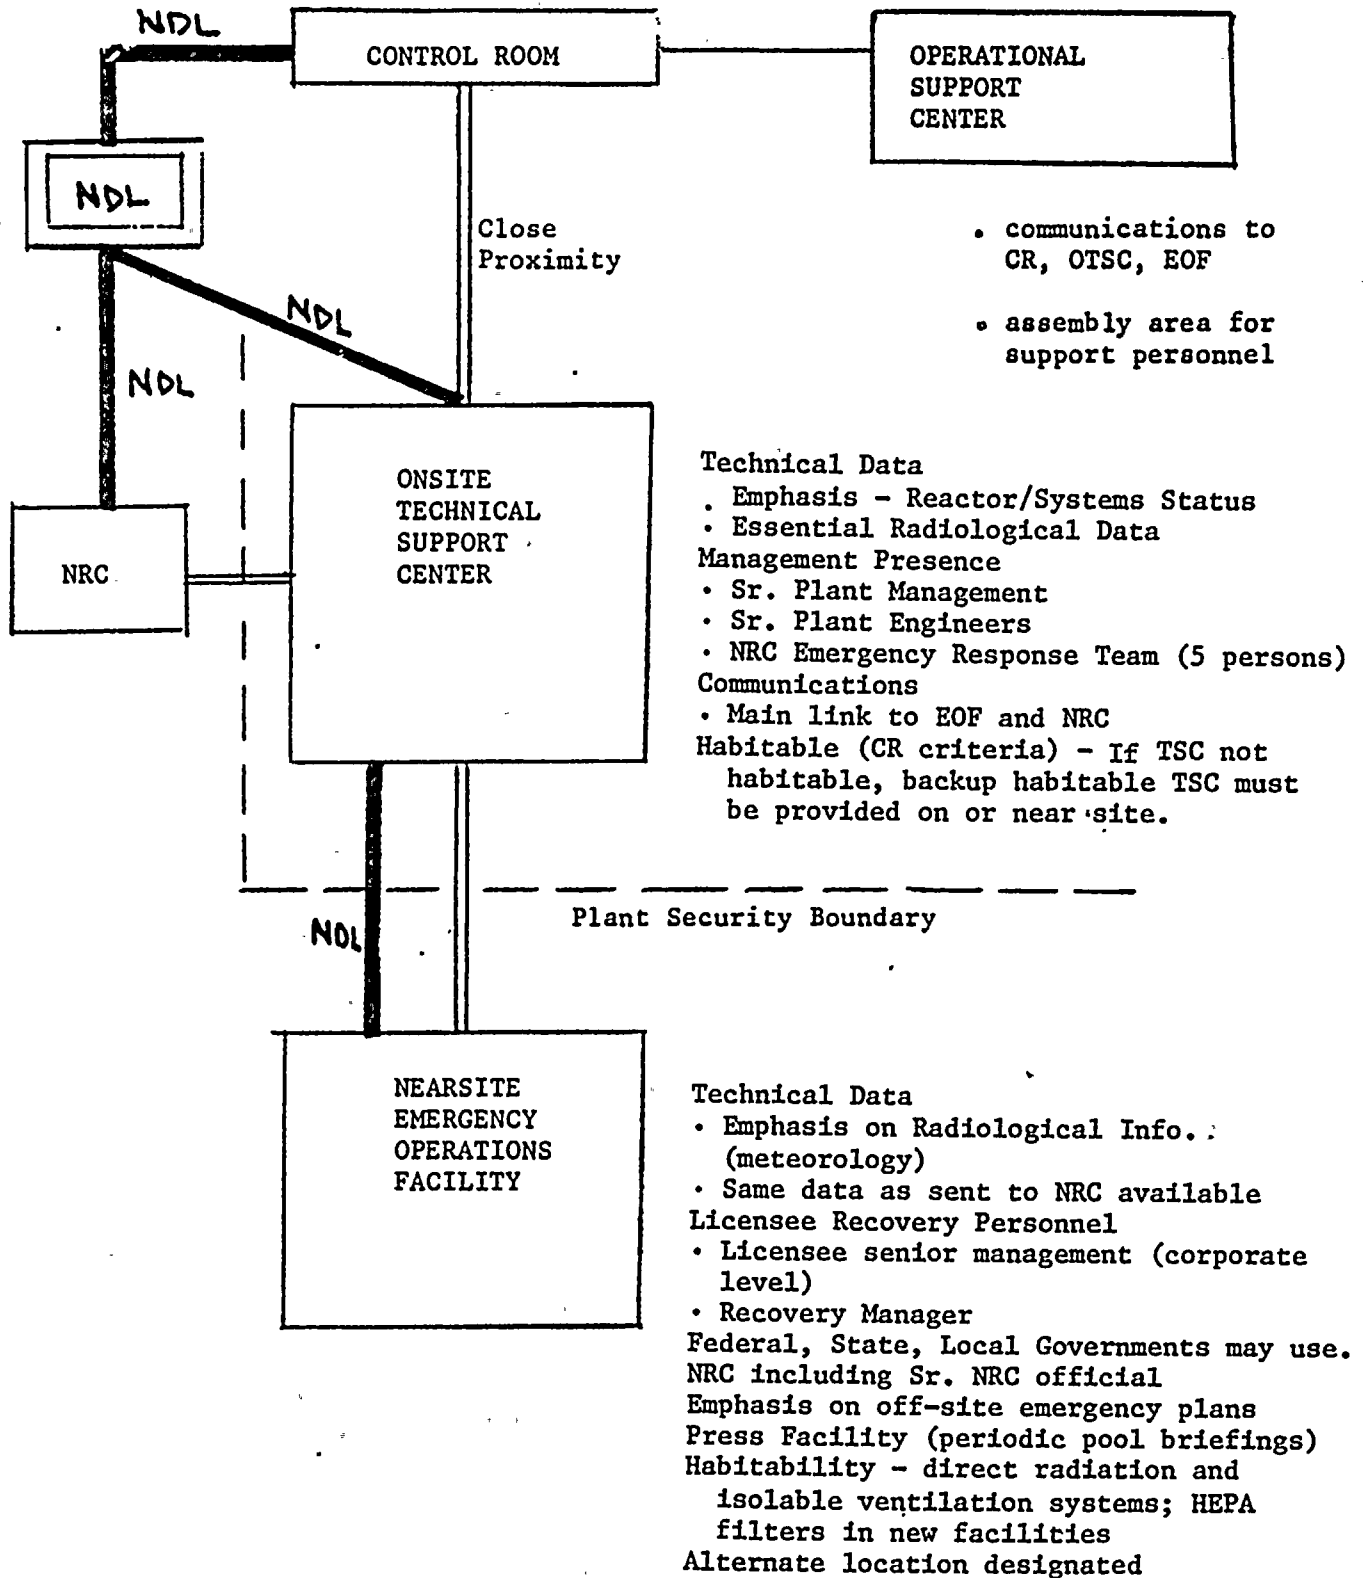

EMERGENCY RESPONSE FACILITIES

Onsite Technical Support Center

An onsite technical support center (TSC) shall be maintained by each operating nuclear power plant. The TSC shall be separate from, but in very close proximity to, the control room and be within the plant security boundary. While care must be taken in selecting technical input available in the TSC, it appears likely that access to additional control room data would be required during an emergency. The location of the TSC shall also be such as to facilitate occasional face-to-face contact between key control room and TSC supervisors (management presence). The emphasis in designing the TSC information displays should be on reactor systems status. Those individuals who are knowledgeable of and responsible for engineering and management support of reactor operations in the event of an accident will report to the TSC (minimum size 25 persons including 5 NRC). Those persons who are responsible for the overall management of the utility resources including recovery following an accident (e.g., corporate managers) should report to the EOF (see below). Upon activation, the TSC will provide the main communication link between the plant and the operator's near-site Emergency Operations Facility, and the main communication link to the NRC for plant operations matters. The TSC must be habitable to the same degree as the control room for postulated accidents (SRP 6.4 as revised by NUREG-0660). Where the primary, in-plant, TSC is not made habitable because of site-specific considerations, a backup TSC which does meet the habitability requirements must be provided on or near the site. Parameters transmitted by any nuclear data link installed to meet future NRC requirements should be available for display in the TSC and the EOF.

Onsite Operational Support Center (Assembly Area)

The Operational Support Center shall be the place to which the operations support personnel report in an emergency situation. Communications will be provided with the control room, OTSC and EOF.

Emergency Operations Facility (Near-Site)

The Emergency Operations Facility (EOF) will be operated by the licensee for continued evaluation and coordination of licensee activities related to an emergency having or potentially having environmental consequences. The EOF must have the capability to display the same plant data and radiological information as will be required for transmittal to the NRC. The EOF will have sufficient space to accommodate representatives from Federal, State and local governments if desired by those agencies, including facilities for the senior NRC representative (10) on-site. In addition, the major State and local response agencies may perform data analysis jointly with the licensee. Overall management of utility resources including recovery operations following an accident (e.g., by corporate management) shall be managed from this facility. Press facilities for about 20 people shall be available at the Emergency Operations Facility (periodic use). Site meteorology should be used to the extent practical for determining the EOF location. The EOF should be located within about one mile of the reactor. The EOF should be a substantial structure, providing significant shielding factors from direct radiation and the capability to isolate ventilation systems. Filtration systems (at least HEPA filters) shall be provided in new structures. Arrangements shall be made to activate an alternate EOF in the event that the nearsite EOF becomes uninhabitable.

Emergency Response Facilities

Center	Location	Activation Required?	Occupants			Function	Data Display	Habitability	Back-up if Not Habitable
			In Charge	Number	Skills				
Existing Control Room Upgraded Control Room	In Plant	No	Shift Supervisor or Senior Plant Official	Utility - Variable NRC (1)	Operational & Technical	Plant Control		Wide Accident Spectrum (SRP 6.4 with NUREG-0660)	-
Interim Technical Support Center (TSC) (by 1/1/81)	Should be near Control Room	Yes	Senior Plant Official	Utility - Variable NRC (5)	Engineering & Senior Plant Management	Emergency Engineering Support for Control Room	Direct Display or Call-up of Plant Parameters Necessary for Assessment	No Requirement	Control Room
Permanent TSC (by 1/1/81)	Must be in very close proximity to Control Room	Yes, for Alert, Site Emergency or General Emergency Class	Senior Plant Official	25 (5 NRC)	Engineering & Senior Plant Management	Accident Assessment by Operations Engineers; Support to Control Room during Accidents	Direct Display of plant safety system parameters, call-up display of radiological parameters	Either TSC or backup must be same as Control Room Except for System Redundancy	Habitable TSC near site if primary TSC not habitable
Emergency Operations Facility (EOF)	Near Site (within about 1 mile)	Yes, for Alert, Site Emergency or General Emergency Class	Senior Plant or Corporate Official	10 NRC, including Regional Director, 20 utility including radiological accident assessment and Corporate management, 5 State and local. (periodic)	Corporate Management, Radiological Accident Assessment	1. Overall Management of Utility Resources 2. Analysis of Plant effluents met; offsite monitoring for offsite action decisions 3. Briefing location for offsite officials and press pools.	Direct display of radiological and meteorological parameters. At least that provided to NRC	Shielding against direct radiation & ventilation isolation capability	Alternate EOF required away from site; no habitability requirements for alternate