

B 07/20/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL 50-220

REC: GRIER B H
NRC

ORG: SCHNEIDER R R
NIAGARA MOHAWK PWR

DOC DATE: 07/13/78
DATE RCVD: 07/17/78

DOCTYPE: LETTER NOTARIZED: NO
SUBJECT:

COPIES RECEIVED
LTR 1 ENCL 1

LICENSEE EVENT REPT #78-025 ON 6/24/78 CONCERNING RE04D FOUND WITH A SETPOINT OF 3.70 PSIG WHILE THE TECH SPECS REQUIRE THE DRYWELL HIGH PRESSURE SWITCHES TO HAVE A SETPOINT OF 3.50 PSIG. W/ATT LER 78-026 & LER 78-027

PLANT NAME: NINE MILE PT - UNIT 1

REVIEWER INITIAL: XRS
DISTRIBUTOR INITIAL: *W*

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

INCIDENT REPORTS
(DISTRIBUTION CODE A002)

FOR ACTION: BR CHIEF ORB#3 BC**W/4 ENCL

INTERNAL:

REG FILE**W/ENCL
I & E**W/2 ENCL
I & C SYSTEMS BR**W/ENCL
NOVAK/CHECK**W/ENCL
AD FOR ENG**W/ENCL
HANAUER**W/ENCL
AD FOR SYS & PROJ**W/ENCL
ENGINEERING BR**W/ENCL
KREGER/J. COLLINS**W/ENCL
K SEYFRIT/IE**W/ENCL

NRC PDR**W/ENCL
MIPC**W/3 ENCL
EMERGENCY PLAN BR**W/ENCL
EEB**W/ENCL
PLANT SYSTEMS BR**W/ENCL
AD FOR PLANT SYSTEMS**W/ENCL
REACTOR SAFETY BR**W/ENCL
VOLLMER/BUNCH**W/ENCL
POWER SYS BR**W/ENCL

EXTERNAL:

LPDR'S
OSWEGO, NY**W/ENCL
TIC, LIZ CARTER**W/ENCL
NSIC**W/ENCL
ACRS CAT B**W/16 ENCL


A104

DISTRIBUTION: LTR 45 ENCL 45
SIZE: 1P+3P

CONTROL NBR: 782000096

***** THE END *****

CP

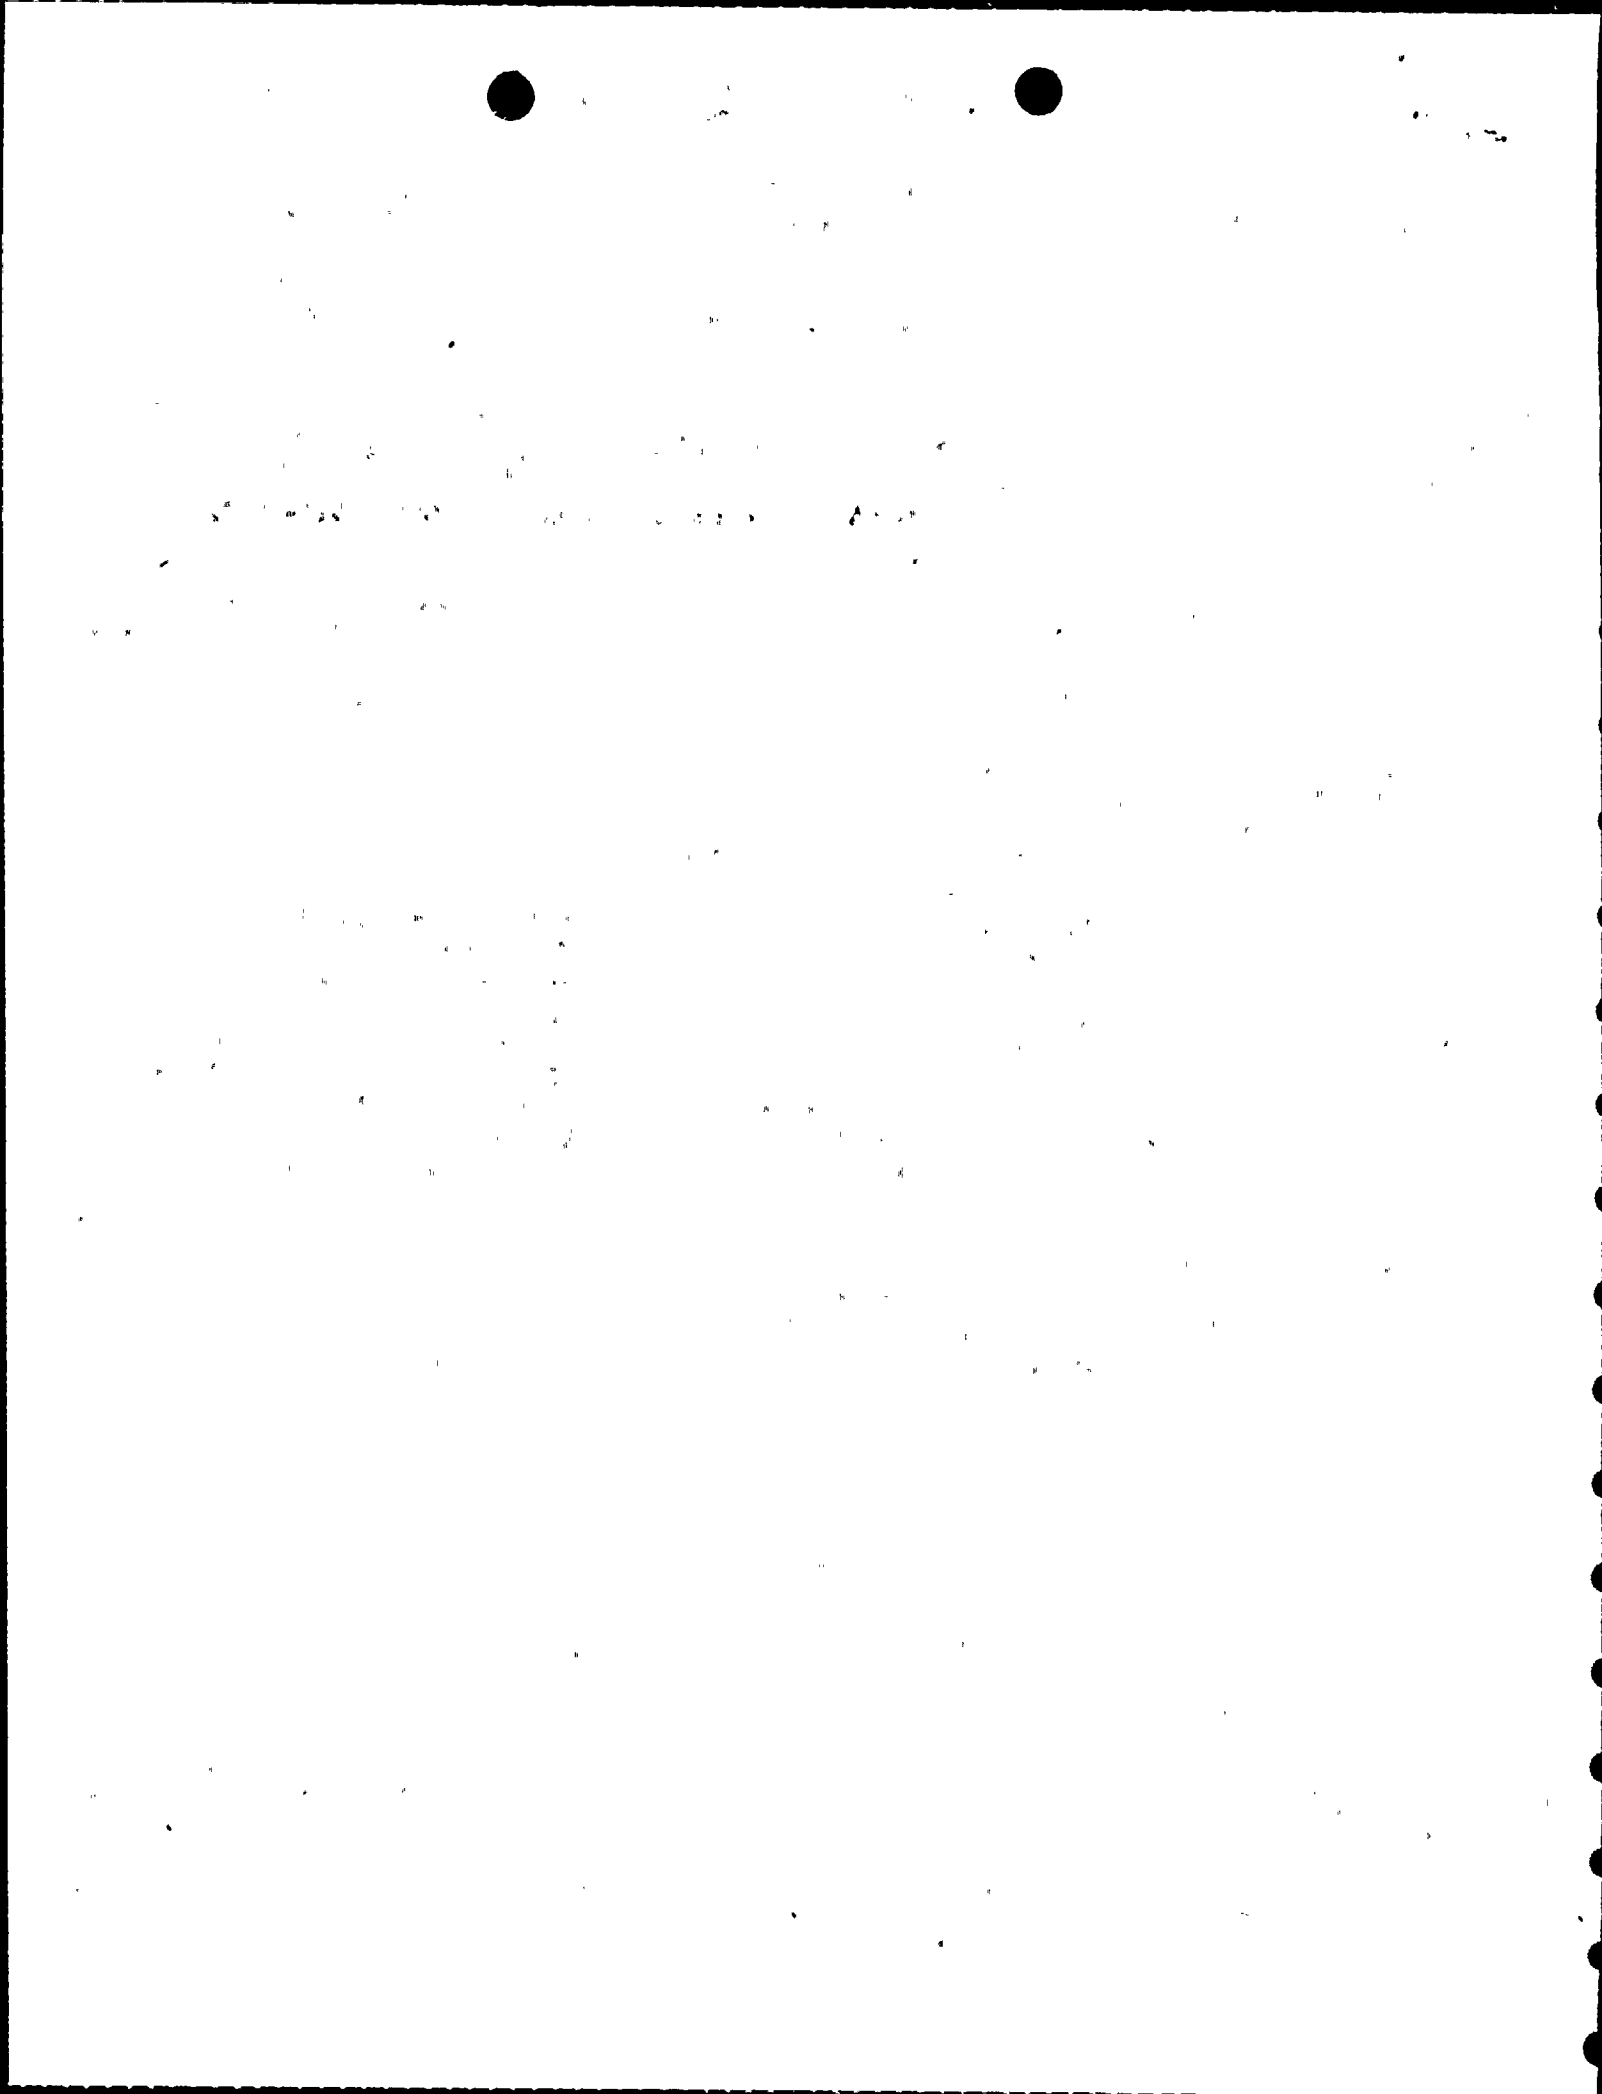

July 13, 1978

REC'D JUL 17 11 11 AM
COMMUNICATIONS SERVICES

Mr. Boyce H. Grier
Director
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, PA. 19406

RE: Docket No. 50-220

Dear Mr. Grier:

In accordance with Nine Mile Point Nuclear Station Unit #1
Technical Specifications, we hereby submit Licensee Event Reports:

LER 78-25 which is in violation of Section 3.6.2a of
the Technical Specifications

LER 78-26 in accordance with Section 6.9.2 of the
Technical Specifications

LER 78-27 which is in violation of Section 3.6.2b of
the Technical Specifications.

These reports were completed in the format designated in
NUREG-0161, dated July 1977.

Very truly yours,

ORIGINAL SIGNED BY R.R. SCHNEIDER

R.R. Schneider
Vice President -
Electric Production

mtm

Attachments (3 copies each)

cc: Director, Office of I&E (30 copies)
Director, Office of MIPC (3 copies)

REGULATORY DOCKET FILE COPY

782000096

A002
5/11



Small, illegible marks or characters in the top right corner.

Faint, illegible marks on the right side of the page.

Faint, illegible marks on the right side of the page.

Faint, illegible marks in the center of the page.

A single small mark or character near the bottom center.



10

10

10

10

10

10

10

10

10

10

10

10



7
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100