

Q 04/05/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)  
DISTRIBUTION FOR INCOMING MATERIAL

50-220

REC: GRIER B H  
NRC

ORG: SCHNEIDER R R  
NIAGARA MOHAWK PWR

DOC DATE: 03/28/78  
DATE RCVD: 04/03/78

DOCTYPE: LETTER NOTARIZED: NO  
SUBJECT:

COPIES RECEIVED  
LTR 1 ENCL 1

LICENSEE EVENT REPT (RO 50-220/78-14) ON 03/07/78 CONCERNING PERFORMANCE OF SURVEILLANCE TEST N1-ST-M4 FOUND THAT THE FUEL TRANSFER PUMP ON 102 D/G WOULD NOT FILL THE DAY TANK, DUE TO FOOT VALVE UNSEATED DURING ATTEMPT TO SAMPLE FUEL OIL... W/ATT LER 78-14

PLANT NAME: NINE MILE PT - UNIT 1

REVIEWER INITIAL: XJM  
DISTRIBUTOR INITIAL:

\*\*\*\*\* DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS \*\*\*\*\*

INCIDENT REPORTS  
(DISTRIBUTION CODE A002)

FOR ACTION: BR CHIEF LEAR\*\*W/4 ENCL

INTERNAL: REG FILE\*\*W/ENCL  
I & E\*\*W/2 ENCL  
SCHROEDER/IPPOLITO\*\*W/ENCL  
NOVAK/CHECK\*\*W/ENCL  
KNIGHT\*\*W/ENCL  
HANAUER\*\*W/ENCL  
EISENHUT\*\*W/ENCL  
SHAO\*\*W/ENCL  
KREGER/J. COLLINS\*\*W/ENCL  
K SEYFRIT/IE\*\*W/ENCL

NRC PDR\*\*W/ENCL  
MIPC\*\*W/3 ENCL  
HOUSTON\*\*W/ENCL  
GRIMES\*\*W/ENCL  
BUTLER\*\*W/ENCL  
TEDESCO\*\*W/ENCL  
BAER\*\*W/ENCL  
VOLLMER/BUNCH\*\*W/ENCL  
ROSA\*\*W/ENCL

EXTERNAL: LPDR'S  
OSWEGO, NY\*\*W/ENCL  
TIC\*\*W/ENCL  
NSIC\*\*W/ENCL  
ACRS CAT B\*\*W/16 ENCL


COPIES NOT SUBMITTED PER  
REGULATORY GUIDE 10.1

DISTRIBUTION: LTR 45 ENCL 45  
SIZE: 1P+1P+1P

CONTROL NBR: 780950026

\*\*\*\*\* THE END \*\*\*\*\*

J

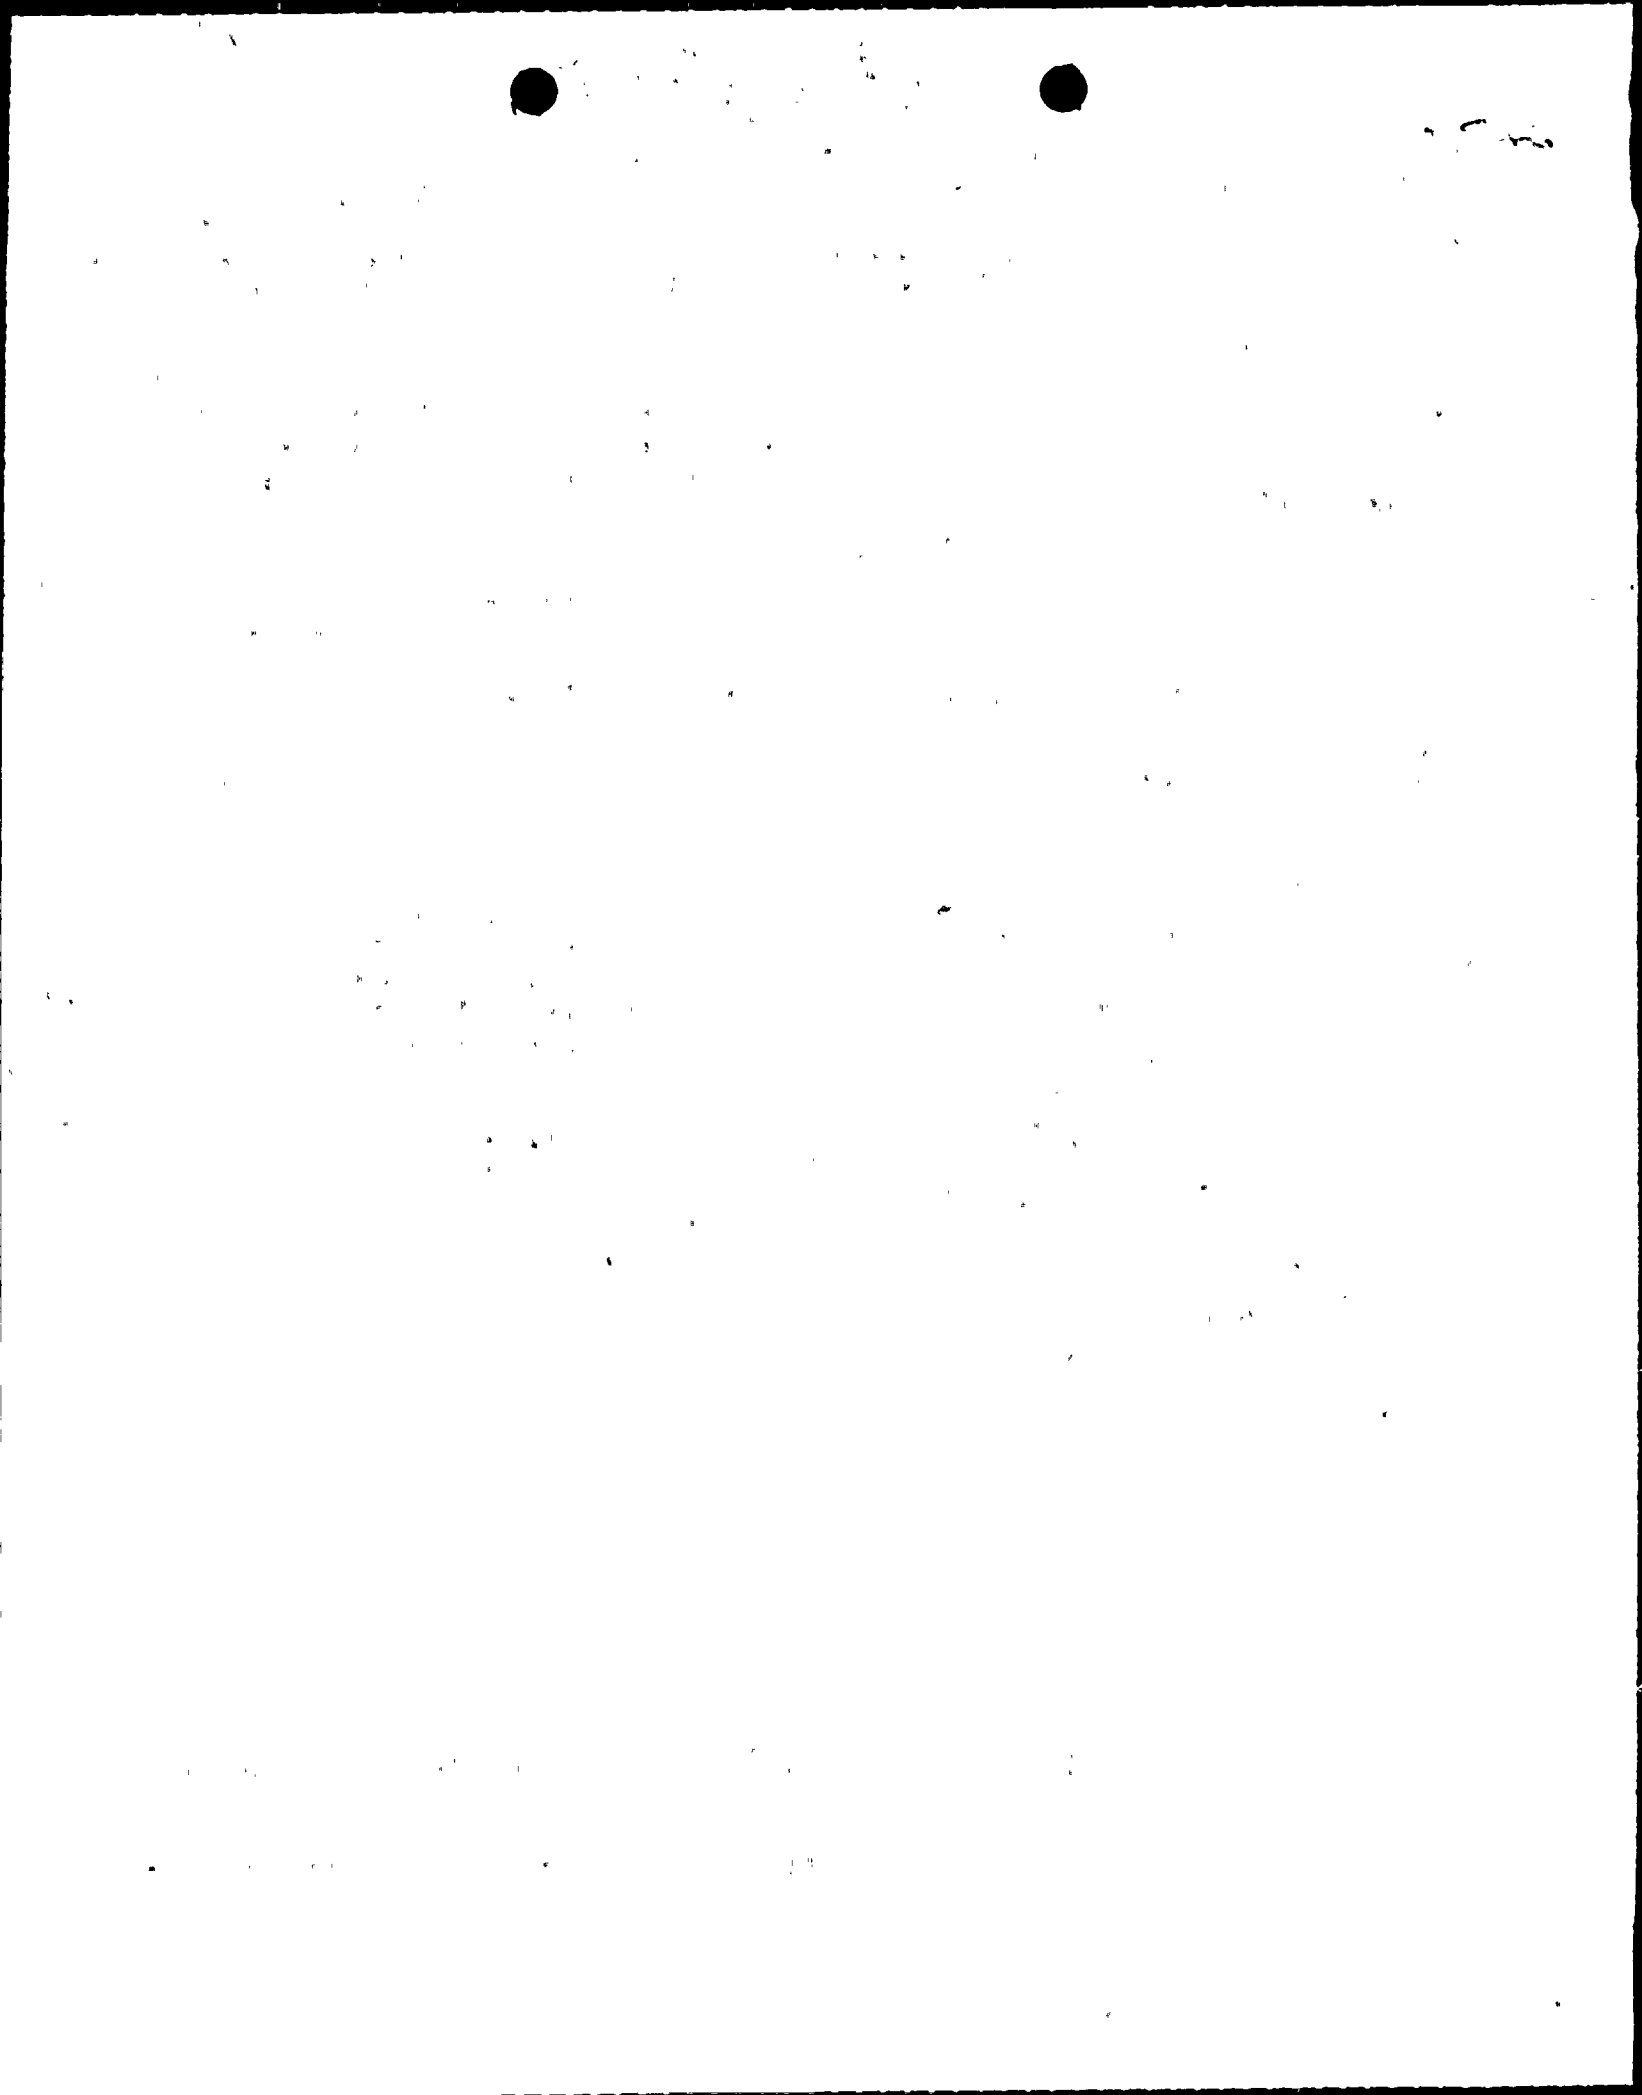

NEW YORK  
COMMUNICATIONS

NMP-0140

NIAGARA MOHAWK POWER CORPORATION/300 ERIE BOULEVARD WEST, SYRACUSE, N.Y. 13202/TELEPHONE (315) 474-1511

March 28, 1978

US NRC  
DISTRIBUTION SERVICES  
BRANCH

1978 APR 3 PM 3 30

RECEIVED DISTRIBUTION  
SERVICES UNIT

Mr. Boyce H. Grier  
Director  
United States Nuclear Regulatory Commission  
Region I  
631 Park Avenue  
King of Prussia, PA. 19406

RE: Docket No. 50-220

Dear Mr. Grier:

In accordance with Nine Mile Point Nuclear Station Unit #1 Technical Specifications, we hereby submit Licensee Event Reports, LER 78-14, which is in violation of Section 3.6.3, and LER 78-15, which is in violation of Section 3.4.5, of the Technical Specifications.

These reports were completed in the format designated in NUREG-0161, dated July 1977.

Very truly yours,

ORIGINAL SIGNED BY R.R. SCHNEIDER

R.R. Schneider  
Vice President -  
Electric Production

mtm

Enclosure (3 copies)

xc: Director, Office of I&E (30 copies)  
Director, Office of MIPC (3 copies)

780950026

1002  
S  
111

100-100000

100

100

100

100





11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100





Handwritten scribbles or marks in the top right corner.