

B 07/10/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS) 387/388
DISTRIBUTION FOR INCOMING MATERIAL 50-222/297

REC: GRIER B H
NRC

ORG: CURTIS N W
PA PWR & LIGHT

DOC DATE: 07/05/78
DATE RCVD: 07/10/78

DOCTYPE: LETTER NOTARIZED: NO

COPIES RECEIVED
LTR 1 ENCL 0

SUBJECT: INFORMING OF NEW DATE, 09/29/78 FOR SUBMITTAL OF UPDATE OF INTERIM REPT OF REPORTABLE DEFICIENCY RE SPOT WELDING OF STRUT MATERIAL.

PLANT NAME: SUSQUEHANNA - UNIT 2 ^{UNIT 1} ✓
~~WPPSS UNIT 2~~

REVIEWER INITIAL: XJM
DISTRIBUTER INITIAL: *[Signature]*

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

NOTES:
SEND I&E 3CYS FSAR & ALL AMDTS

CONSTRUCTION DEFICIENCY REPORT (10CFR50.55E)
(DISTRIBUTION CODE B019)

FOR ACTION: ASST DIR VASSALLO**LTR ONLY(1) BR CHIEF LWR#3 BC**LTR ONLY(1)
PROJ MGR MINER**LTR ONLY(1) LIC ASST LWR#3 LA**LTR ONLY(1)

INTERNAL: REG FILE**LTR ONLY(1) NRC PDR**LTR ONLY(1)
I & E**LTR ONLY(2) OELD**LTR ONLY(1)
GOSSICK & STAFF**LTR ONLY(1) MIPC**LTR ONLY(1)
DIRECTOR DPM**LTR ONLY(1) DEPUTY DIR DPM**LTR ONLY(1)
QAB**LTR ONLY(1) DIRECTOR DSS**LTR ONLY(1)
AD FOR ENG**LTR ONLY(1) AD FOR REAC SFTY**LTR ONLY(1)
AD FOR PLANT SYSTEMS**LTR ONLY(1) AD FOR SYS & PROJ**LTR ONLY(1)
SD**LTR ONLY(1) K SEYFRIT/IE**LTR ONLY(1)
FERD DREHER/IE**LTR ONLY(1)


EXTERNAL: LPDR'S
WILKES BARRE, PA**LTR ONLY(1)
TERA**LTR ONLY(1)
NSIC**LTR ONLY(1)
ACRS CAT B**LTR ONLY(16)


DISTRIBUTION: LTR 41 ENCL 0
SIZE: 2P

CONTROL NBR: 781920008

MA 1 60

***** THE END *****

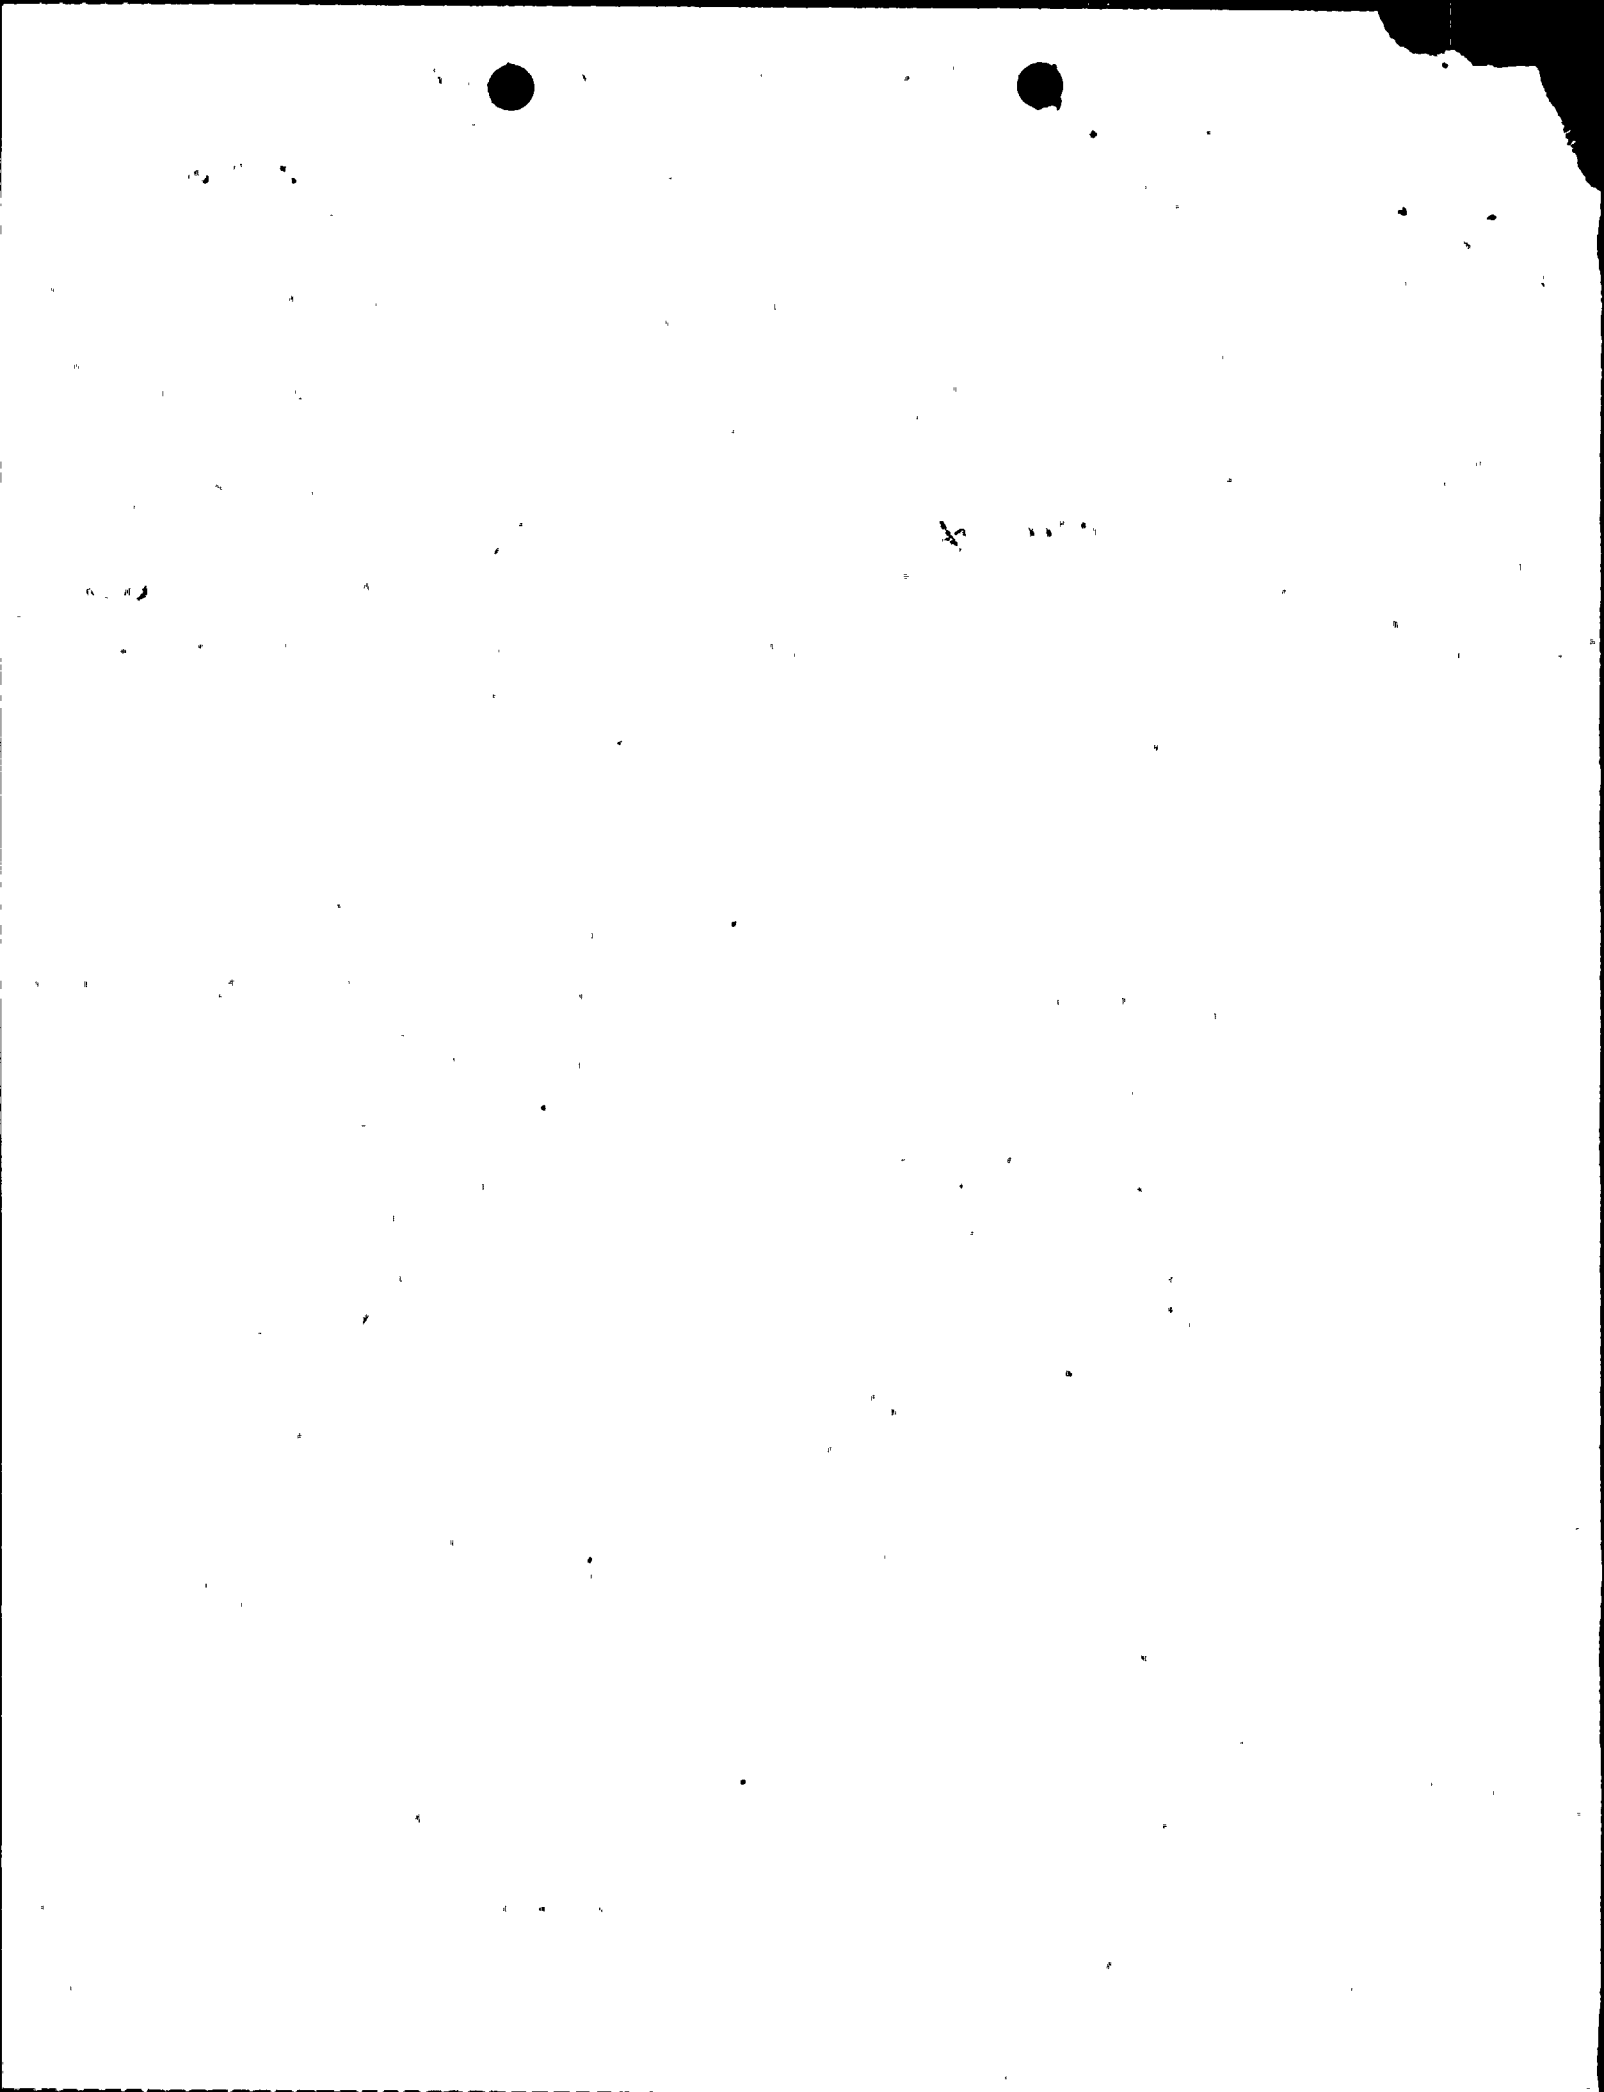



TWO NORTH NINTH STREET, ALLENTOWN, PA. 18101 PHONE: (215) 821-5151

NORMAN W. CURTIS
Vice President-Engineering & Construction
821-5381

W. J. ...

July 5, 1978

Mr. Boyce H. Grier
Director, Region I
U. S. Nuclear Regulatory Commission
631 Park Avenue
King of Prussia, Pennsylvania 19406

RECEIVED
JUL 10 1978
U.S. NUCLEAR REGULATORY COMMISSION
REGION I
KING OF PRUSSIA, PA.

SUSQUEHANNA STEAM ELECTRIC STATION
UPDATE OF INTERIM REPORT OF REPORTABLE DEFICIENCY
REGARDING SPOT WELDING OF STRUT MATERIAL
DOCKET NOS: 50-397, 50-388
LICENSE NOS: CPPR-101, CPPR-102
ERs 100450/100508 FILE 840-4
PLA-267

Dear Mr. Grier:

Reference is to my letter PLA-249, dated April 26, 1978.

We have recently decided to take and test additional samples for the purpose of evaluating the subject deficiency. Based upon our recently established time requirements for obtaining, testing and evaluating the test results, we conclude that it will not be possible to submit a definitive report by the date (7/31/78) originally identified.

We therefore submit for your information a new date, September 29, 1978, by which time we expect to submit the required report.


Very truly yours,

N. W. Curtis
Vice President-Engineering & Construction

ARS:mcb

781920008

Boily
5/10

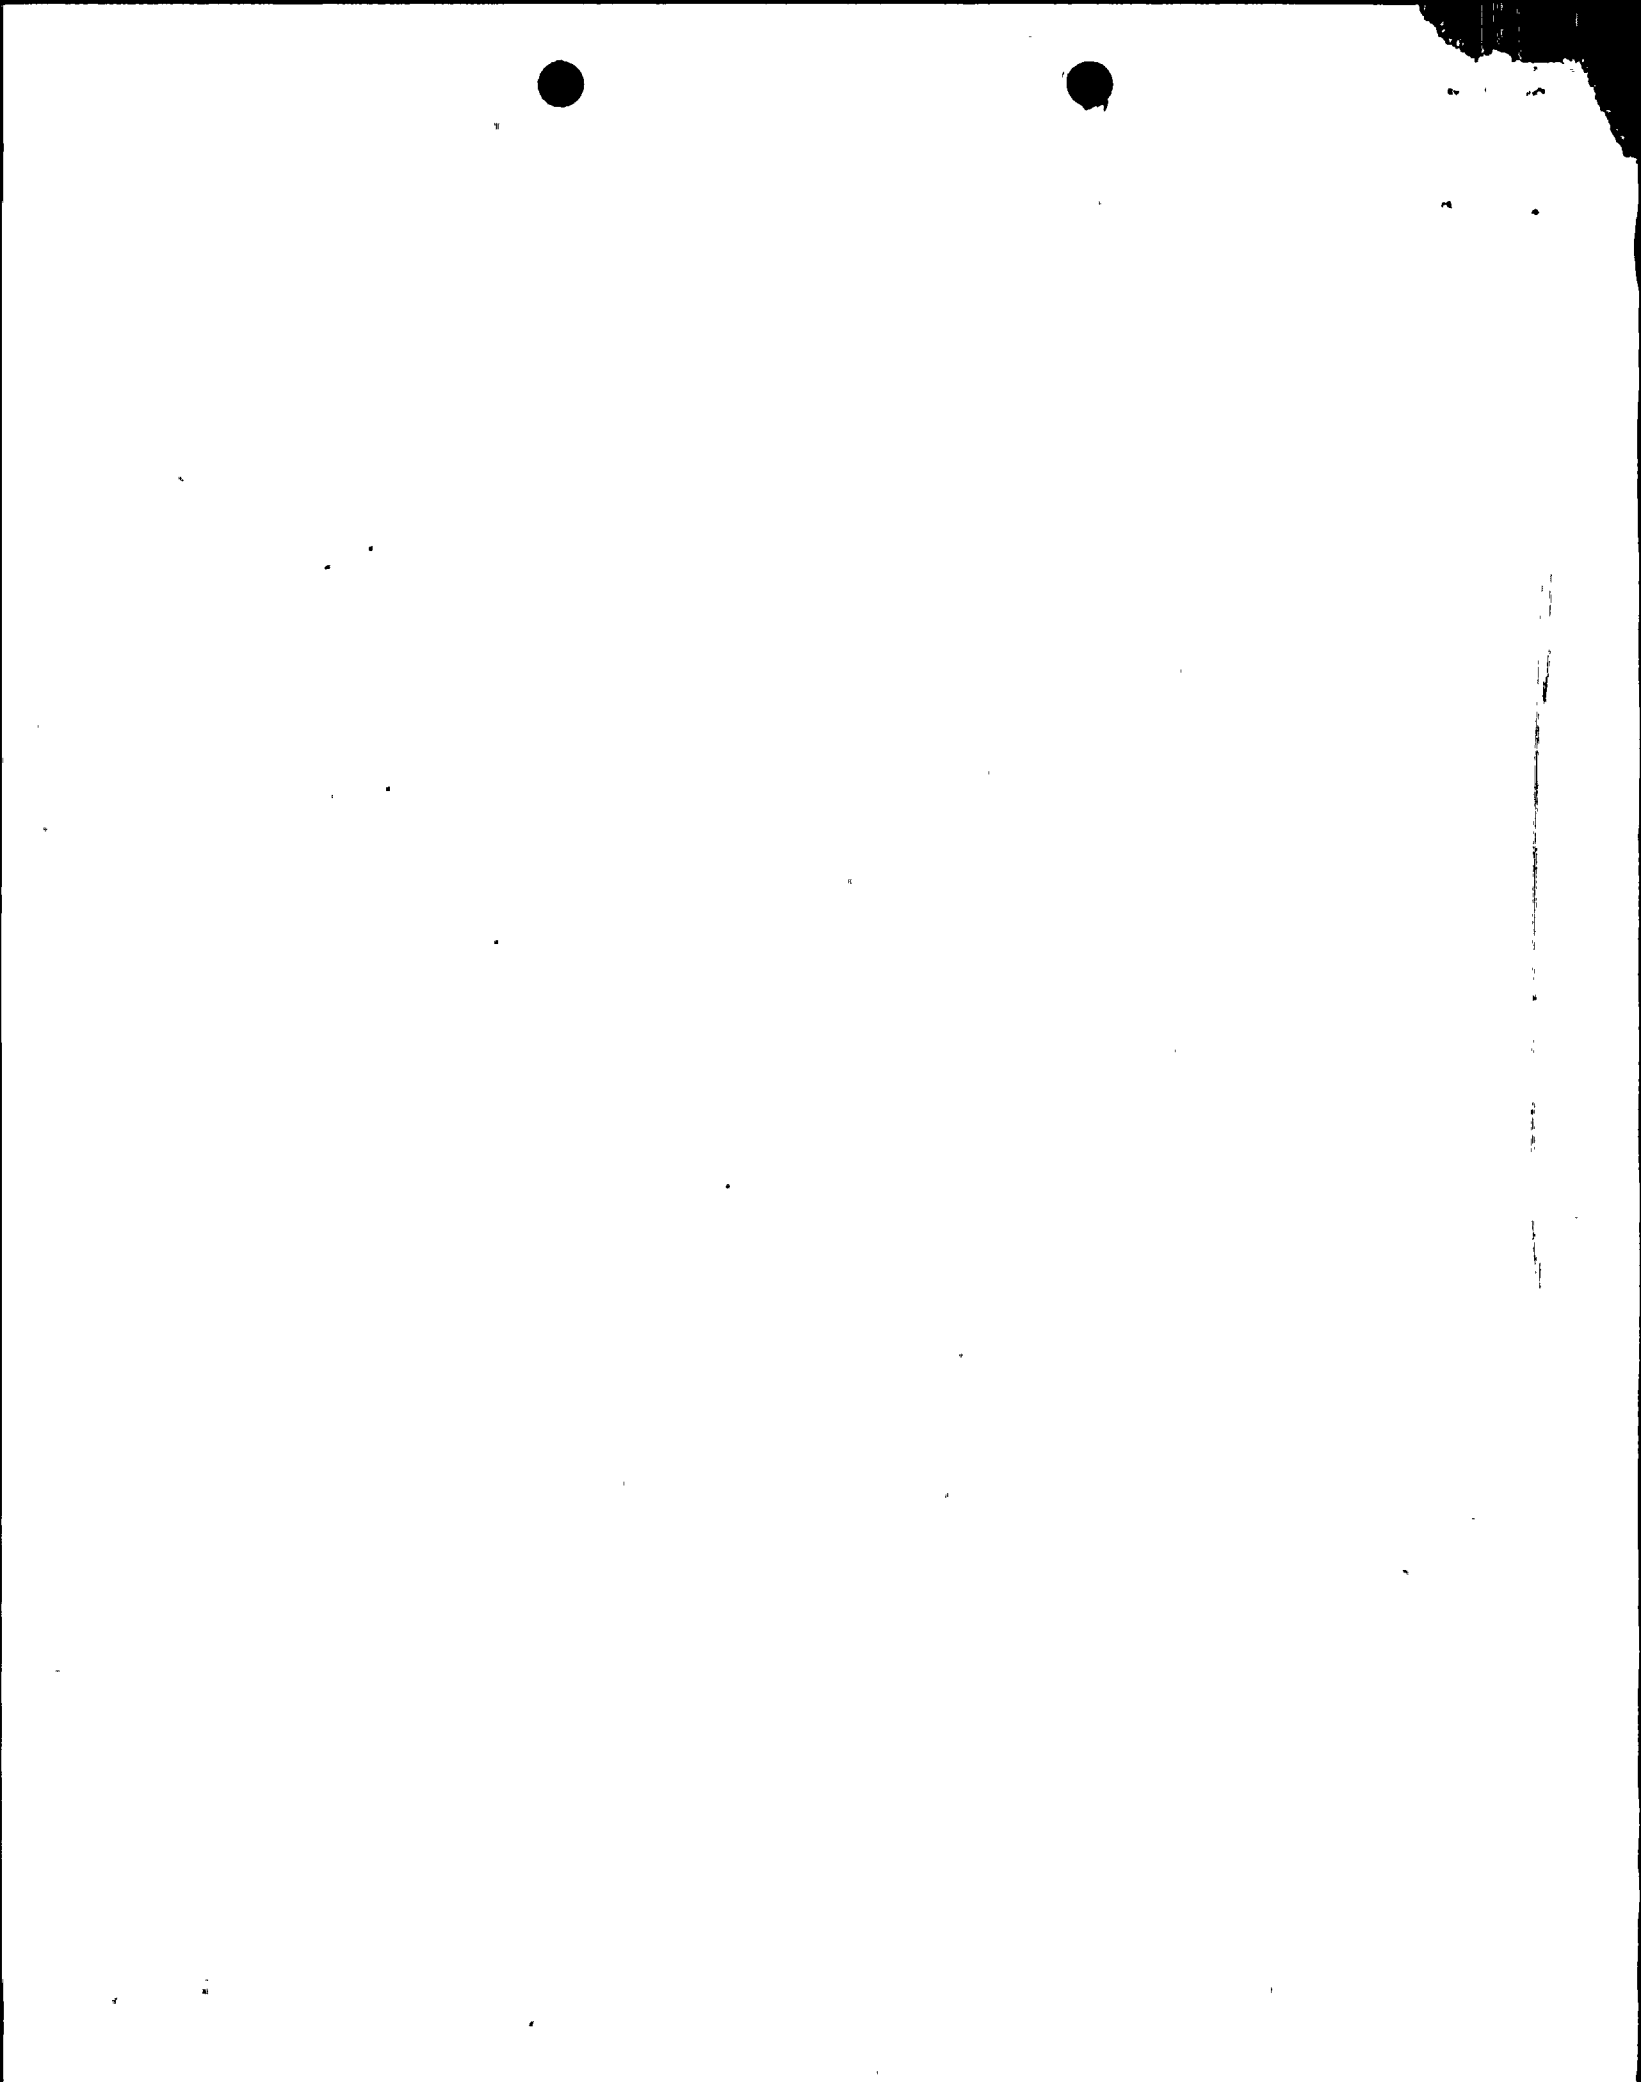

July 5, 1978

cc: Mr. Ernst Volgenau (15)
Director
Office of Inspection & Enforcement
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Mr. G. McDonald, Director
Office of Management Information and Program Control
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555