

REGULARY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8110070230 DOC. DATE: 81/10/01 NOTARIZED: NO
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania
 AUTH. NAME: CURTIS, V.W. AUTHR AFFILIATION: Pennsylvania Power & Light Co.
 RECIPIENT NAME: SCHWENCER, A. RECIPIENT AFFILIATION: Licensing Branch 2

DOCKET #
 05000387
05000388

SUBJECT: Provides final test results which demonstrate operational adequacy of safety relief valves. Submittal of NEDE-24988-P satisfies 811001 & 820101 submittal requirements of NUREG-0737, Item II.D.1.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: I&E: 3; copies FSAR & all amends. LPDR: 2 cys
 I&E: 3; copies FSAR & all amends. LPDR: 2 cys

05000387
 05000388

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME:	LTTR	ENCL		ID CODE/NAME:	LTTR
ACTION:	A/D. LICENSNG	1	0	LIC BR #2 BC	1	0
	LIC BR #2: LA	1	0	STARK, R.	04	1
INTERNAL:	ACCID. EVAL BR25:	1	0	AUX SYS BR	27	1
	CHEM. ENG. BR. 11.	1	0	CONT. SYS BR	09	1
	CORE. PERF BR 10.	1	0	EFF. TR SYS BR12:		1
	ELDI	1	0	EQUIP. QUAL BR13:		3
	GEOSCIENCES 28	2	0	HUM. FACT. ENG 40		1
	HYD/GEOL BR 30.	2	0	I&C SYS BR	16	1
	I&E 05	3	0	IE/EPOB	35	1
	IE/EPL3: 35	3	0	LIC. GUID. BR	33	1
	LIC. QUAL BR. 32:	1	0	MATL. ENG. BR	17	1
	MECH. ENG. BR 13	1	0	MPA		1
	OP. LIC BR 34	1	0	POWER. SYS BR	19	1
	PROC/TST. REV. 20:	1	0	QA. BR	21	1
	RADI. ASSESS BR22:	1	0	REAC. SYS BR	23	1
<u>REG. FILE</u> 01:	1	0	SIT. ANAL. BR	24	1	
STRUCT. ENG. BR25:	1	0				
EXTERNAL:	ACRS: 41.	16	16	FEMA-REP. DIV	39	1
	LPDR: 03.	2	2	VRC. PDR	02	1
	NSIC 05	1	1	NTIS:		1

OCT 09 1981

may

TOTAL NUMBER OF COPIES REQUIRED: LTR 63 ENCL 7




Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215 / 770-5151

Norman W. Curtis
Vice President-Engineering & Construction-Nuclear
215 / 770-5381

October 1, 1981

Mr. A. Schwencer, Chief
Licensing Branch No. 2
Division of Project Management
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

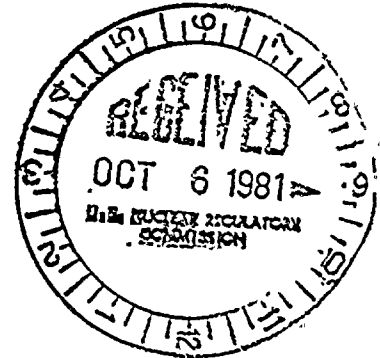

SUSQUEHANNA STEAM ELECTRIC STATION
SAFETY RELIEF VALVE OPERABILITY
TEST REPORT
ER 100450 FILE 834-1 PLA-940

- References:
- 1) Letter from T. Dente (BWR Owners' Group) to D. G. Eisenhut (NRC), "Transmittal of Valve Operability Test Report from Generic BWR Safety/Relief Valve (SRV) Test Program" dated September 25, 1981.
 - 2) Letter from N. W. Curtis to A. Schwencer, "Safety Relief Valve Test Program Preliminary Results," July 1, 1981 (PLA-865).

In response to NUREG 0737 Item II.D.1, this letter provides the final test results which demonstrate the operational adequacy of the SRVs for Susquehanna. In addition, the adequacy of the SRV discharge piping and supports has also been demonstrated. These final test results are contained in NEDE-24988-P, "Analysis of Generic BWR Safety/Relief Valve Operability Test Results" which was submitted to the NRC via Reference 1. PP&L is a participant in the BWR Owners Group generic SRV operability test program.

Susquehanna employs the Crosby 6R10 SRV. The applicability of the generic test results to this SRV has already been demonstrated in Reference 2.

A review of the test report shows that the operational adequacy of the SRVs and the piping and supports has been demonstrated for the conditions defined in Item II.D.1. The submittal of NEDE-24988-P and this letter satisfies the October 1, 1981 and January 1, 1982 submittal requirements of Item II.D.1 and completes our efforts on this item.

Very truly yours,

N. W. Curtis
Vice President-Engineering & Construction-Nuclear

- cc: M. W. Hodges (NRC)
J. A. Olshinski (NRC)
D. M. Verrelli (NRC)

8110070230 811001
PDR ADDCK 05000387
A PDR

Bool
S/10