

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8103270742 DOC. DATE: 81/03/25 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania 05000388
 AUTH. NAME AUTHOR AFFILIATION
 CURTIS, N.W. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 YOUNGBLOOD, B.J. Licensing Branch 1

SUBJECT: Confirms that HPCI sys automatically restarts on low water level after manual shutdown.

DISTRIBUTION CODE: B0018 COPIES RECEIVED: LTR 1 ENCL 0 SIZE: L
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: Send I&E 3 copies FSAR & all amends. 05000387
 Send I&E 3 copies FSAR & all amends. 05000388


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	A/D LICENSNG	1		YOUNGBLOOD, B	1	
	RUSHBROOK, M.	1		STARK, R. 04	1	
INTERNAL:	ACCID EVAL BR26	1		AUX SYS BR 07	1	
	CHEM ENG BR 08	1		CONT SYS BR 09	1	
	CORE PERF BR 10	1		EFF TR SYS BR12	1	
	EMERG PREP 22	1		EQUIP QUAL BR13	3	
	GEOSCIENCES 14	1		HUM FACT ENG BR	1	
	HYD/GEO BR 15	2		I&C SYS BR 16	1	
	I&E 06	3		LIC GUID BR	1	
	LIC QUAL BR	1		MATL ENG BR 17	1	
	MECH ENG BR 18	1		MPA	1	
	NRC PDR 02	1		OELD	1	
	OP LIC BR	1		POWER SYS BR 19	1	
	PROC/TST REV 20	1		QA BR 21	1	
	RAD ASSESS BR22	1		REAC SYS BR 23	1	
	REG FILE 01	1		SIT ANAL BR 24	1	
STRUCT ENG BR25	1		SYS INTERAC BR	1		
EXTERNAL:	ACRS 27	16	16	LPDR 03	1	
	NSIC 05	1				

MAR 30 1981

MA
4

TOTAL NUMBER OF COPIES REQUIRED: LTR 57 ENCL 54


SF

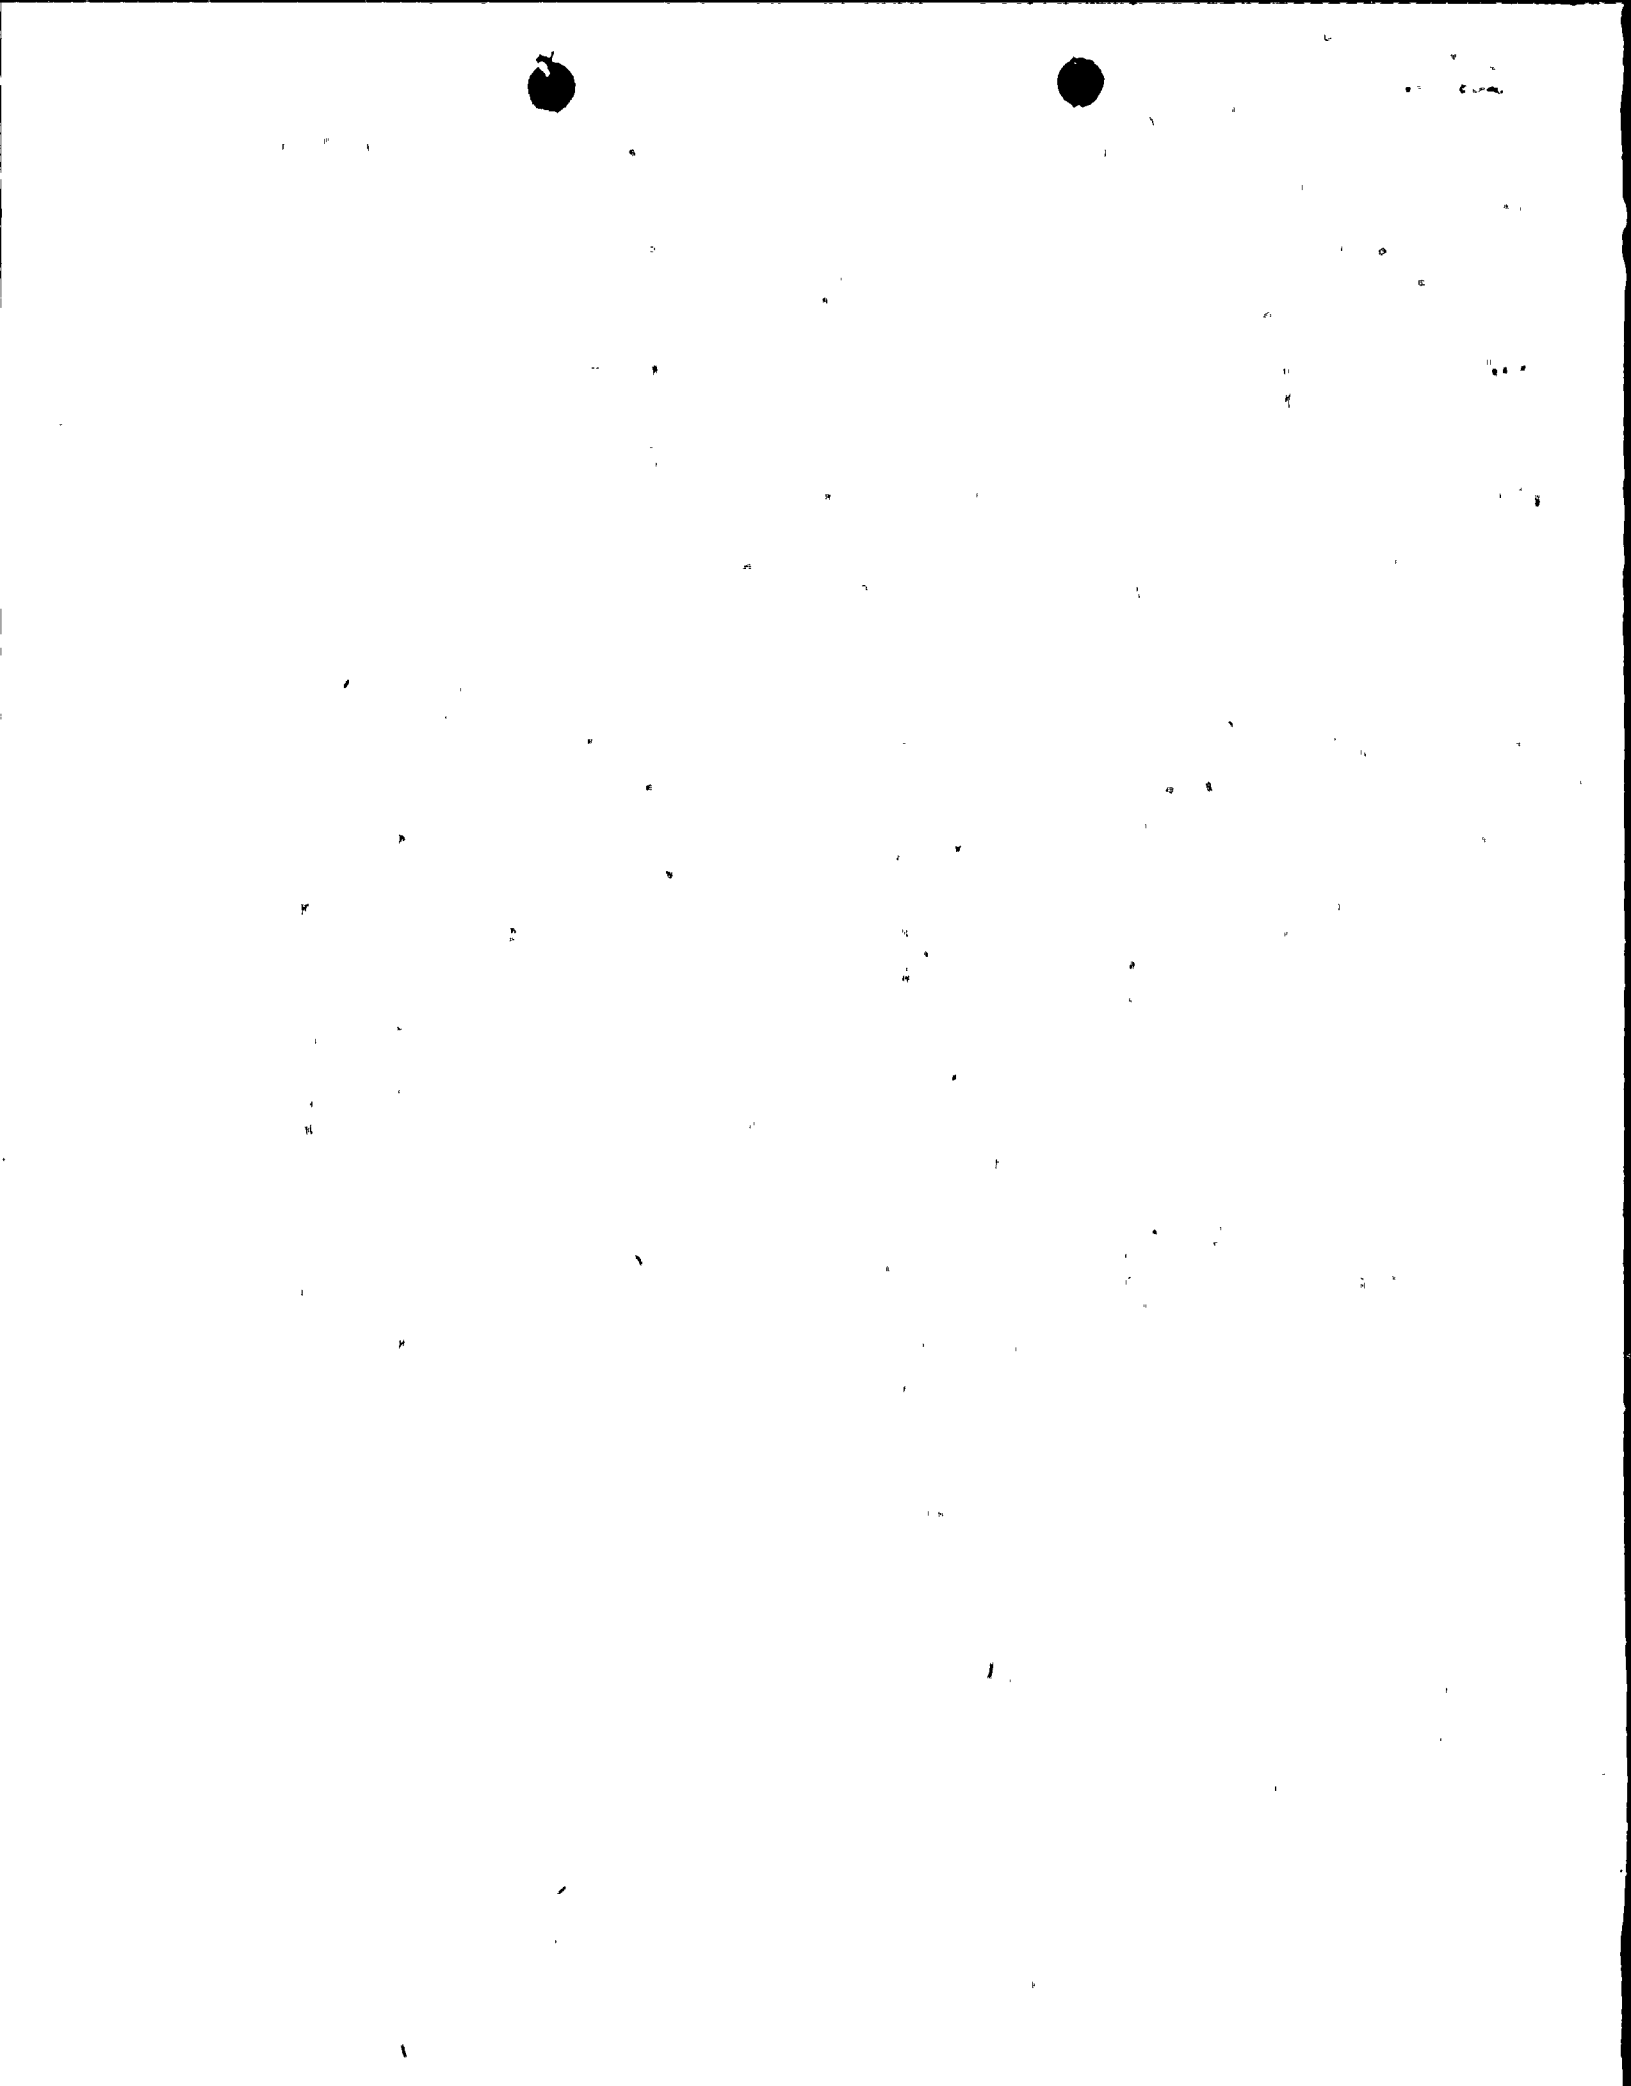



TWO NORTH NINTH STREET, ALLENTOWN, PA. 18101 PHONE: (215) 770-5151

NORMAN W. CURTIS
Vice President-Engineering & Construction-Nuclear
770-5381

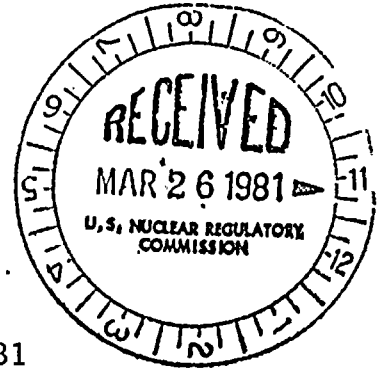

March 25, 1981

Mr. B.J. Youngblood, Chief
Licensing Branch 1
U.S. Nuclear Regulatory Commission
Washington, DC 20555

Susquehanna Steam Electric Station
HPCI Auto Restart
ER100450 File 841-2
PLA-671

Docket Nos. 50-387
and 50-388

Dear Mr. Youngblood:

In response to your concern, we confirm that the HPCI system automatically restarts on low water level after manual shutdown.

Very truly yours,

N.W. Curtis

N.W. Curtis
Vice-President-Engineering
and Construction-Nuclear

cc: R.M. Stark

bcc: N.W. Curtis
W.E. Barberich
B.A. Snapp
C.T. Coddington
R.J. Shovlin

*Boo
s
1/0*

A 8108270 742

