

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8105220169 DOC. DATE: 81/05/20 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania 05000388
 AUTH. NAME: CURTIS, N.W. AUTHOR AFFILIATION: Pennsylvania Power & Light Co.
 RECIP. NAME: YOUNGBLOOD, B.J. RECIPIENT AFFILIATION: Licensing Branch 1

SUBJECT: Commits to installation of automatic reset mod & break detection logic prior to fuel loading contingent upon delivery of qualified equipment. Mods address SER Outstanding Issues 91 & 92 respectively.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: Send I&E 3 copies FSAR & all amends, 1 cy: BWR-LRG PM(L,RIB) 05000387
 Send I&E 3 copies FSAR & all amends, 1 cy: BWR-LRG PM(L,RIB) 05000388


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
ACTION:	A/D LICENSNG	1		LIC BR #2 BC	1	
	RUSHBROOK, M.	1		STARK, R. 04	1	
INTERNAL:	ACCID EVAL BR26	1		AUX SYS BR 07	1	
	CHEM ENG BR 06	1		CONT SYS BR 09	1	
	CORE PERF BR 10	1		EFF TR SYS BR12	1	
	EMERG PREP 22	1		EQUIP QUAL BR13	3	
	GEOSCIENCES 14	1		HUM FACT ENG BR	1	
	HYD/GE0 BR 15	2		I&C SYS BR 16	1	
	I&E 06	3		LIC GUID BR	1	
	LIC QUAL BR	1		MATL ENG BR 17	1	
	MECH ENG BR 18	1		MPA	1	
	NRC PDR 02	1		OELD	1	
	OP LIC BR	1		POWER SYS BR 19	1	
	PROC/TST REV 20	1		QA BR 21	1	
	RAD ASSESS BR22	1		REAC SYS BR 23	1	
	REG FILE 01	1		SIT ANAL BR 24	1	
STRUCT ENG BR25	1					
EXTERNAL:	ACRS 27	16	16	LPDR 03	1	
	NSIC 05	1	1			

MAY 27 1981

MAH

57 0

TOTAL NUMBER OF COPIES REQUIRED: LTR 57 ENCL 0

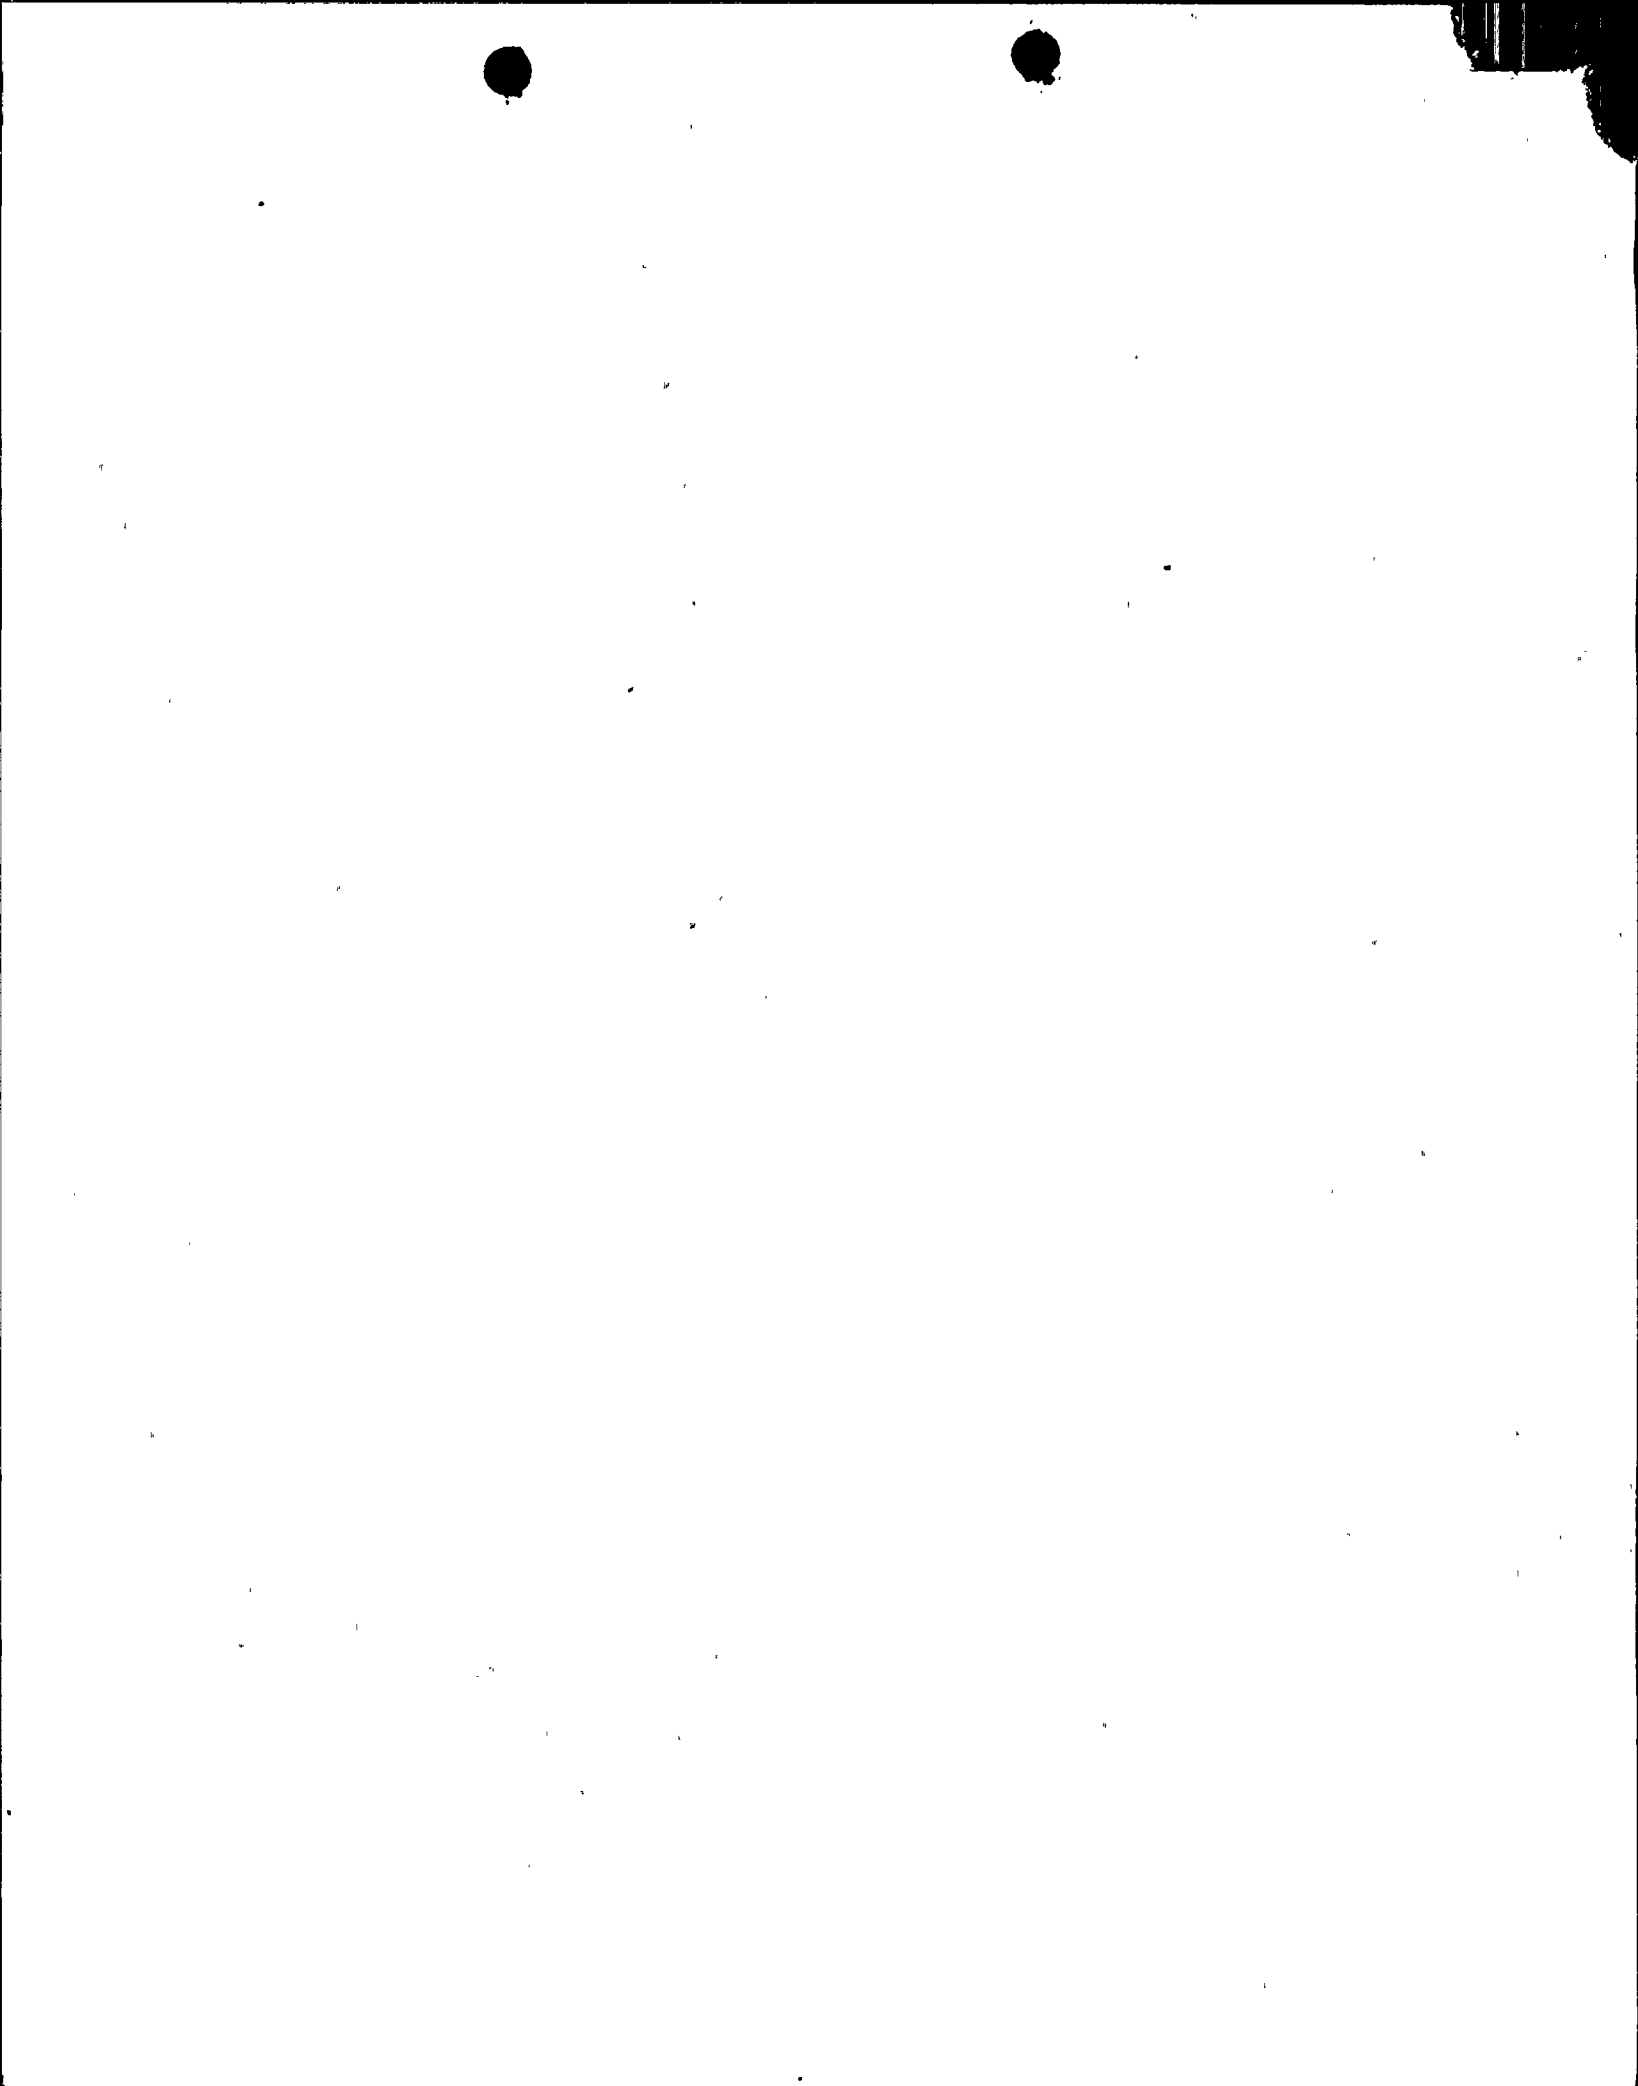

PP&L

TWO NORTH NINTH STREET, ALLENTOWN, PA. 18101 PHONE: (215) 821-5151

NORMAN W. CURTIS
Vice President-Engineering & Construction
821-5381

May 20, 1981

Mr. B.J. Youngblood, Chief
Licensing Branch No. 1
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Docket Nos 50-387
50-388

Susquehanna Steam Electric Station
RCIC System - Automatic Reset Modification (SER Outstanding Issue 91)
HPCI and RCIC System - Break Detection Logic (SER Outstanding Issue 92)
ER100450 File 841-2

Dear Mr. Youngblood:

PP&L commits to install both of the subject modifications prior to fuel loading contingent upon delivery of qualified equipment. These modifications are those developed by General Electric and accepted by the BWR Owners Group. (12/29/80 - letter from D.B. Waters to D. Eisenhut)

Very truly yours,


N.W. Curtis/rgs

N.W. Curtis
Vice President-Engineering & Construction-Nuclear

CTM/mks

Attachment

cc: R.M. Stark

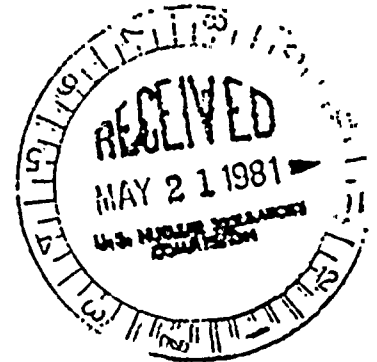

Boo 1/10

8105220169

E