

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9810220316      DOC. DATE: 98/10/12      NOTARIZED: YES      DOCKET #  
FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv      05000387  
50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv      05000388  
AUTH. NAME      AUTHOR AFFILIATION  
BYRAM, R.G.      Pennsylvania Power & Light Co.  
RECIP. NAME      RECIPIENT AFFILIATION  
Records Management Branch (Document Control Desk)

SUBJECT: Forwards Rev 28 to "SSES Emergency Plan." Changes become effective upon implementation of Improved Tech Specs.

DISTRIBUTION CODE: A045D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 4 + 18  
TITLE: OR Submittal: Emergency Preparedness Plans, Implement'g Procedures,

NOTES:

05000387


	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD1-2 PD	1 1	NERSES, V	1 1
INTERNAL:	AEOD/HAGAN, D	1 1	<u>FILE CENTER 81</u>	2 2
	NRR/DRPM/PERB	1 1	NUDOCS-ABSTRACT	1 1
EXTERNAL:	NOAC	1 1	NRC PDR	1 1
NOTES:		1 1		

*2nd copy 1*  
*4/23 RB*

NOTE TO ALL "RIDS" RECIPIENTS:  
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 10 ENCL 10

C  
A  
T  
E  
G  
O  
R  
Y  
1  
D  
O  
C  
U  
M  
E  
N  
T

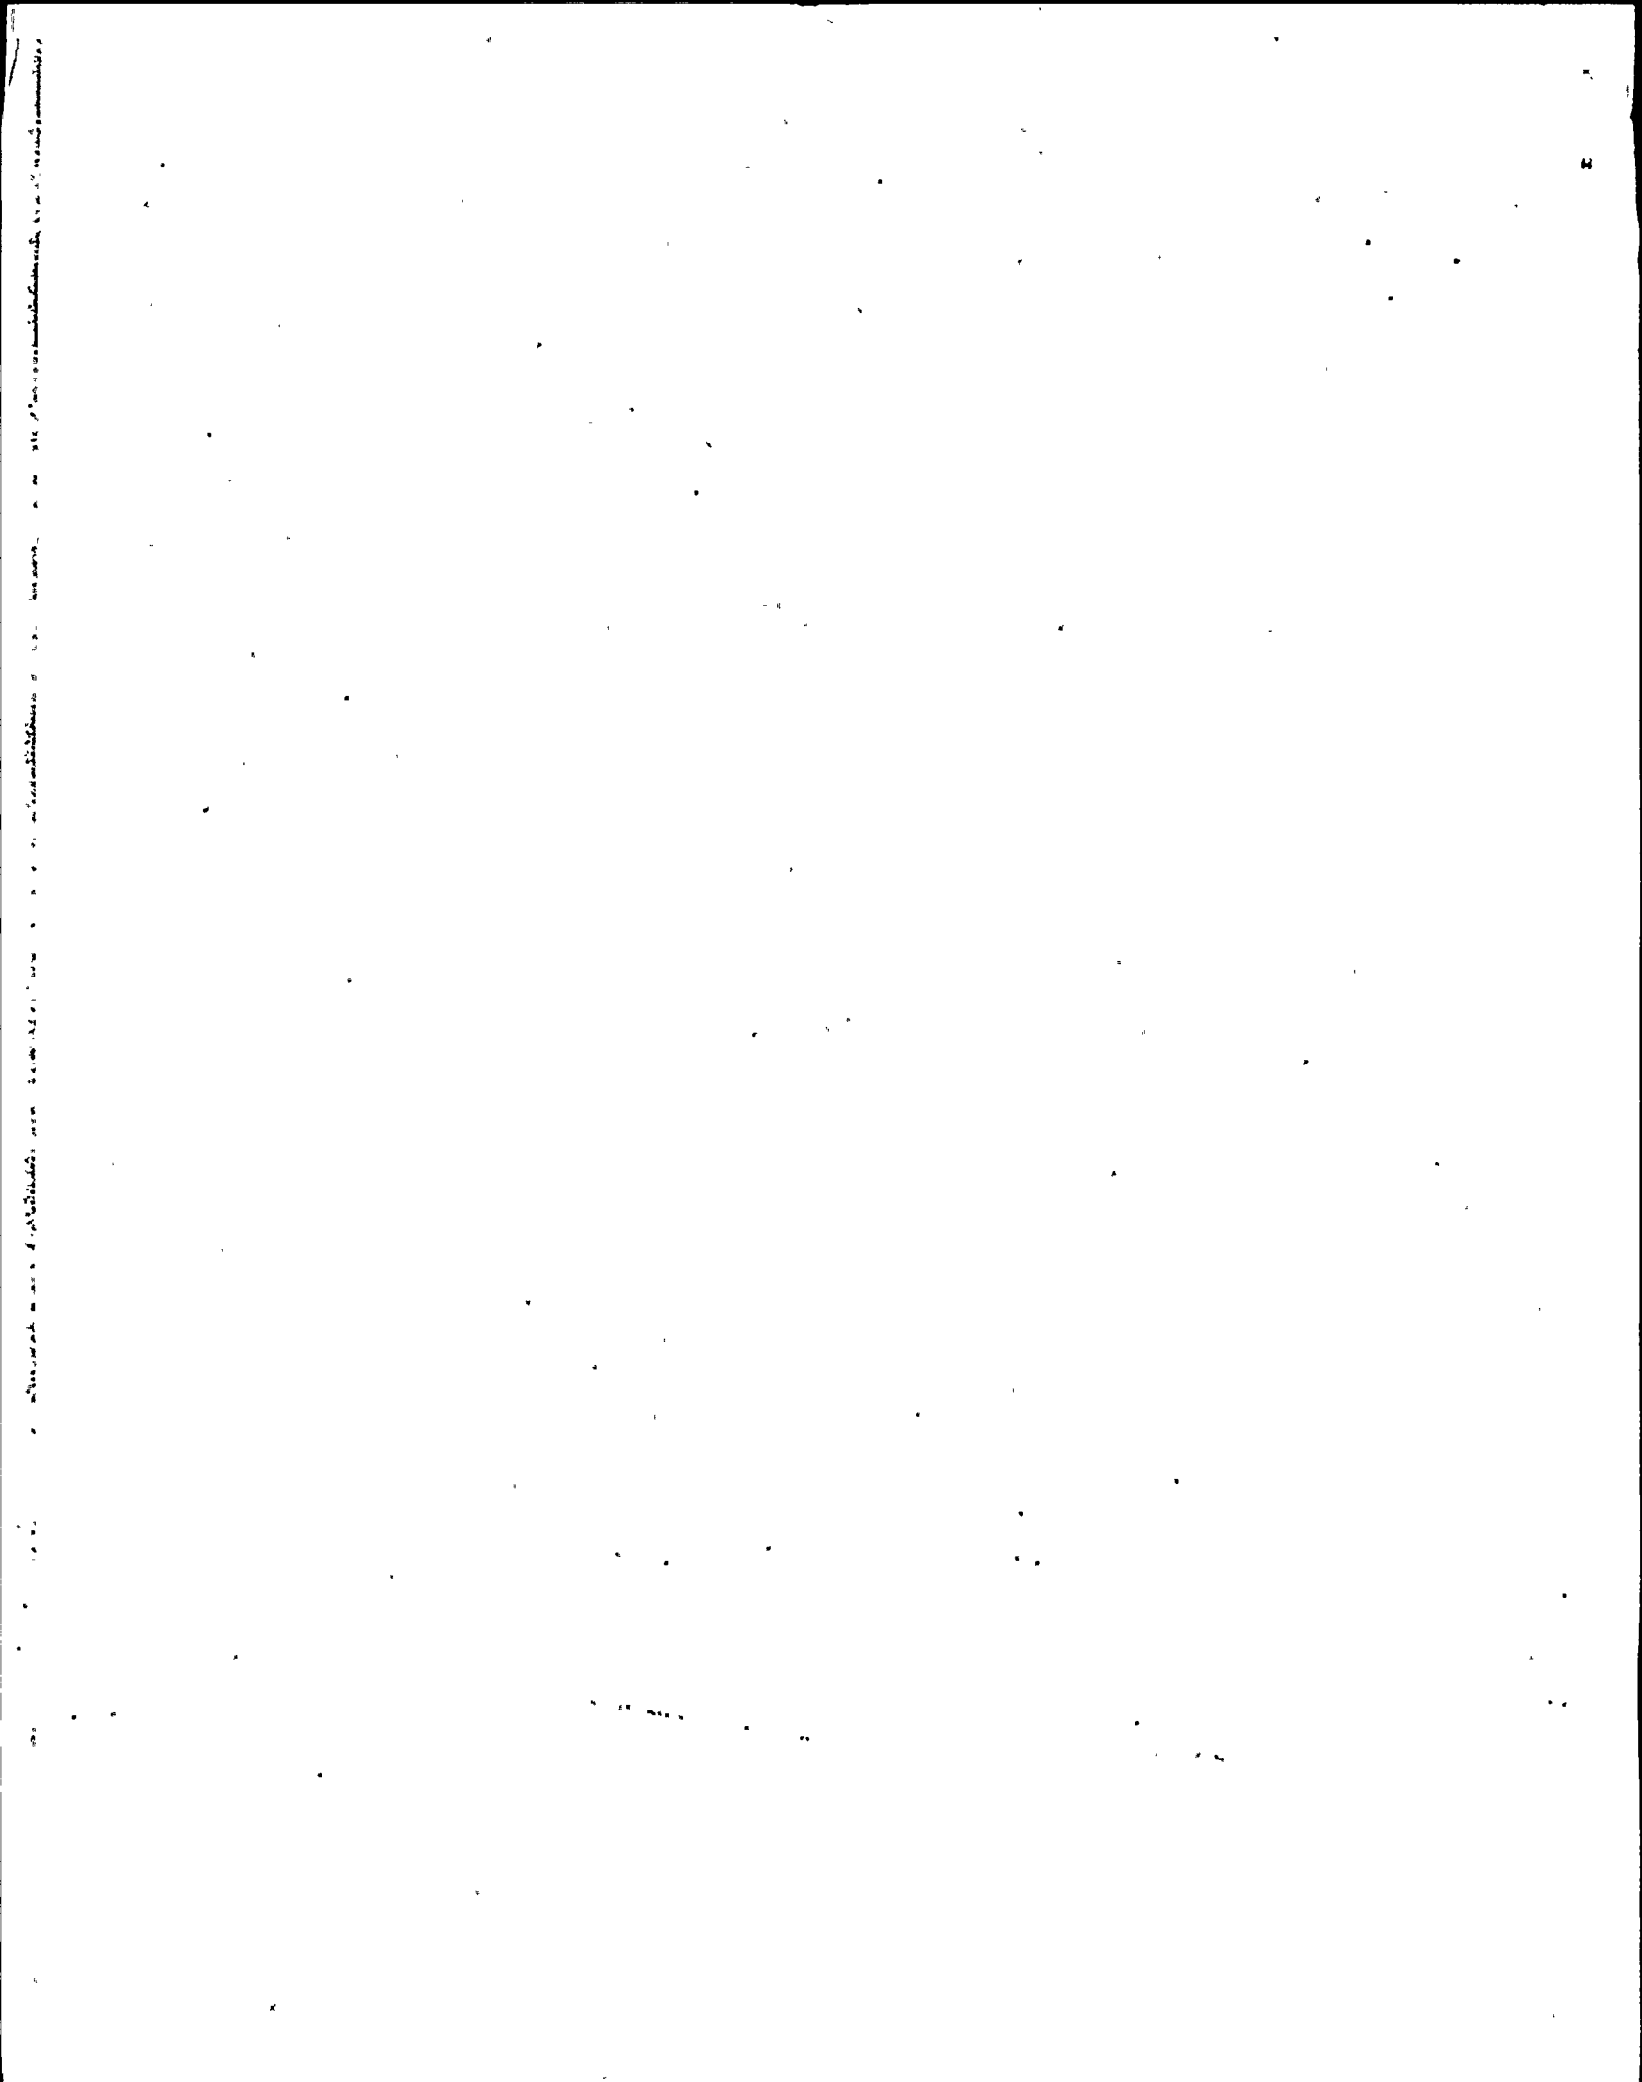

Robert G. Byram  
Senior Vice President  
Generation and Chief Nuclear Officer  
Tel. 610.774.7502 Fax 610.774.5019  
E-mail: rbyram@papl.com

PP&L, Inc.  
Two North Ninth Street  
Allentown, PA 18101-1179  
Tel. 610.774.5151  
http://www.ppl-inc.com/



OCT 12 1998

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Mail Stop P1-137  
Washington, D.C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION  
EMERGENCY PLAN REVISION 28  
PLA-4985**

**FILES R36, A17-13**

**Docket Nos. 50-387  
and 50-388**

Enclosed is Revision 28 to the Susquehanna SES Emergency Plan. In accordance with the requirements of 10 CFR 50 54q, the change has been made without commission approval as it does not decrease the effectiveness of the plan and the plan as changed continues to satisfy the applicable requirements of Appendix E to 10 CFR 50.

The change is summarized below:

**SECTION 7.0, EMERGENCY MEASURES**


Section 7.1.1 "Offsite Dose Calculation"

This change adds the description of the Remote Monitoring System. This system provides information (magnitude, direction and type of radiological release) which can be used to assist field monitoring teams and to supplement the information provided by in-field monitoring teams. This system is considered an enhancement to the existing capabilities in that it can provide an additional source of data to assist field monitoring teams in locating and assessing radiological conditions; however, this system is not relied upon to provide data and its loss will not prevent the gathering of data.

//  
//  
A245


0-3000

9810220316 981012  
PDR ADDCK 05000387  
PDR

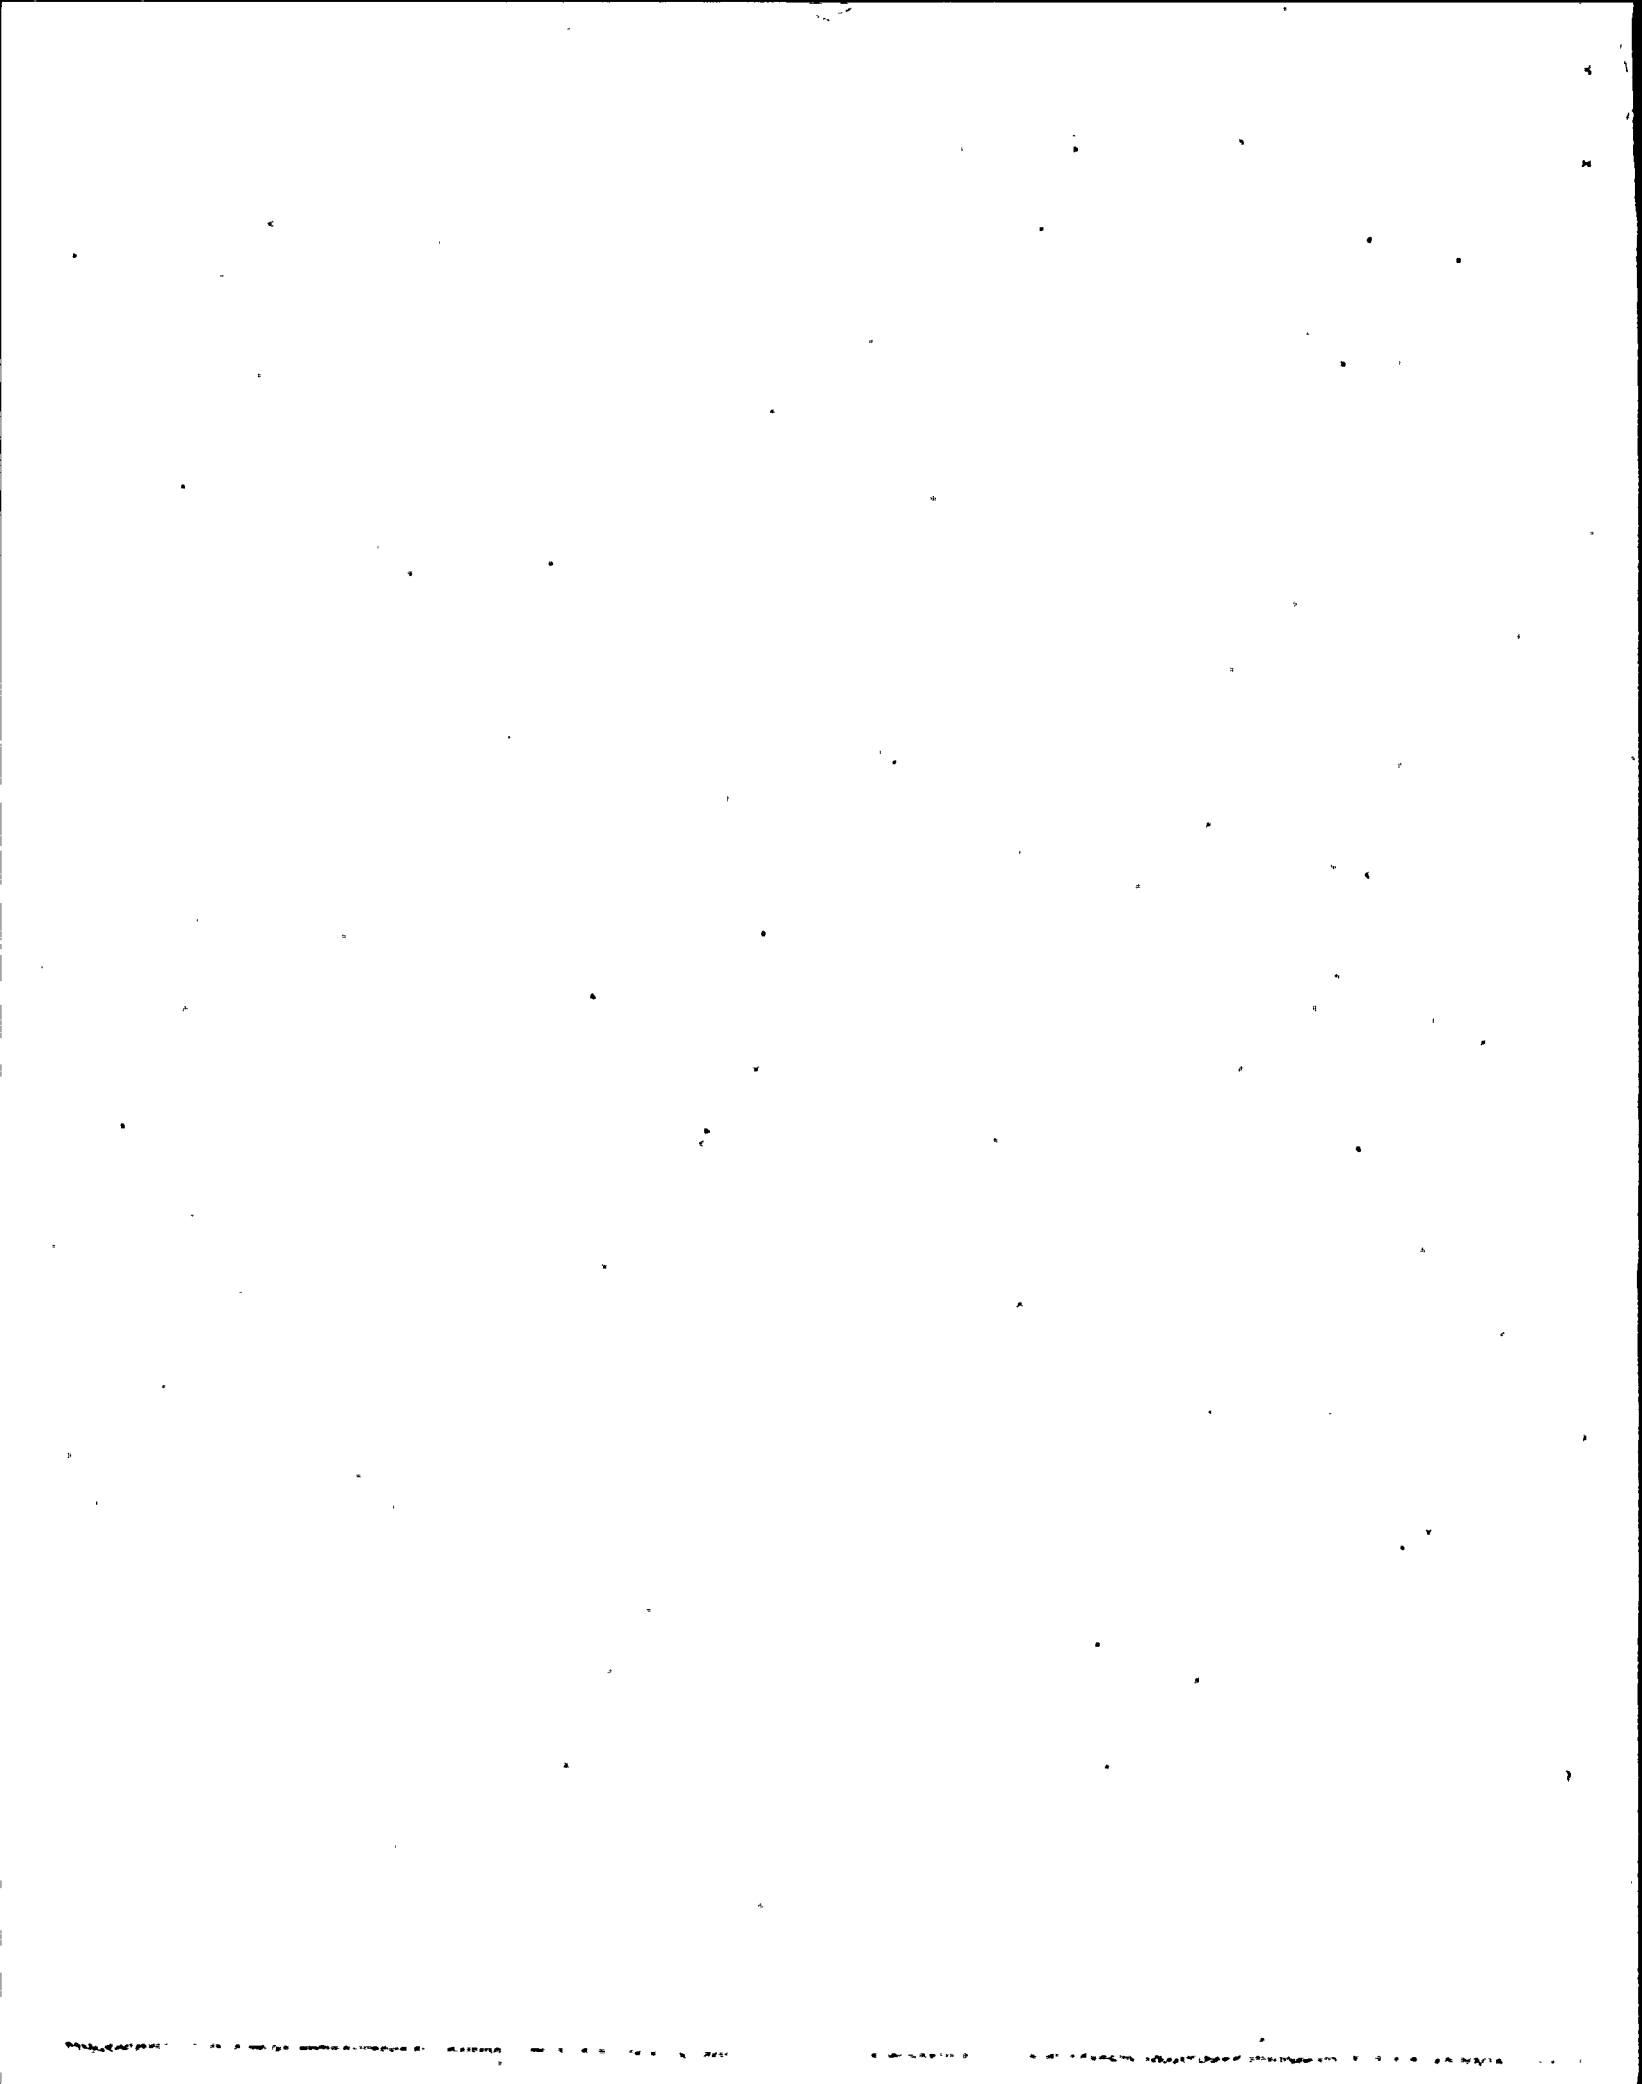

Should you have questions regarding this submittal, please contact Ms. C. A. Smith at  
(717) 542-3233.

Sincerely,

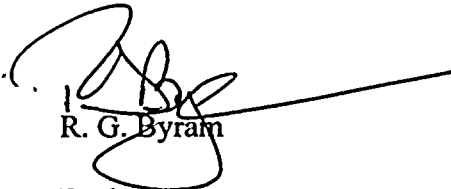A handwritten signature in black ink, appearing to be 'R. G. Byram', written over a horizontal line. The signature is stylized and cursive.

R. G. Byram

Enclosure

copy: NRC Region I  
Mr. K. M. Jenison, NRC Resident Inspector  
Mr. V. Nerses, NRC Sr. Project Manager



BEFORE THE  
UNITED STATES NUCLEAR REGULATORY COMMISSION

In the Matter of

PP&L, INC.

:

:

Docket No. 50-387  
and 50-388

REVISION NO. 28

EMERGENCY PLAN  
FOR THE  
SUSQUEHANNA STEAM ELECTRIC STATION  
UNITS NO. 1 AND NO. 2

PP&L, Inc. hereby files Revision 28 to its Emergency Plan dated July 31, 1978.


PP&L, INC.  
BY:



R. G. Byram  
Senior Vice-President - Generation and Chief Nuclear Officer

Sworn to and subscribed before me  
this 18<sup>th</sup> day of October, 1998.

*Michelle A. Kernechel*

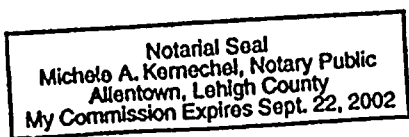





These changes become effective upon implementation of Improved Technical Specifications. Should you have questions regarding this submittal, please contact Ms. C. A. Smith at (717) 542-3233.

Sincerely,

(Signed) R. G. BYRAM

R. G. Byram

Enclosure

copy: NRC Region I  
Mr. K. M. Jenison, NRC Resident Inspector  
Mr. V. Nerses, NRC Sr. Project Manager

bc:	C. T. Coddington	NUCSA4	w/o attach
	D. L. Filchner	GENA63	w/o attach
	G. T. Jones	GENA61	w/o attach
	J. M. Kenny	GENA61	w/o attach
	R. D. Kichline	GENA61	w/o attach
	G. D. Miller	GENA62	w/o attach
	R. F. Saunders	NUCSA4	w/o attach
	C. A. Smith	NUCWB	w/o attach
	R. R. Sgarro	GENA61	w/o attach
	W. F. Tabor	EMC	w/o attach
	R. R. Wehry	NUCSA4	w/o attach
	W. W. Williams	GENA61	w/o attach
	Licensing File	GENA61	w/o attach
	NR Files	GENA62	w/o attach

