

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7909140337 DOC. DATE: 79/09/10 NOTARIZED: NO DOCKET #  
 FACIL: ~~50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.~~ 05000389  
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388  
 AUTH. NAME AUTHOR AFFILIATION  
 CURTIS, N.W. Pennsylvania Power & Light Co. 50-387  
 RECIPIENT AFFILIATION  
 SELLS, D. Environmental Projects Branch 2

SUBJECT: Forwards NPDES permit PA-0047325 & changes to DES, Tables 4.1 & 5.1.

DISTRIBUTION CODE: C002B COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 4+25  
 TITLE: Environ. Comments

NOTES: SEND THE 3 CYS FSAR & ALL AMDTS. L.A. ICY EVERYTHING (ORNY)


	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
ACTION:	05 PM P. LEECH	1 1	17 BC EPB #2	1 1
	18 LA EPB #2	1 1	AD MOORE	1 0
INTERNAL:	01 <u>REG FILE</u>	1 1	02 NRC PDR	1 1
	07 I&E	2 2	09 ENVN SPEC BR	1 1
	10 CST BNFT ANL	1 1	11 TA/EDO	1 1
	12 AD SITE TECH	2 2	14 ACIDENT ANALY	1 1
	15 EFLT TRT SYS	1 1	16 RAD ASMT BR	1 1
	19 DIR DSE	1 1	AD ENVIRON TECH	1 0
	AD SITE ANALY	1 0	OELD	1 0
EXTERNAL:	03 LPDR	1 1	04 NSIC	1 1
	20 NATL LAB	5 5	ACRS	1 0

Ltr  
 LWR  
 LWR #3 BC  
 MINER  
 LWR #3 LA

SEP 17 1979

T ENO  
 4

TOTAL NUMBER OF COPIES REQUIRED: LTTR 33 ENCL 24  
 28 23

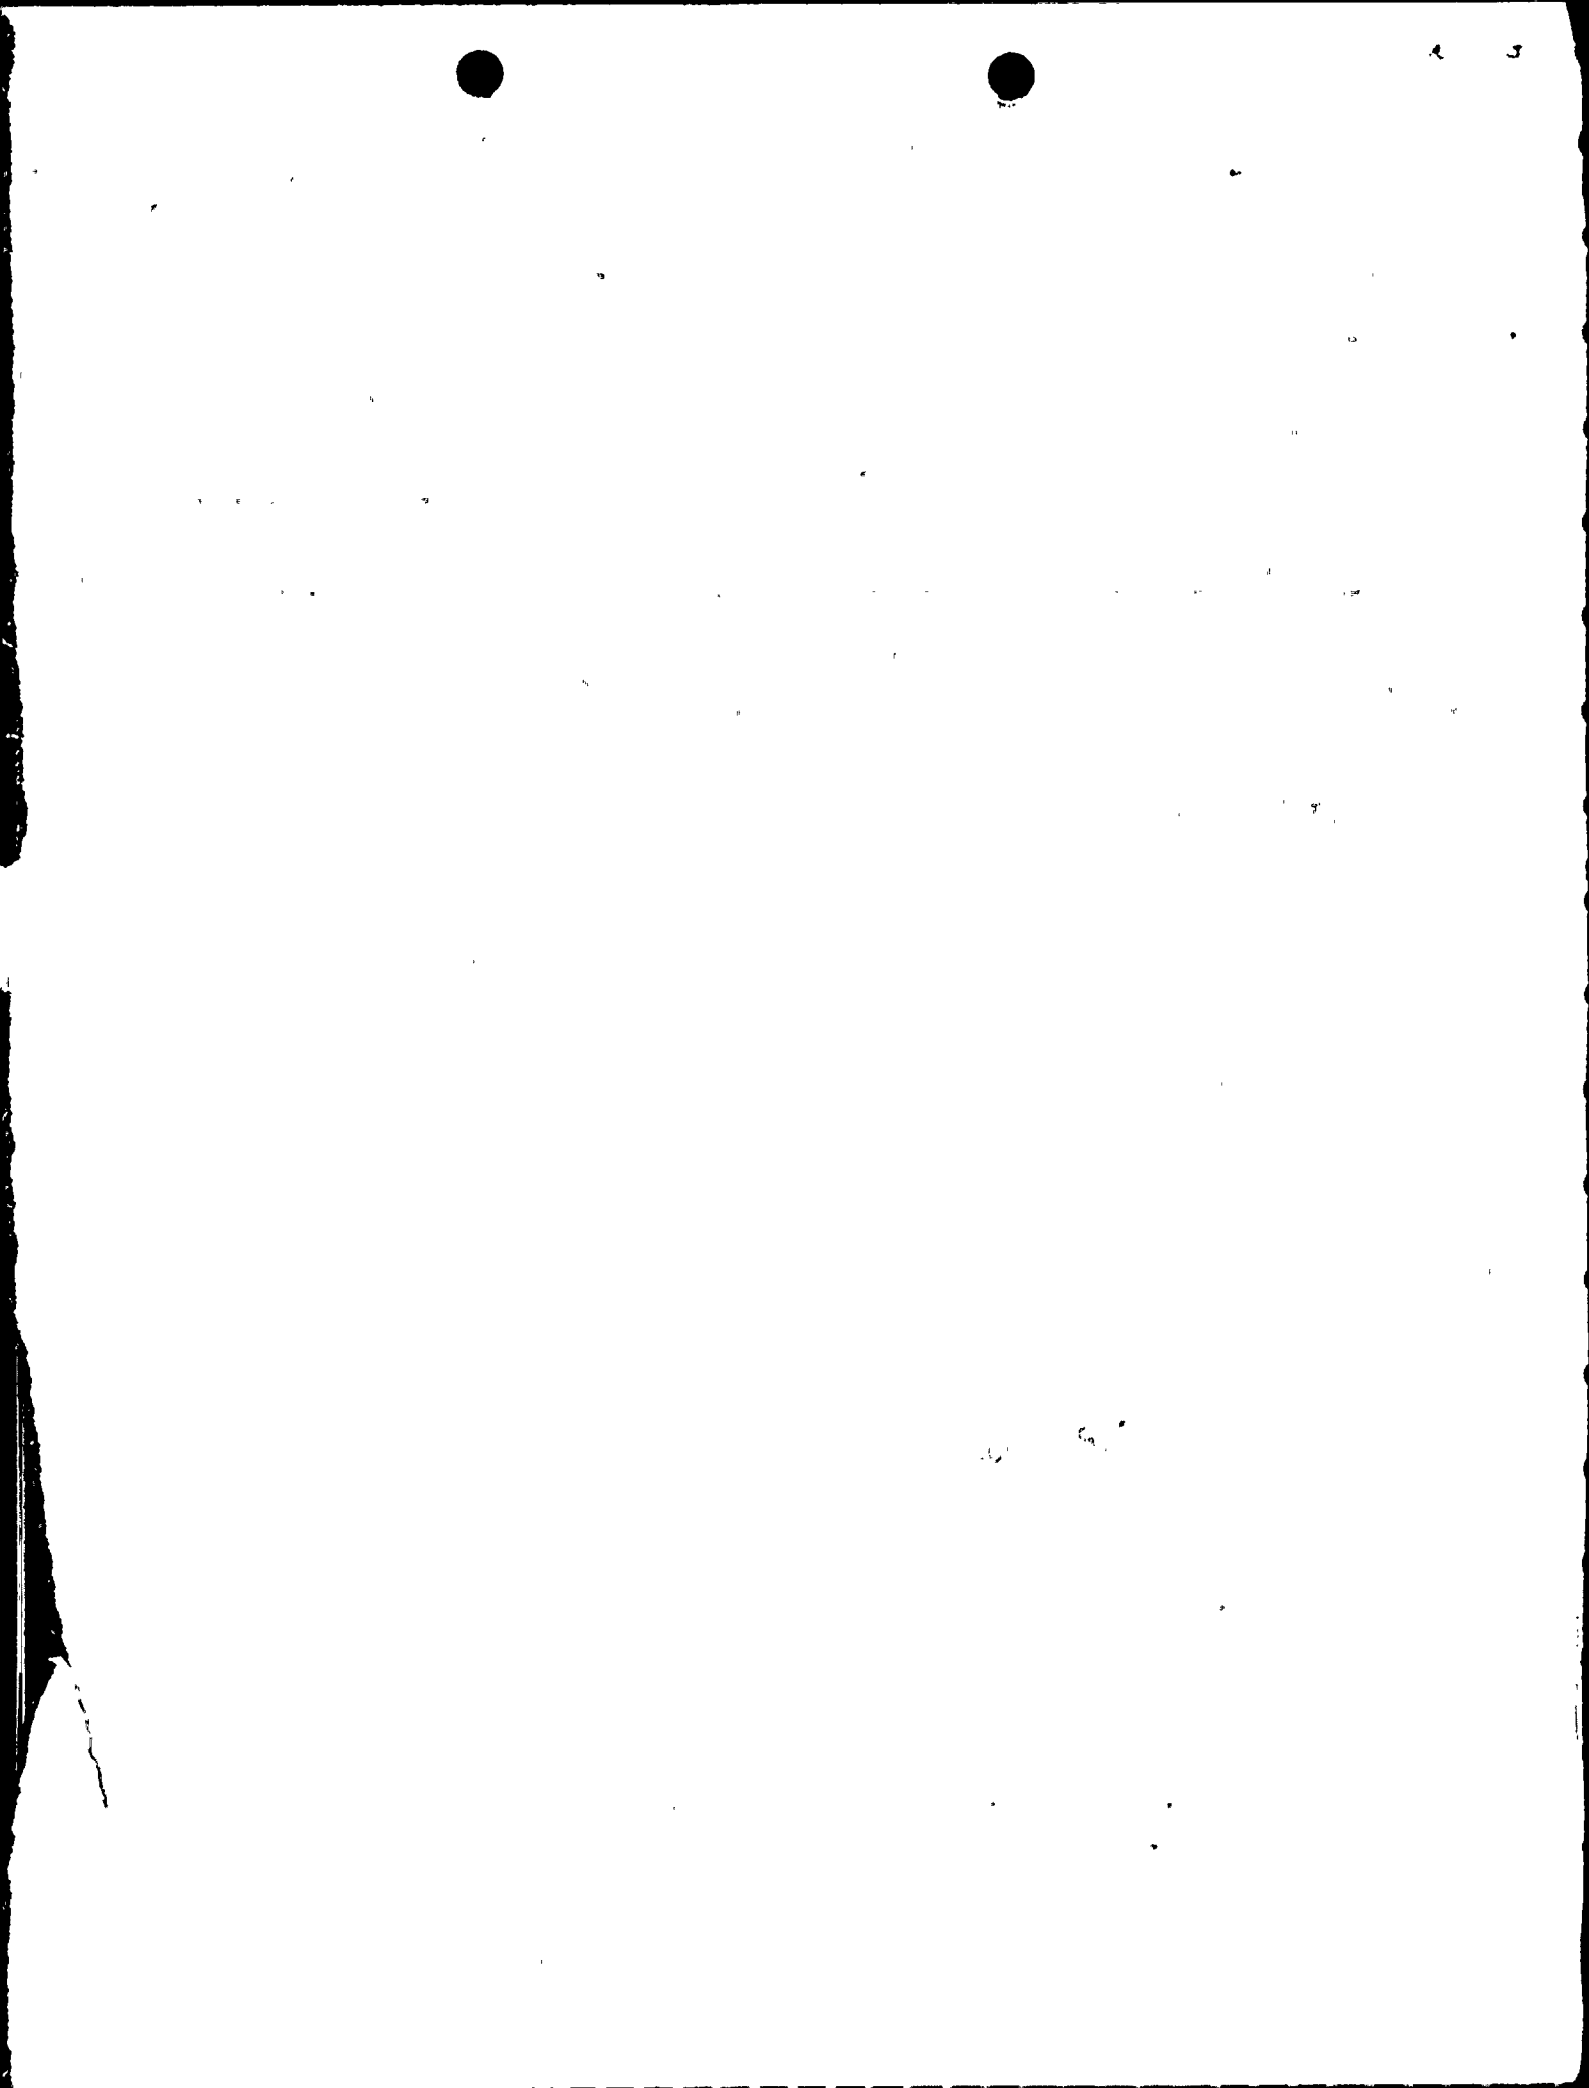



TWO NORTH NINTH STREET, ALLENTOWN, PA. 18101 PHONE: (215) 821-5151

September 10, 1979

NORMAN W. CURTIS  
Vice President-Engineering & Construction  
821-5381

Mr. Donald E. Sells, Acting Branch Chief  
Environmental Projects Branch 2  
Division of Site Safety and Environmental Analysis  
U. S. Nuclear Regulatory Commission  
Washington, D.C. 20555

SUSQUEHANNA STEAM ELECTRIC STATION  
MATERIAL SUPPORTING DES COMMENTS  
ER 100450 PLA-398 FILE 991-2

DOCKET NOS. 50-387  
AND 50-388

Dear Mr. Sells:

Attached is a copy of each of the following:

1. NPDES Permit No. PA-0047325, dated July 31, 1979;
2. DES Table 4.1 with suggested corrections marked; and
3. DES Table 5.1 with changes marked.

This information was referenced in our letter of September 4, 1979 containing comments on the DES.

Very truly yours,

N. W. Curtis  
Project Director-Susquehanna

/jm  
Attachments

cc-Mr. Paul Leech  
Mail Stop P522  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

**REGULATORY DOCKET FILE COPY.**

COOZ  
ES/1  
1/1

0

The first part of the document discusses the importance of maintaining accurate records of all transactions. It emphasizes that every entry should be supported by a valid receipt or invoice. This ensures transparency and allows for easy verification of the data.

In the second section, the author outlines the various methods used to collect and analyze the data. This includes both primary and secondary data collection techniques. The primary data was gathered through direct observation and interviews with key personnel. Secondary data was obtained from existing reports and databases.

The analysis phase involved a thorough review of the collected information. Statistical tools were used to identify trends and patterns in the data. The results of the analysis are presented in the following sections, showing a clear correlation between the variables studied.

The final part of the document provides a summary of the findings and offers recommendations for future research. It suggests that further studies should focus on the long-term effects of the variables and explore additional factors that may influence the outcomes.


COMMONWEALTH OF PENNSYLVANIA



DEPARTMENT OF ENVIRONMENTAL RESOURCES

Bureau of Water Quality Management  
Wilkes Barre Regional Office  
90 East Union Street - 2nd Floor  
Wilkes Barre, Pa. 18701  
July 31, 1979

Industrial Waste  
NPDES Permit No. PA-0047325  
Pennsylvania Power & Light Company  
Susquehanna Steam Electric  
Salem Township  
Luzerne County



Pennsylvania Power & Light Company  
Susquehanna Steam Electric  
c/O Mr. John T. Kauffman  
Executive Vice President, Operations  
Two North Ninth Street  
Allentown, Pa. 18101

Gentlemen:

The subject permit is enclosed.

Please study the permit carefully and direct any questions to this office. Our telephone number is (717) 826-2553.

Very truly yours,

A handwritten signature in cursive script, reading "Lawrence A. Pawlush".  
Lawrence A. Pawlush  
Regional Water Quality Manager

IAP:JPL:hp

Enclosures - NPDES Permit  
NPDES Discharge Monitoring Report  
DMR Instructions

cc: File  
Program Services  
Richard L. Constrisciano  
Environmental Engineer  
Water Enforcement Branch  
Pennsylvania Section 3EN22  
U.S. Environmental Protection Agency  
Sixth & Walnut Streets  
Philadelphia, Pa. 19106