


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, imaged, scanned, or otherwise disseminated by any means without the express written consent of the lender.

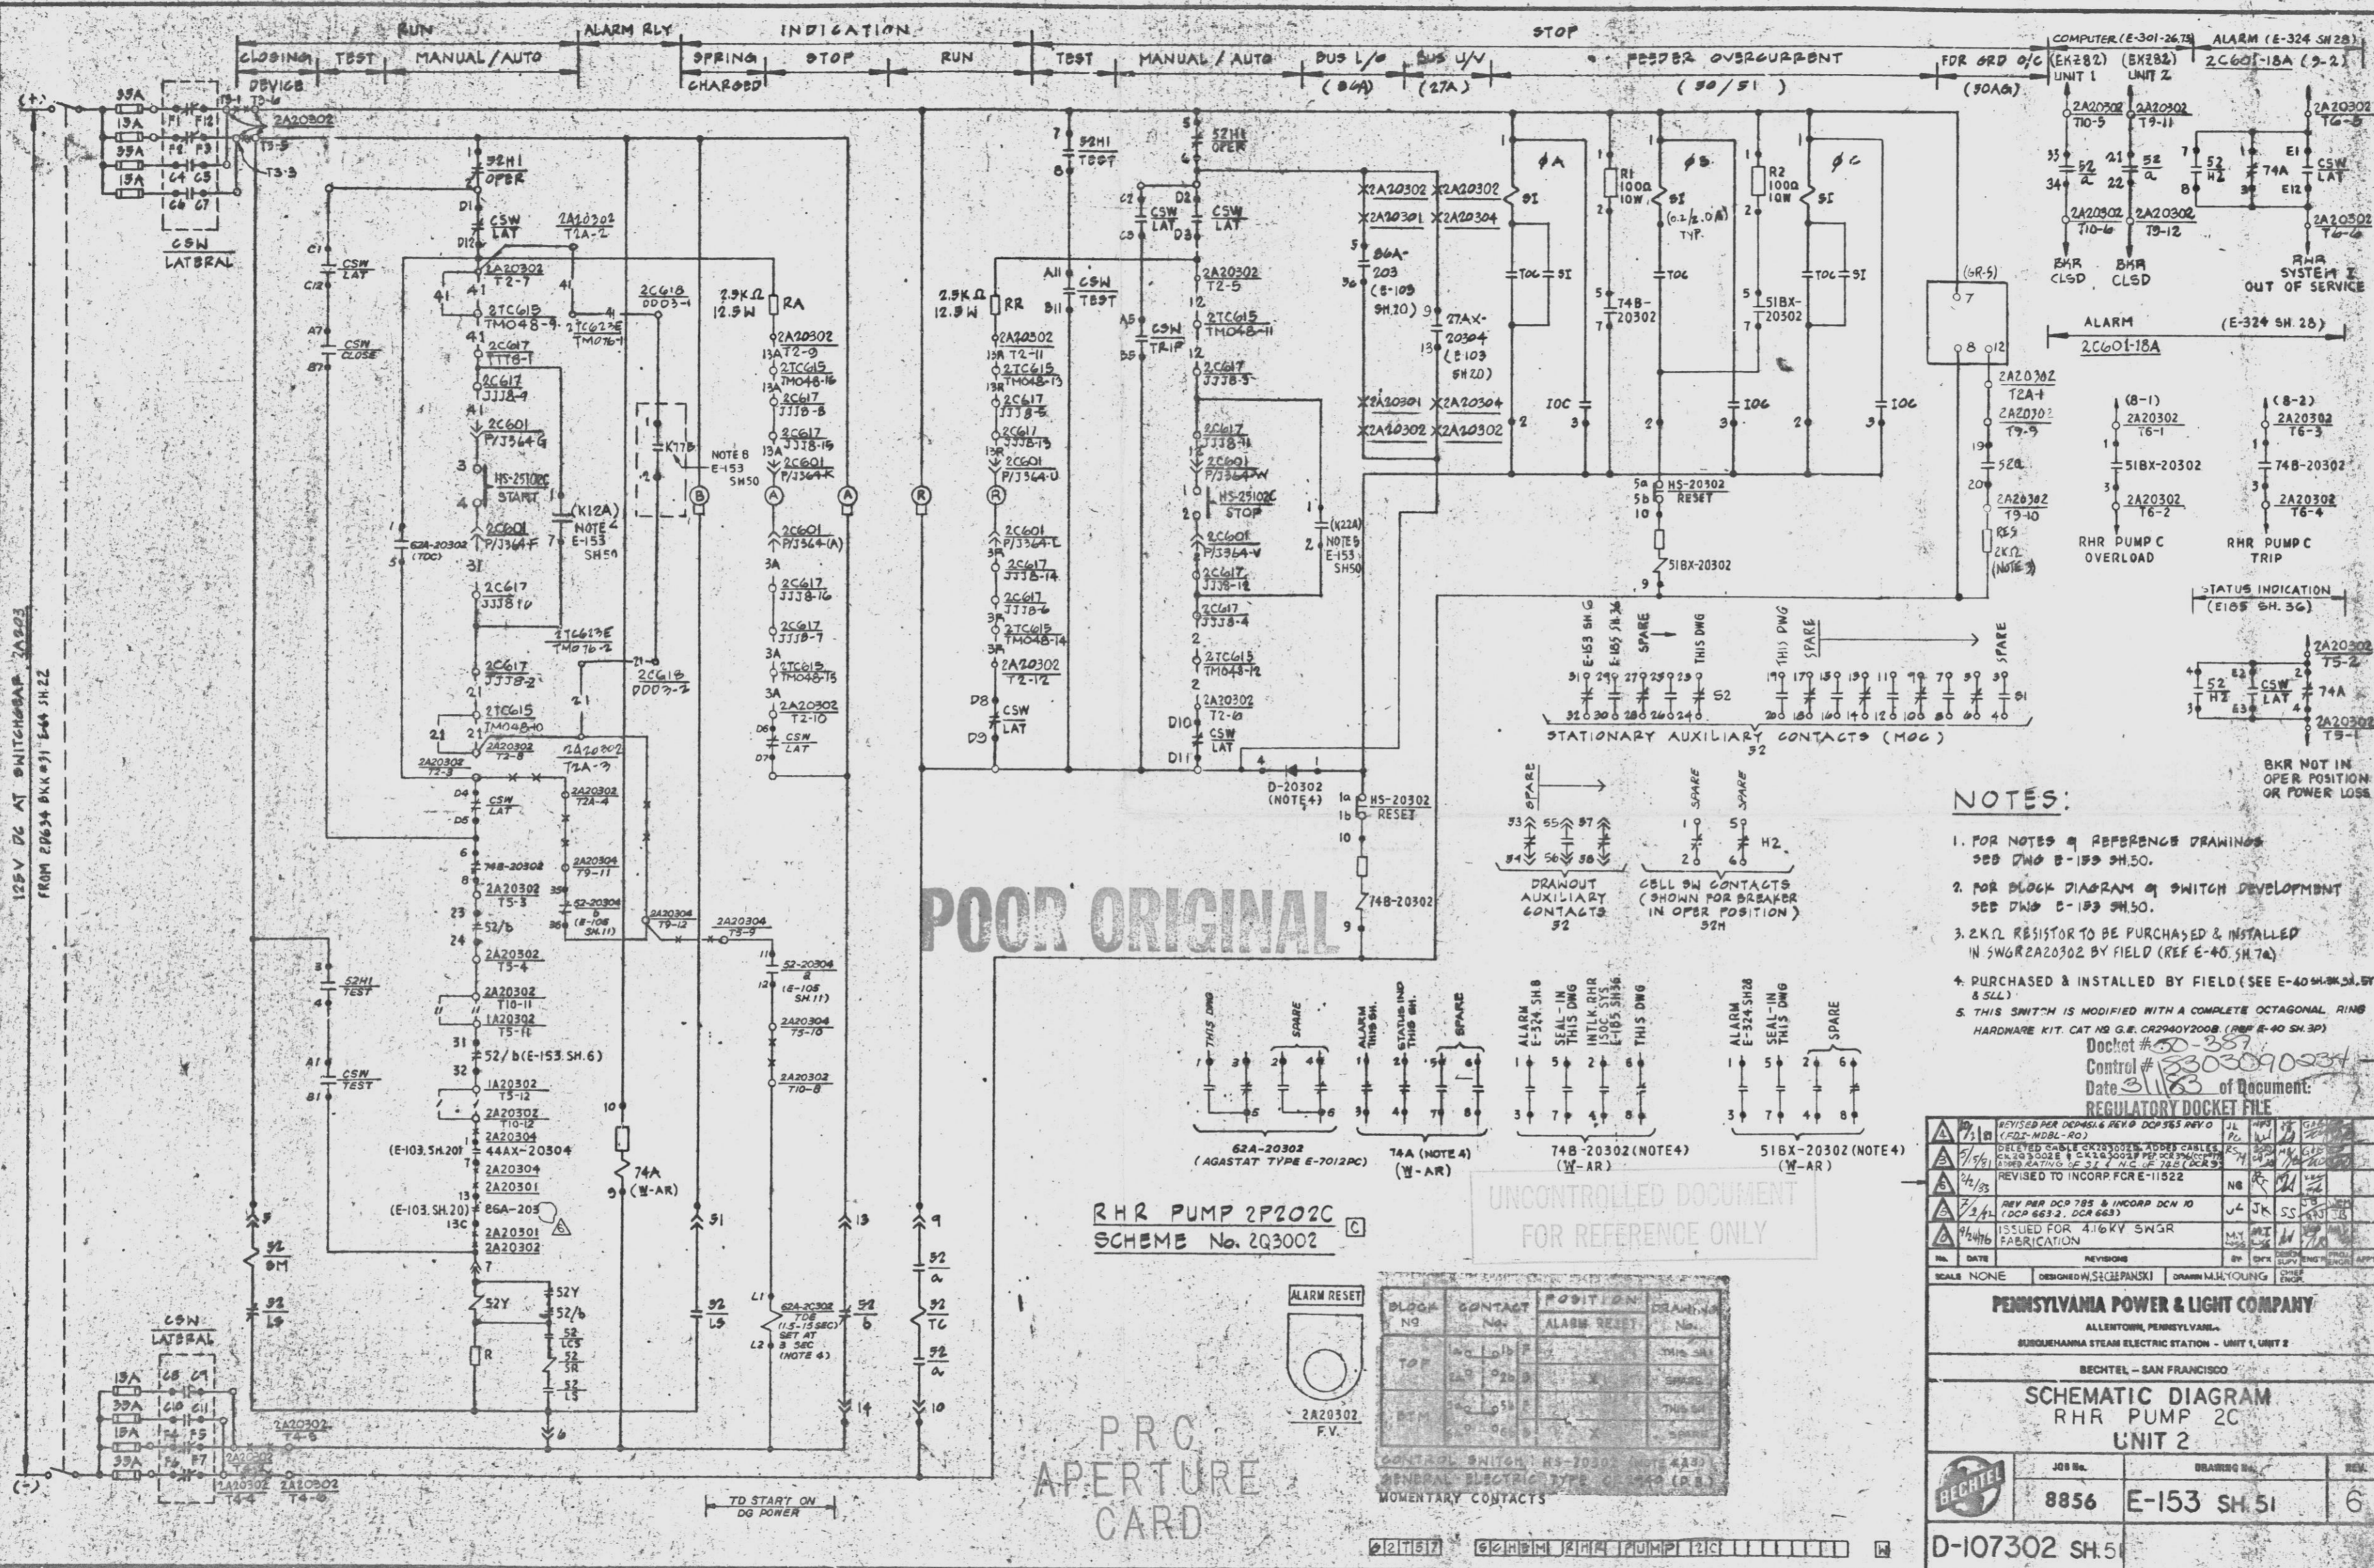

POOR ORIGINAL

P.R.C. APERTURE CARD

UNCONTROLLED DOCUMENT FOR REFERENCE ONLY

BLOCK NO.	CONTACT	POSITION	REMARKS
TOP
BOTTOM

NOTES:

- FOR NOTES & REFERENCE DRAWINGS SEE DWG B-153 SH.50.
- FOR BLOCK DIAGRAM OF SWITCH DEVELOPMENT SEE DWG B-153 SH.50.
- 2.9KΩ RESISTOR TO BE PURCHASED & INSTALLED IN SWGR2A20302 BY FIELD (REF E-40 SH.7A).
- PURCHASED & INSTALLED BY FIELD (SEE E-40 SH.5A, 5B & 5C).
- THIS SWITCH IS MODIFIED WITH A COMPLETE OCTAGONAL RING HARDWARE KIT. CAT. NO. G.E. CR2040Y2008 (REF E-40 SH.3P).
DocRef # 330309024
Date 3/1/83 of Document: REGULATORY DOCKET FILE

PENNSYLVANIA POWER & LIGHT COMPANY ALLENTOWN, PENNSYLVANIA SUSQUEHANNA STEAM ELECTRIC STATION - UNIT 1, UNIT 2 BECHTEL - SAN FRANCISCO			
SCHEMATIC DIAGRAM RHR PUMP 2C UNIT 2			
JOB No. 8856	DRAWING No. E-153 SH.51	SHEET No. 6	
D-107302 SH.51			

24X

I certify that the microfilm image contained on this microform were made in the normal and regular course of business. This is a true, full, correct and complete reproduction and replacement for and/or in lieu of original documents generated by the Bechtel group of companies.
Signed: **DANNY** Date: **2-4-83** Camera Type: **MRC1**
Camera Operator