

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8807050530 DOC. DATE: 88/06/24 NOTARIZED: YES DOCKET #

FACIL: 50-259 Browns Ferry Nuclear Power Station, Unit 1, Tennessee 05000259

50-260 Browns Ferry Nuclear Power Station, Unit 2, Tennessee 05000260

50-296 Browns Ferry Nuclear Power Station, Unit 3, Tennessee 05000296

AUTH. NAME AUTHOR AFFILIATION
 GRIDLEY, R. Tennessee Valley Authority
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to Licenses DPR-33, DPR-52 & DPR-68, clarifying LCO for RHR svc water & EECW sys.

DISTRIBUTION CODE: D030D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+15

TITLE: TVA Facilities - Routine Correspondence


NOTES: S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson 05000259 S
 B.D. Liaw, K. Barr, OI.
 S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson, 05000260 /
 B.D. Liaw, K. Barr, OI.
 S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson, 05000296 A
 B.D. Liaw, K. Barr, OI.

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTTR	ENCL	ID	CODE/NAME	LTTR	ENCL
	SIMMS, M		1	1	PD		1	1
	MORAN, D		1	1	GEARS, G		1	1
INTERNAL:	ACRS		1	1	ADM/LFMB		1	0
	AEOD		1	1	NUDOCS-ABSTRACT		1	1
	OGC 15-B-18		1	0	<u>REG FILE</u> 01		1	1
EXTERNAL:	LPDR		1	1	NRC PDR		1	1
	NSIC		1	1				
NOTES:			9	9				

w/check
\$150
#45388

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 20

R
I
D
S
/
A
D
D
S

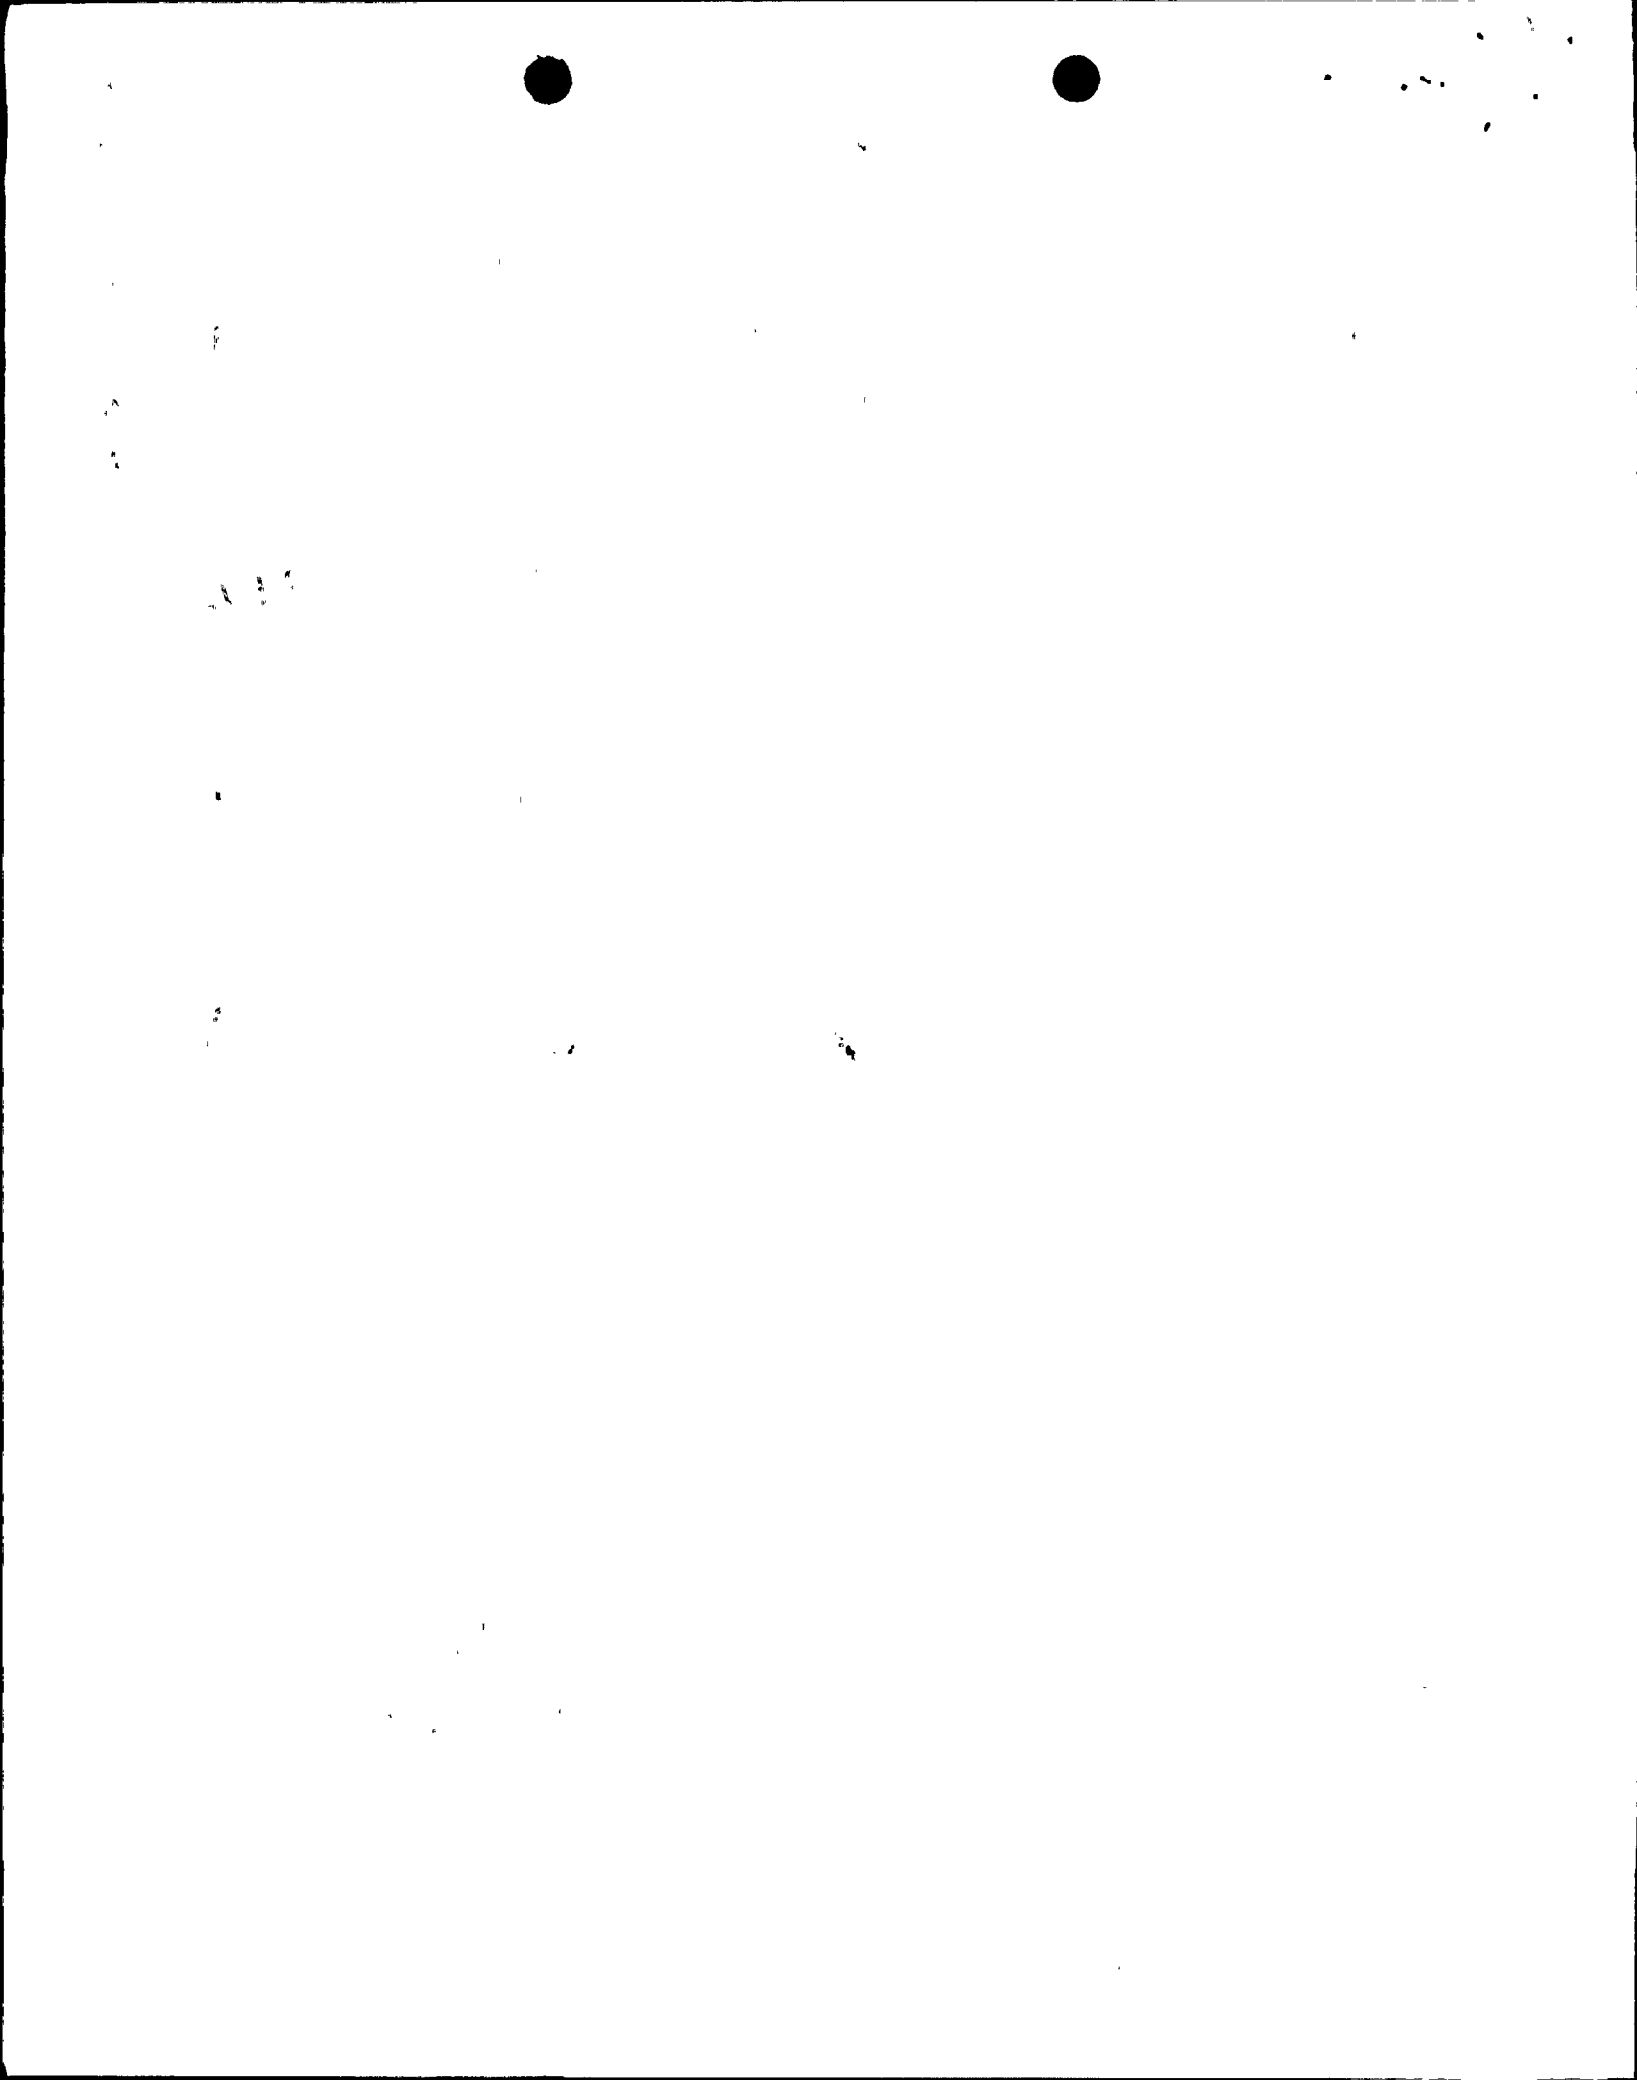

TENNESSEE VALLEY AUTHORITY

CHATTANOOGA, TENNESSEE 37401

5N 157B Lookout Place

JUN 24 1988

TVA-BFN-TS-242

10 CFR 50.90

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Gentlemen:

In the Matter of)
Tennessee Valley Authority)

Docket Nos. 50-259
50-260
50-296

BROWNS FERRY NUCLEAR PLANT (BFN) - TVA BFN TECHNICAL SPECIFICATION NO. 242 -
RESIDUAL HEAT REMOVAL SERVICE WATER (RHRSW) AND EMERGENCY EQUIPMENT COOLING
WATER (EECW) - TAC NOS. 00071, 00072, AND 00073

In accordance with the provisions of 10 CFR 50.4 and 50.90, we are submitting
a request for an amendment to licenses DPR-33, DPR-52, and DPR-68 to change
the BFN Technical Specifications for units 1, 2, and 3 (enclosure 1).

This proposed amendment will clarify the limiting conditions for operation for
the RHRSW and EECW Systems. This change has been identified as required for
restart. The description, reason for change, and justification in support of
the proposed changes are enclosed (enclosure 2). A proposed determination of
no significant hazards consideration is provided (enclosure 3).

Enclosed is a check for the \$150 amendment fee required by 10 CFR Part 170.12.
We request that these specifications be made effective 60 days after issuance
because of the number of procedure revisions required.

Very truly yours,

TENNESSEE VALLEY AUTHORITY

R. Gridley
R. Gridley, Director
Nuclear Licensing and
Regulatory Affairs

Subscribed and sworn to before me
on this 24th day of June 1988.

Paulette H. White
Notary Public

My Commission Expires 8-24-88

Enclosures:
cc: See page 2

Do 30
1/1 w/check
\$ 150
45388

1941

U.S. Nuclear Regulatory Commission

JUN 24 1988

cc (Enclosures):

Mr. K. P. Barr, Acting Assistant Director
for Inspection Programs
TVA Projects Division
U.S. Nuclear Regulatory Commission
Region II
101 Marietta Street, NW, Suite 2900
Atlanta, Georgia 30323

Mr. S. C. Black, Assistant Director
for Projects
TVA Projects Division
U.S. Nuclear Regulatory Commission
One White Flint, North
11555 Rockville Pike
Rockville, Maryland 20852

Browns Ferry Resident Inspector
Browns Ferry Nuclear Plant
Route 12, Box 637
Athens, Alabama 35611

2000