

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8807070093      DOC. DATE: 88/06/24      NOTARIZED: YES      DOCKET #  
 FACIL: 50-259 Browns Ferry Nuclear Power Station, Unit 1, Tennessee      05000259  
       50-260 Browns Ferry Nuclear Power Station, Unit 2, Tennessee      05000260  
       50-296 Browns Ferry Nuclear Power Station, Unit 3, Tennessee      05000296

AUTH. NAME                      AUTHOR AFFILIATION  
 GRIDLEY, R.                      Tennessee Valley Authority  
 RECIPIENT NAME                RECIPIENT AFFILIATION  
    Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to Licenses DPR-33, DPR-52 & DPR-68, replacing reactor water levels. Fee paid.

DISTRIBUTION CODE: D030D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 2+19  
 TITLE: TVA Facilities - Routine Correspondence


NOTES: S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson      05000259 S  
       B.D. Liaw, K. Barr, OI.  
       S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson,      05000260 /  
       B.D. Liaw, K. Barr, OI.  
       S. Black 3 cy. 1 cy. ea to: Ebnetter, Axelrad, S. Richardson,      05000296 A  
       B.D. Liaw, K. Barr, OI.

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTTR	ENCL	ID	CODE/NAME	LTTR	ENCL
	SIMMS, M		1	1	PD		1	1
	MORAN, D		1	1	GEARS, G		1	1
INTERNAL:	ACRS		1	1	ADM/LFMB		1	0
	AEOD		1	1	NUDOCS-ABSTRACT		1	1
	OGC 15-B-18		1	0	<u>REG FILE</u> 01		1	1
EXTERNAL:	LPDR		1	1	NRC PDR		1	1
	NSIC		1	1				
NOTES:			9	9				

*w/check*  
*\$ 150*  
*#45390*

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 20

R  
I  
D  
S  
  
D  
S  
  
A  
D  
S

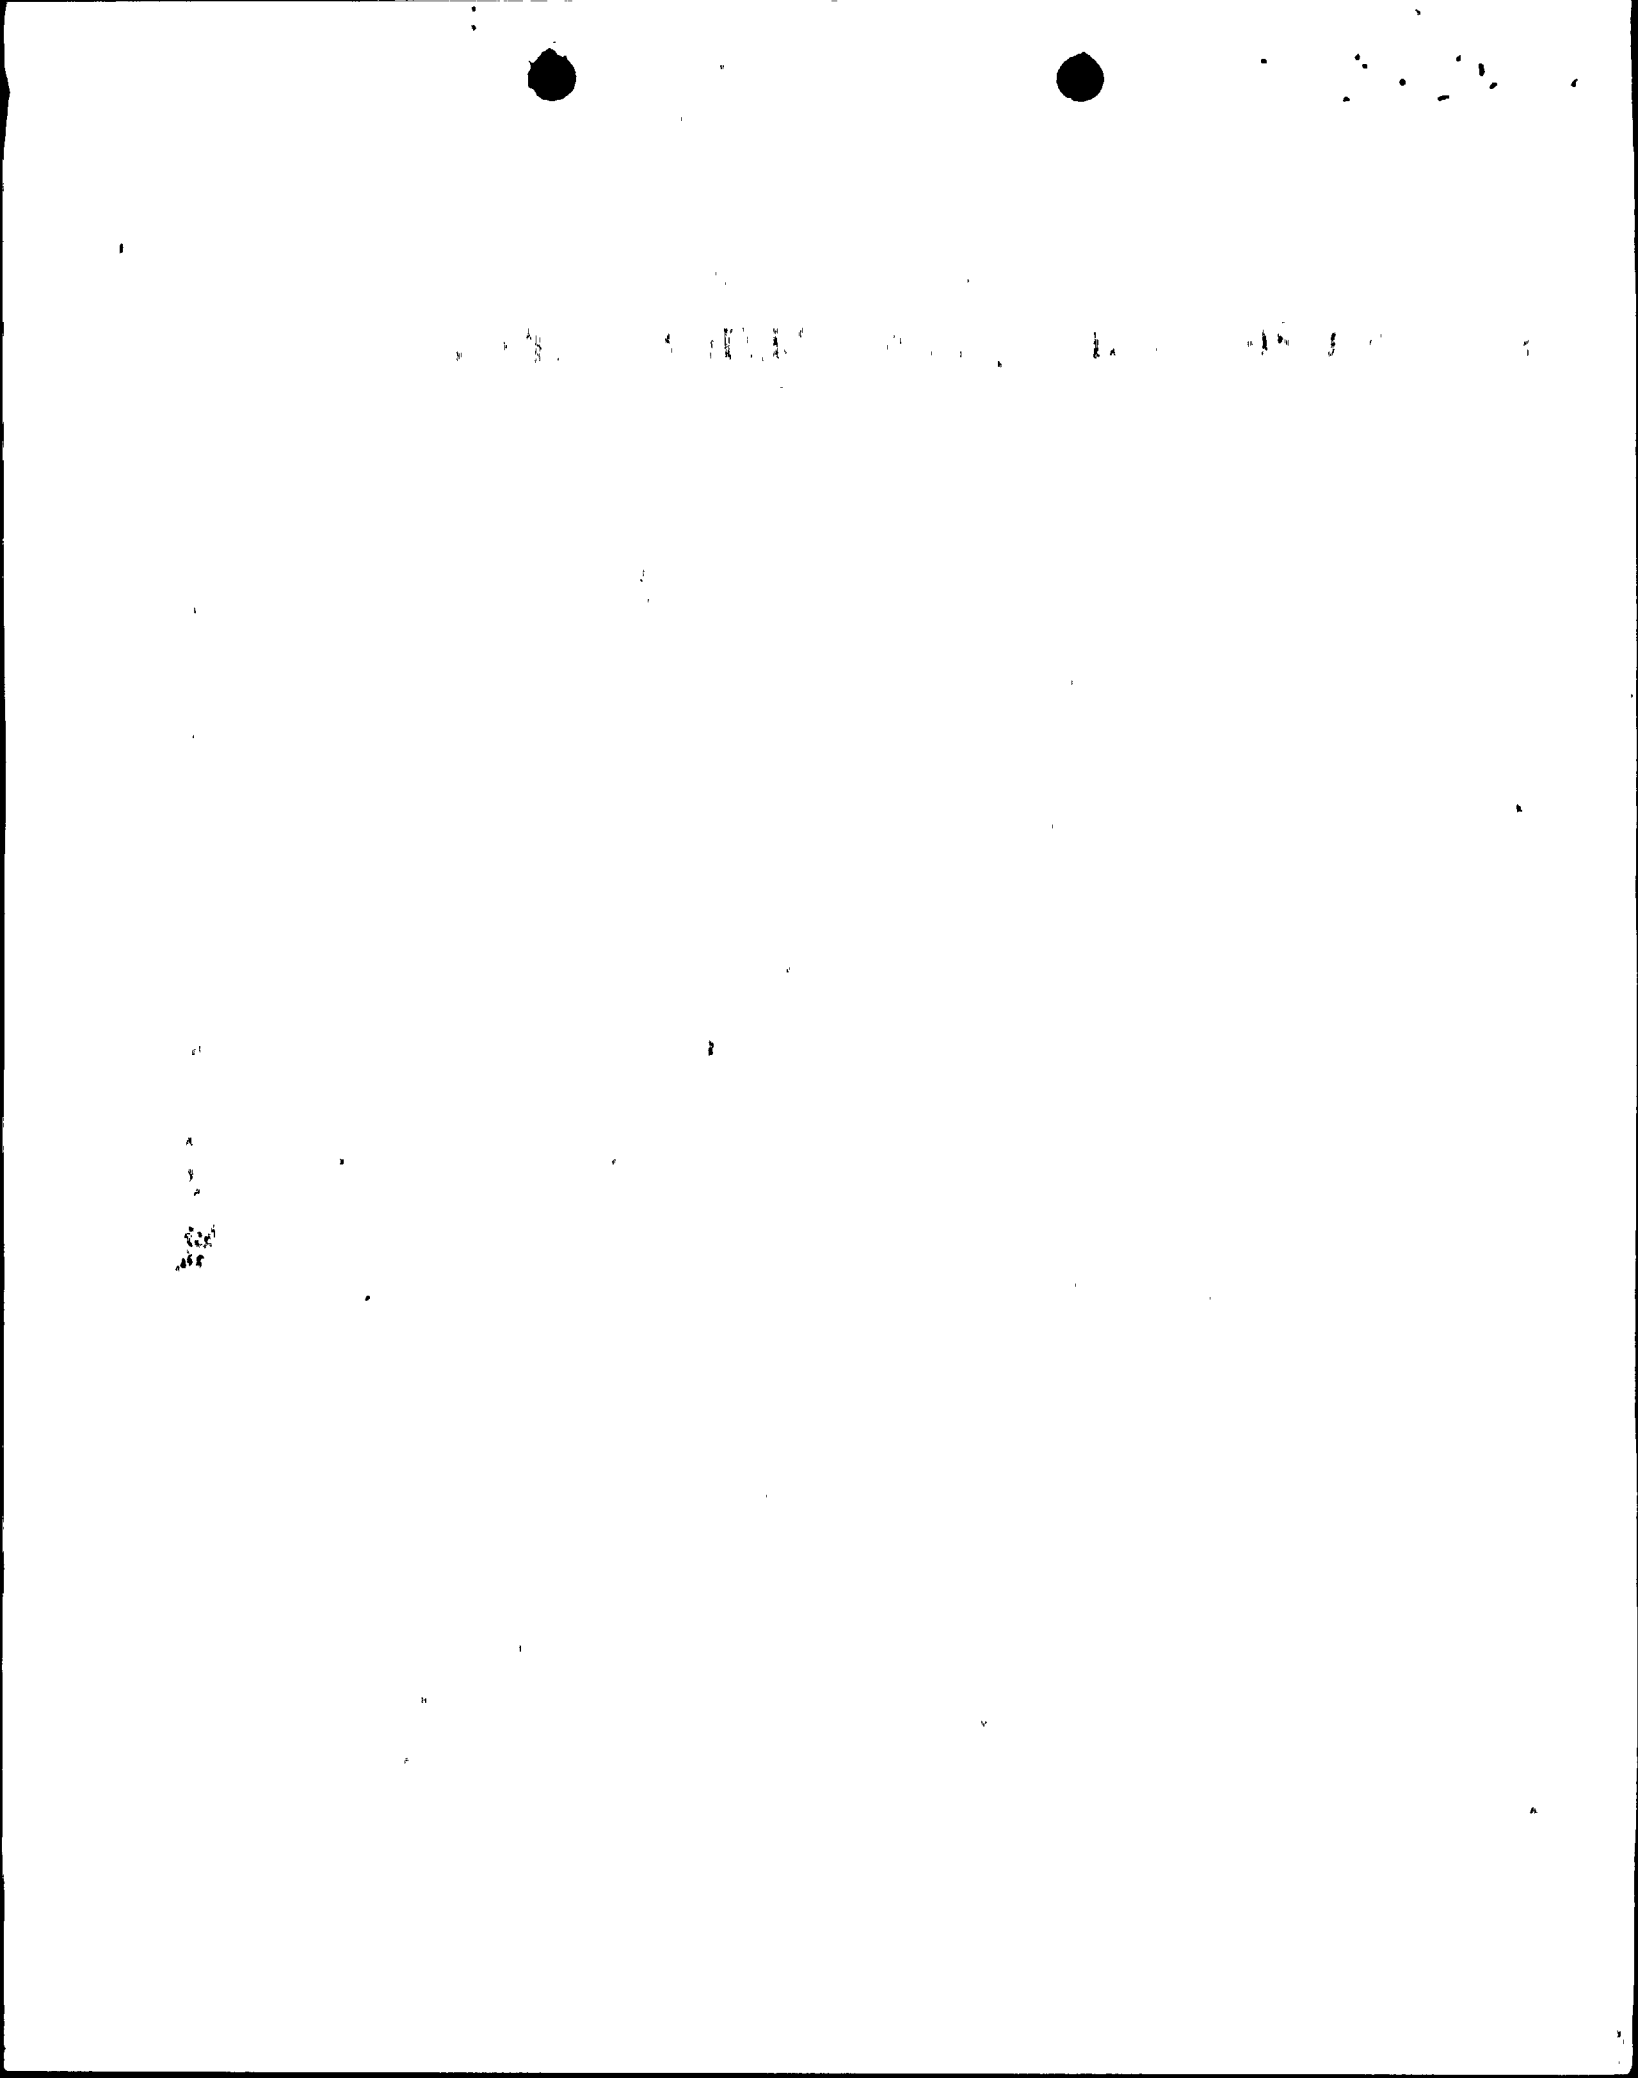

TENNESSEE VALLEY AUTHORITY

CHATTANOOGA, TENNESSEE 37401

5N 157B Lookout Place

TVA-BFN-TS-241

10 CFR 50.90

JUN 24 1988

U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, D.C. 20555

Gentlemen:

In the Matter of )  
Tennessee Valley Authority )

Docket Nos. 50-259  
50-260  
50-296

BROWNS FERRY NUCLEAR PLANT (BFN) - UNITS 1, 2, AND 3 - TVA BFN TECHNICAL SPECIFICATION NO. 241 - REACTOR WATER LEVELS - TAC NO. 00083, 00084, AND 00085

In accordance with the provisions of 10 CFR 50.4 and 50.90, we are submitting a request for an amendment to licenses DPR-33, DPR-52, and DPR-68 to change the BFN Technical Specifications for units 1, 2, and 3 (enclosure 1).

This proposed amendment replaces all water level references to the top of active fuel with the corresponding reference to vessel zero. This eliminates ambiguity in the BFN Technical Specifications. This amendment has been identified as a restart requirement. Description, reason for change, and justification are provided in enclosure 2. A proposed determination of no significant hazards consideration is provided in enclosure 3.

*Do 30 w/ check  
1/1 150  
245390*

8807070093 880624  
PDR ADOCK 05000259  
P PDC



• • • • •

[Faint, illegible text scattered across the page]


U.S. Regulatory Commission

JUN 24 1988

Enclosed is a check for the \$150 amendment fee required by 10 CFR Part 170.12. We request that these specifications be made effective 30 days after issuance.

Very truly yours,

TENNESSEE VALLEY AUTHORITY



R. Gridley, Director  
Nuclear Licensing and  
Regulatory Affairs

Subscribed and sworn to before me  
on this 24th day of June 1988.

Paulette H. White  
Notary Public

My Commission Expires 8-24-88

Enclosures

cc (Enclosures):

Mr. K. P. Barr, Acting Assistant Director  
for Inspection Programs  
TVA Projects Division  
U.S. Nuclear Regulatory Commission  
Region II  
101 Marietta Street, NW, Suite 2900  
Atlanta, Georgia 30323

Ms. S. C. Black, Assistant Director  
for Projects  
TVA Projects Division  
U.S. Nuclear Regulatory Commission  
One White Flint, North  
11555 Rockville Pike  
Rockville, Maryland 20852

Browns Ferry Resident Inspector  
Browns Ferry Nuclear Plant  
Route 12, Box 637  
Athens, Alabama 35611

cc: Continued on page 3

