

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8808030326 DOC. DATE: 88/07/29 NOTARIZED: YES DOCKET # 05000260
 FACIL: 50-260 Browns Ferry Nuclear Power Station, Unit 2, Tennessee
 AUTH. NAME AUTHORITY AFFILIATION
 GRIDLEY, R. Tennessee Valley Authority
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Application for amend to License DPR-52, revising trip setpoint for ADS timer.

DISTRIBUTION CODE: D030D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+16
 TITLE: TVA Facilities - Routine Correspondence

NOTES: 1 Copy each to: S. Black, J.G. Partlow, S. Richardson 05000260
 B.D. Liaw, F. McCoy.


	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL		LTTR	ENCL
	SIMMS, M PM	1	1	PD	1	1
INTERNAL:	ACRS	1	1	ADM/LFMB	1	0
	AEOD	1	1	NUDOGS-ABSTRACT	1	1
	OGC/HDS2	1	0	<u>REG FILE</u> 01	1	1
EXTERNAL:	LPDR	1	1	NRC PDR	1	1
	NSIC	1	1			
NOTES:		5	5			

*w/check \$150
#45415*

TOTAL NUMBER OF COPIES REQUIRED: LTTR 17 ENCL 15

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

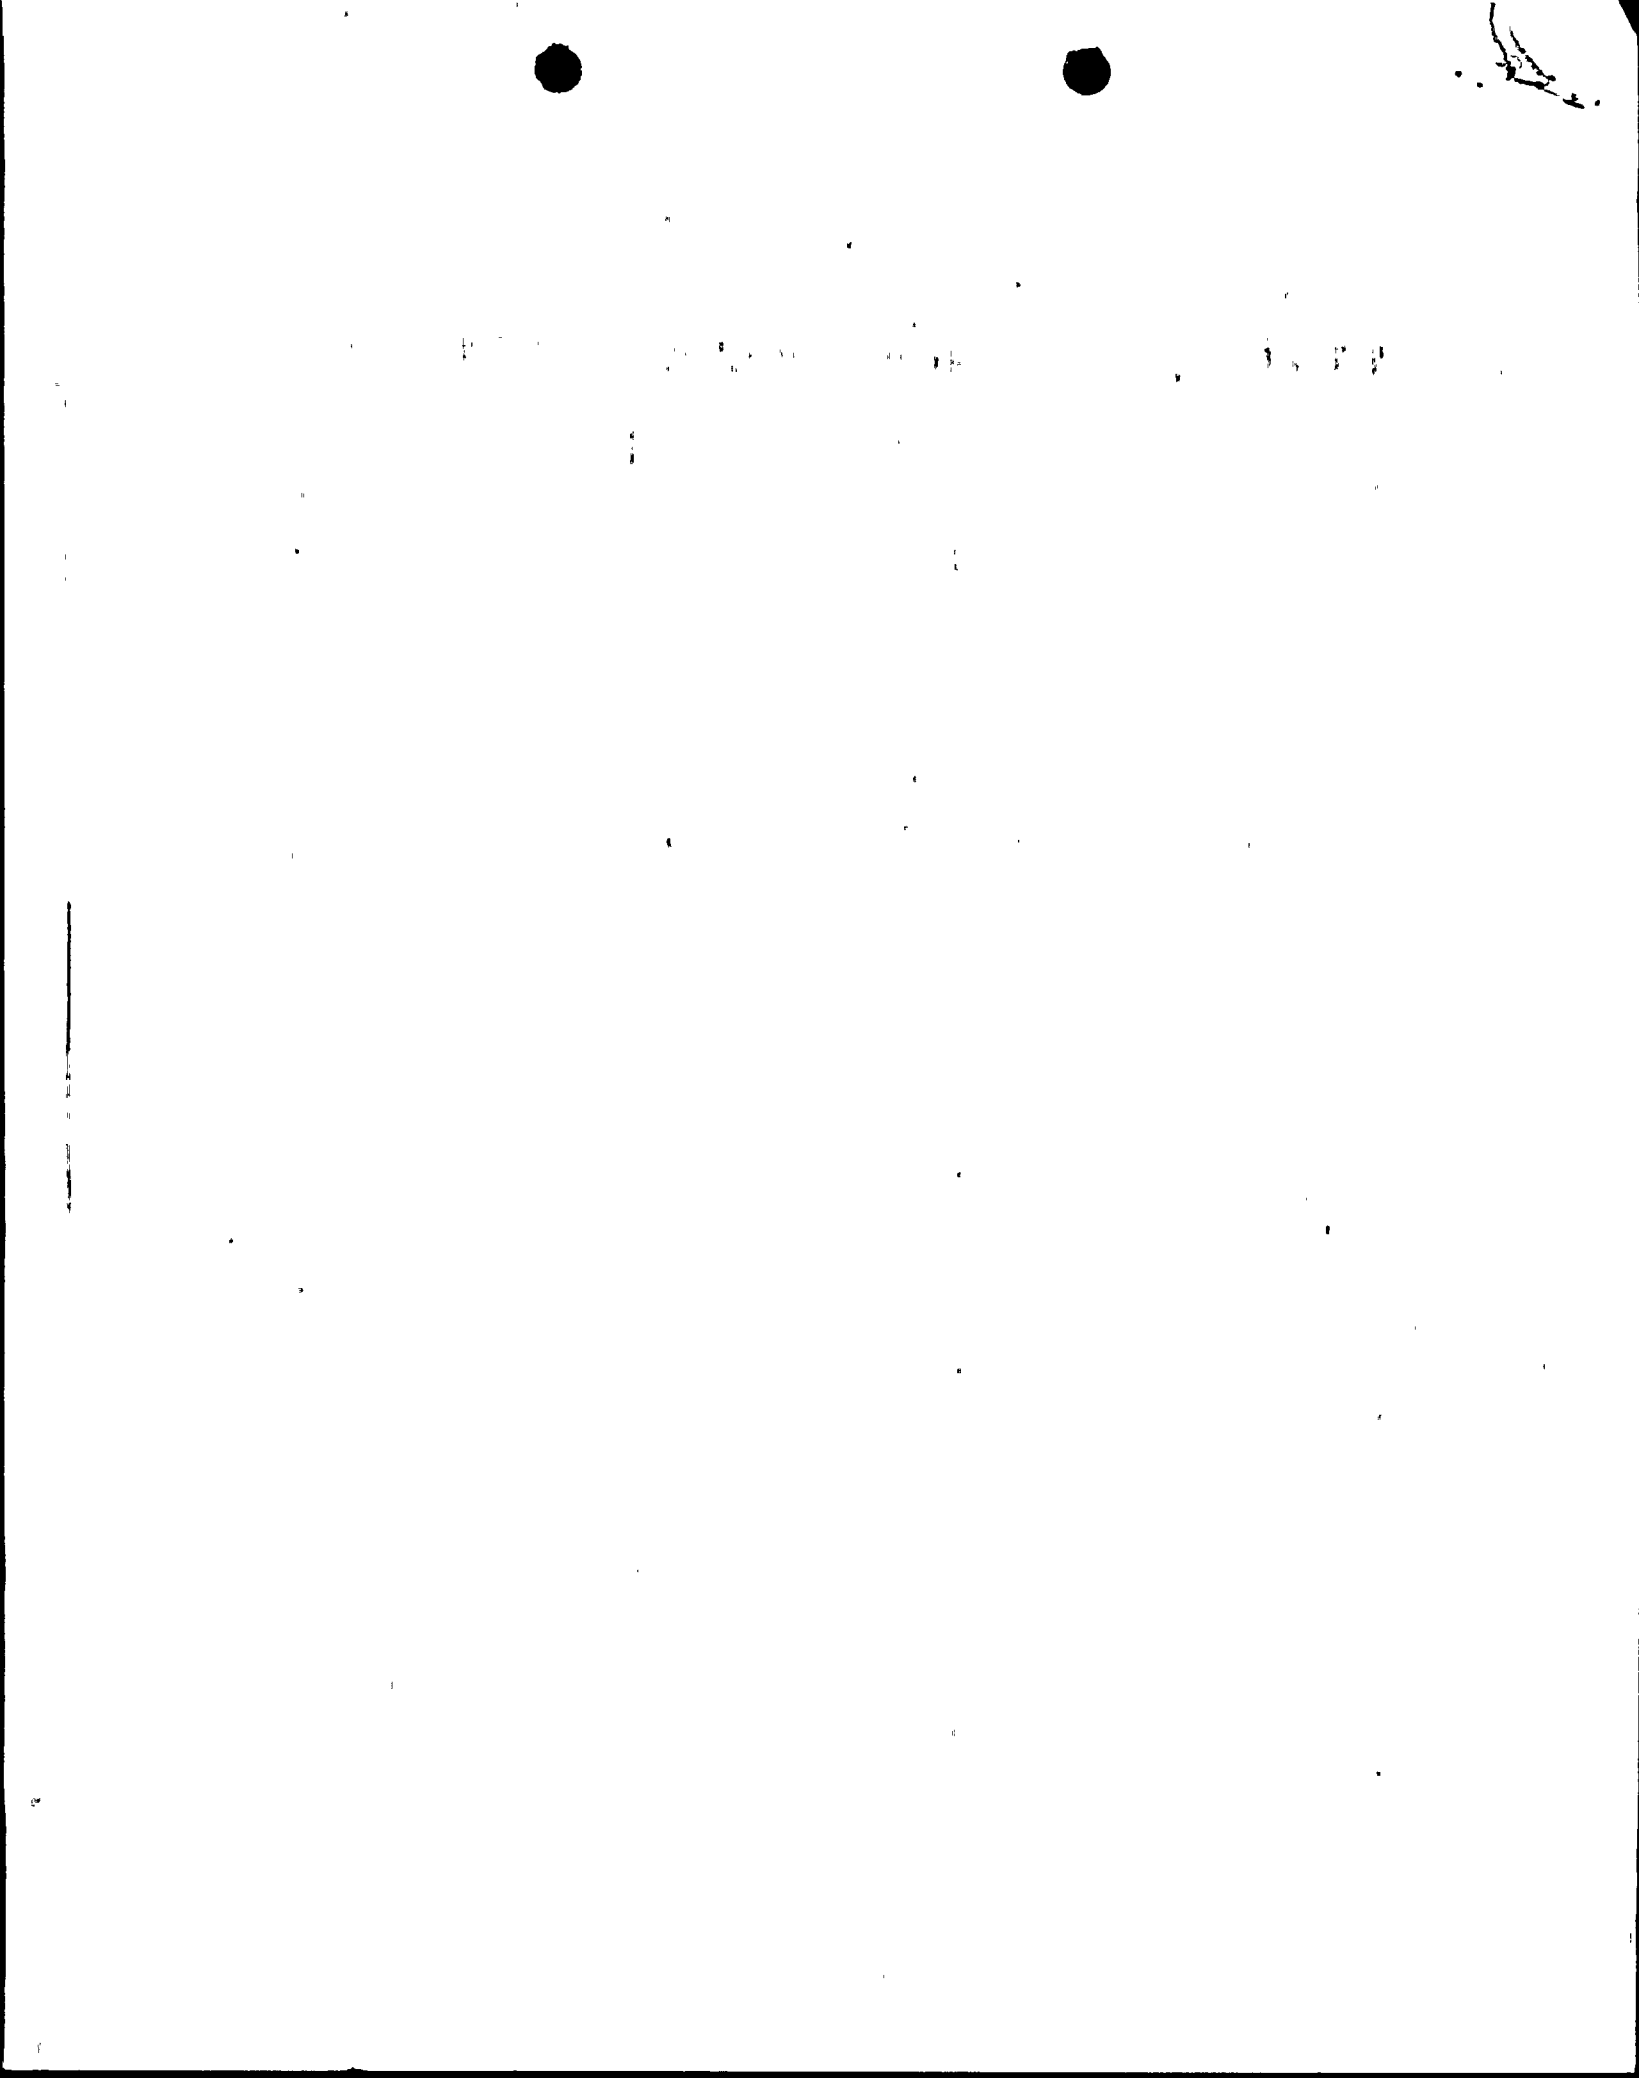

TENNESSEE VALLEY AUTHORITY

CHATTANOOGA, TENNESSEE 37401

5N-157B Lookout Place

JUL 29 1988

TVA-BFN-TS-248

10 CFR 50.90

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Gentlemen:

In the Matter of)
Tennessee Valley Authority) Docket No. 50-260

BROWNS FERRY NUCLEAR PLANT (BFN) - UNIT 2 - TVA BFN TECHNICAL SPECIFICATION
NO. 248 - AUTOMATIC DEPRESSURIZATION SYSTEM (ADS) TIMER - TAC NO. 00090

Reference: Letter from J. A. Domer to D. R. Muller dated March 5, 1987,
Browns Ferry Nuclear Plant (BFN) - Modifications to Automatic
Depressurization System (ADS) Logic - NUREG 0737, Item II.K.3.18
(L44 870305 803)

In accordance with the provisions of 10 CFR 50.4 and 50.90, we are submitting
a request for an amendment to license DPR-52 to change the BFN Technical
Specifications for unit 2 (enclosure 1).

This proposed amendment changes the trip setpoint for the existing ADS timer
and adds the surveillance and setpoint requirements for a high drywell
pressure bypass timer. This timer meets the requirements of NUREG 0737,
Item II,K.3.18. This modification was discussed in the above reference. The
specific setpoint was determined by analysis. This amendment has been
identified as a restart requirement. Description, reason for change, and
justification are provided in enclosure 2. A proposed determination of no
significant hazards consideration is provided in enclosure 3.

0030
//
w/check #150
#45415

8808030326 880729
PDR ADOCK 05000260
P PDC

U.S. Nuclear Regulatory Commission

JUL 29 1988

Enclosed is a check for the \$150 amendment fee required by 10 CFR Part 170.12. We request that these specifications be made effective 60 days after issuance.


Very truly yours,

TENNESSEE VALLEY AUTHORITY



R. Gridley, Director
Nuclear Licensing and
Regulatory Affairs

Subscribed and sworn to before me
on this 29th day of July 1988.


Notary Public

My Commission Expires 8-24-88

Enclosures

cc (Enclosures):

Ms. S. C. Black, Assistant Director
for Projects
TVA Projects Division
U.S. Nuclear Regulatory Commission
One White Flint, North
11555 Rockville Pike
Rockville, Maryland 20852

Mr. F. R. McCoy, Assistant Director
for Inspection Programs
TVA Projects Division
U.S. Nuclear Regulatory Commission
Region II
101 Marietta Street, NW, Suite 2900
Atlanta, Georgia 30323

Browns Ferry Resident Inspector
Browns Ferry Nuclear Plant
Route 12, Box 637
Athens, Alabama 35611



11

11

11

11

11

11

11

11

11

11

11

11

11