

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: B610070229 DOC. DATE: 86/09/26 NOTARIZED: YES DOCKET #
 FACIL: 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moha 05000410
 AUTH. NAME AUTHOR AFFILIATION
 MANGAN, C. V. Niagara Mohawk Power Corp.
 RECIP. NAME RECIPIENT AFFILIATION
 ADENSAM, E. G. BWR Project Directorate 3

SUBJECT: Forwards changes to FSAR, providing consistency between wording in Tech Specs & FSAR, per discussions w/NRC & util consistency review. Changes will be incorporated in future FSAR update.

DISTRIBUTION CODE: B001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 6
 TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence

NOTES:

	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTR	ENCL		LTR	ENCL
	BWR EB	1	1	BWR EICSB	2	2
	BWR FOB	1	1	BWR PD3 LA	1	1
	BWR PD3 PD	1	1	HAUGHEY, N 01	2	2
	BWR PSB	1	1	BWR RSB	1	1
INTERNAL:	ACRS 41	6	6	ADM/LFMB	1	0
	ELD/HDS3	1	0	IE FILE	1	1
	IE/DEPER/EPB 36	1	1	IE/DGAVT/QAB 21	1	1
	NRR BWR ADTS	1	0	NRR PWR-B ADTS	1	0
	NRR BOE N. L	1	1	NRR/DHFT/MTB	1	1
	<u>REG FILE</u> 04	1	1	RGN1	3	3
	RM/DDAMI/MIB	1	0			
EXTERNAL:	BNL (AMDTS ONLY)	1	1	DMB/DSS (AMDTS)	1	1
	LPDR 03	1	1	NRC PDR 02	1	1
	NSIC 05	1	1	PNL GRUEL, R	1	1

Faint header text at the top of the page, possibly including a title or reference number.

Second section of faint text, appearing as a list or series of entries.

Third section of faint text, continuing the list or series of entries.

Fourth section of faint text, possibly a concluding paragraph or summary.

Fifth section of faint text, appearing as a list or series of entries.

Sixth section of faint text, continuing the list or series of entries.

Final section of faint text at the bottom of the page, possibly a footer or signature.

September 26, 1986
(NMP2L 0888)

Ms. Elinor G. Adensam, Director
BWR Project Directorate No. 3
U.S. Nuclear Regulatory Commission
7920 Norfolk Avenue
Washington, DC 20555

Dear Ms. Adensam:

Re: Nine Mile Point Unit 2
Docket No. 50-410

As a result of discussions with the Nuclear Regulatory Commission staff and our consistency review between the Final Safety Analysis Report and the Technical Specifications, we are providing the attached changes to the Final Safety Analysis Report. These changes provide consistency between the wording in the Technical Specifications and the Final Safety Analysis Report.

These changes will be incorporated into a future update to the Final Safety Analysis Report.

Very truly yours,

C. V. Mangan

C. V. Mangan
Senior Vice President

KWK/pns
2093G
Attachment

xc: W. A. Cook, NRC Resident Inspector
Project File (2)

8610070229 860926
PDR ADOCK 05000410
A PDR

Boo1
/1



100

100

UNITED STATES OF AMERICA
NUCLEAR REGULATORY COMMISSION

In the Matter of)
Niagara Mohawk Power Corporation)
(Nine Mile Point Unit 2))

Docket No. 50-410

AFFIDAVIT

C. V. Mangan, being duly sworn, states that he is Senior Vice President of Niagara Mohawk Power Corporation; that he is authorized on the part of said Corporation to sign and file with the Nuclear Regulatory Commission the documents attached hereto; and that all such documents are true and correct to the best of his knowledge, information and belief.


C. V. Mangan

Subscribed and sworn to before me, a Notary Public in and for the State of New York and County of Onondaga, this 26th day of September, 1986.

Janis M. Macro
Notary Public in and for
Onondaga County, New York

My Commission expires:
JANIS M. MACRO

Notary Public in the State of New York
Qualified in Onondaga County No. 4784555
My Commission Expires March 30, 1987...



SUBJECT: Justifications for changes to FSAR Figure 9.5-52C and FSAR Table 11.5-2

The changes to FSAR Figure 9.5-52C and FSAR Table 11.5-2 are provided in order to make the FSAR consistent with Technical Specification Table 4.11.1, Item 2.d.


Nine Mile Point Unit 2 FSAR

TABLE 11.5-2 (Cont)

<u>Sample Point Location (No.)</u>	<u>Grab Sample at Sample Station</u>	<u>Local Grab Sample</u>	<u>Grab Sample at Radiation Monitor</u>
Anion regeneration tank effluent	X	-	-
Recovered acid tank effluent	-	X	-
Regeneration system effluent	X	-	-
Ultrasonic resin cleaner resin receiver tank effluent	X	-	-
Ultrasonic resin cleaner resin effluent	X	-	-
Low conductivity waste tank effluent	X	-	-
Demineralizer waste neutralizing tank effluent	X	-	-
Dilute acid effluent	X	X	-
Recovered caustic tank effluent	-	X	-
Dilute caustic effluent	X	X	-
Recovered water sump effluent	-	X	-
<u>Condensate Makeup and Drawoff System</u>			
Condensate transfer line	X	-	-
<u>Makeup Water System</u>			
Demineralizer water transfer line	X	-	-
<u>Condensate System</u>			
Condensate pump discharge	X	-	-
Condenser hotwells (6)	-	-	-
LP heater drains (3)	X	-	-
Common effluent fourth point heaters	X	-	-
LP heater string common effluent	X	-	-
<u>Reactor Feedwater System</u>			
Feedwater (after last heater)	X	-	-
<u>Circulating Water System</u>			
Effluent (blowdown line)	-	X	X
<u>Auxiliary Steam System</u>			
Auxiliary boiler (steam outlet)	X	-	-
Feedwater (pump discharge)	X	-	-
Auxiliary boiler (blowdown)	-	X	-
Auxiliary boiler recirc pump seal heat exchanger outlet and sample cooler discharge (Service Water) (4)	-	X	-



The page is otherwise blank, with only minor scanning artifacts and a few small dark specks visible.

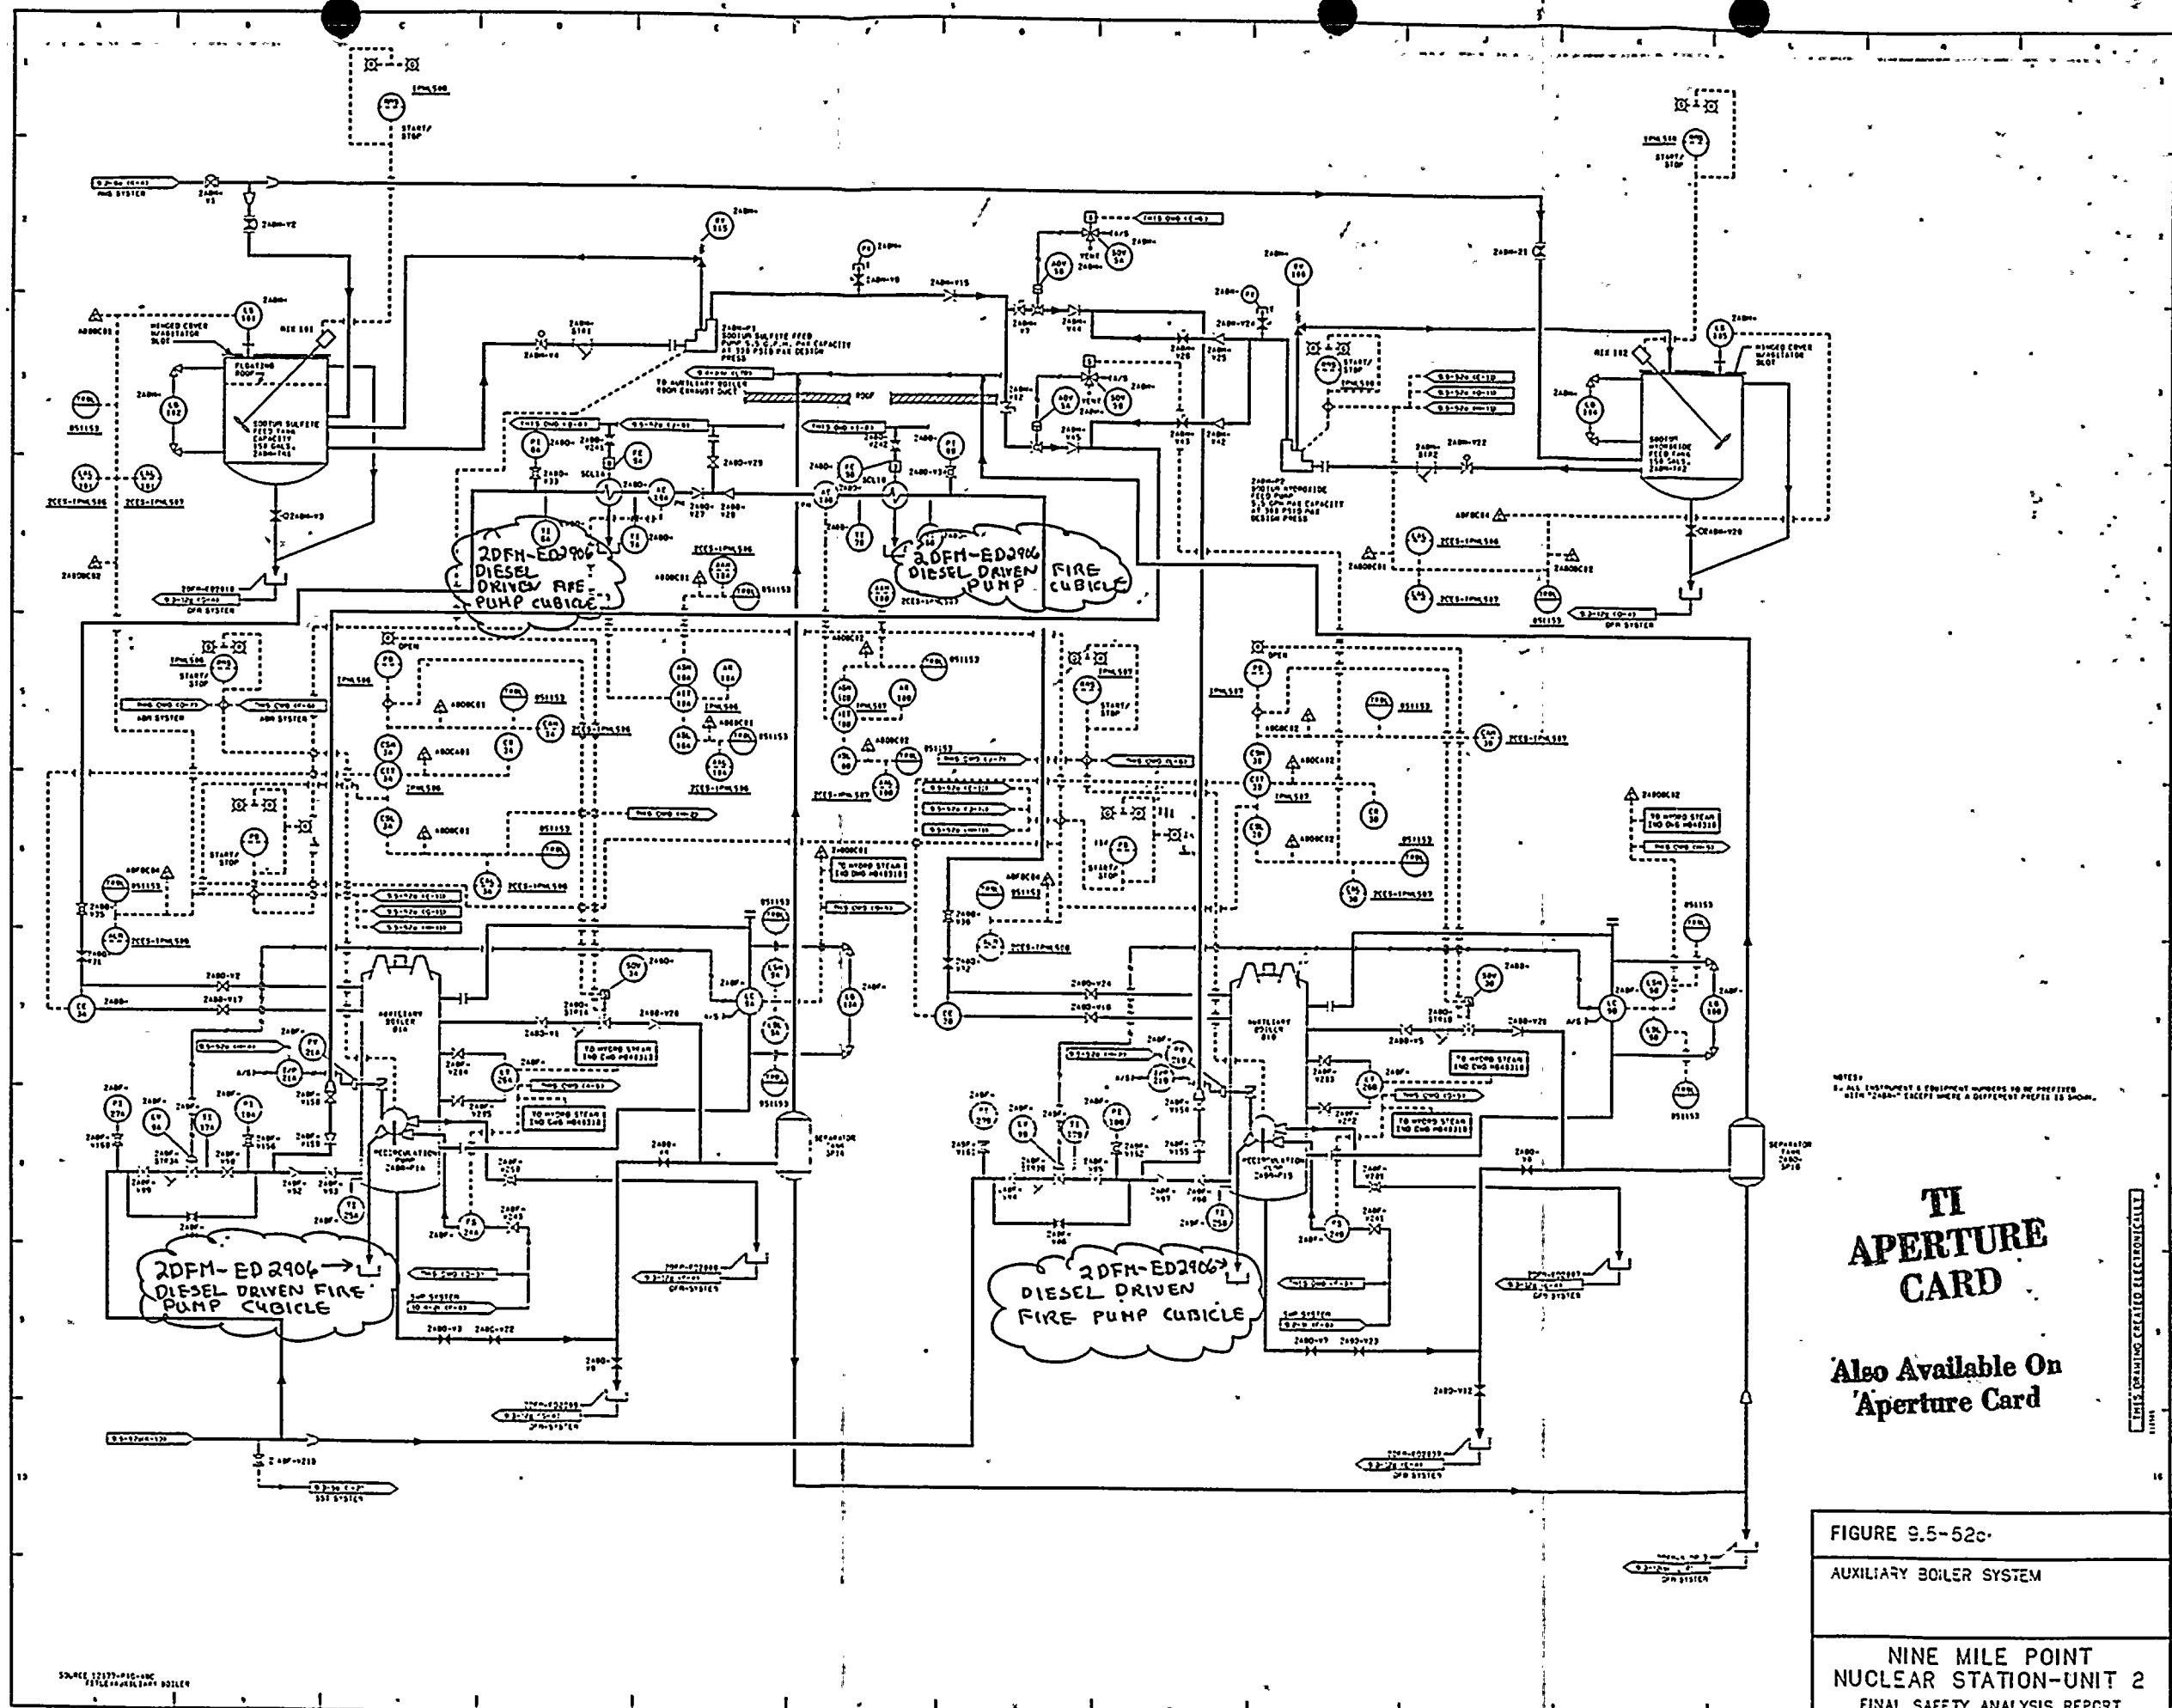

NOTES:
 1. ALL INSTRUMENT & EQUIPMENT NUMBERS SHOWN ARE PREFIXED WITH "2400" EXCEPT WHERE A DIFFERENT PREFIX IS SHOWN.

TI APERTURE CARD

Also Available On Aperture Card

FIGURE 9.5-52c
 AUXILIARY BOILER SYSTEM

NINE MILE POINT
 NUCLEAR STATION-UNIT 2
 FINAL SAFETY ANALYSIS REPORT

8610070229-01

SOURCE: 22177-P10-40C
 TITLE: AUXILIARY BOILER