

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9809100270 DOC.DATE: 98/09/01 NOTARIZED: NO DOCKET #
FACIL:50-260 Browns Ferry Nuclear Power Station, Unit 2, Tennessee 05000260
.50-296 Browns Ferry Nuclear Power Station, Unit 3, Tennessee 05000296
AUTH.NAME AUTHOR AFFILIATION
ABNEY,T.E. Tennessee Valley Authority
RECIP.NAME RECIPIENT AFFILIATION
Records Management Branch (Document Control Desk)

SUBJECT: Submits listed proposed license condition for Units 2 & 3,
lper 980828 telcon w/NRC.

DISTRIBUTION CODE: D030D COPIES RECEIVED:LTR 1 ENCL 0 SIZE: 4
TITLE: TVA Facilities - Routine Correspondence

NOTES:


	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTR	ENCL	ID	CODE/NAME	LTR	ENCL
	PD2-3		1	1	PD2-3-PD		1	1
	DEGAZIO,A		1	1				
INTERNAL:	ACRS		1	1	<u>FILE CENTER 01</u>		1	1
	OGC/HDS3		1	0	RES/DE/SSEB/SES		1	1
EXTERNAL:	NOAC		1	1	NRC PDR		1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 9 ENCL 0

C
A
T
E
G
O
R
Y
1
D
O
C
U
M
E
N
T

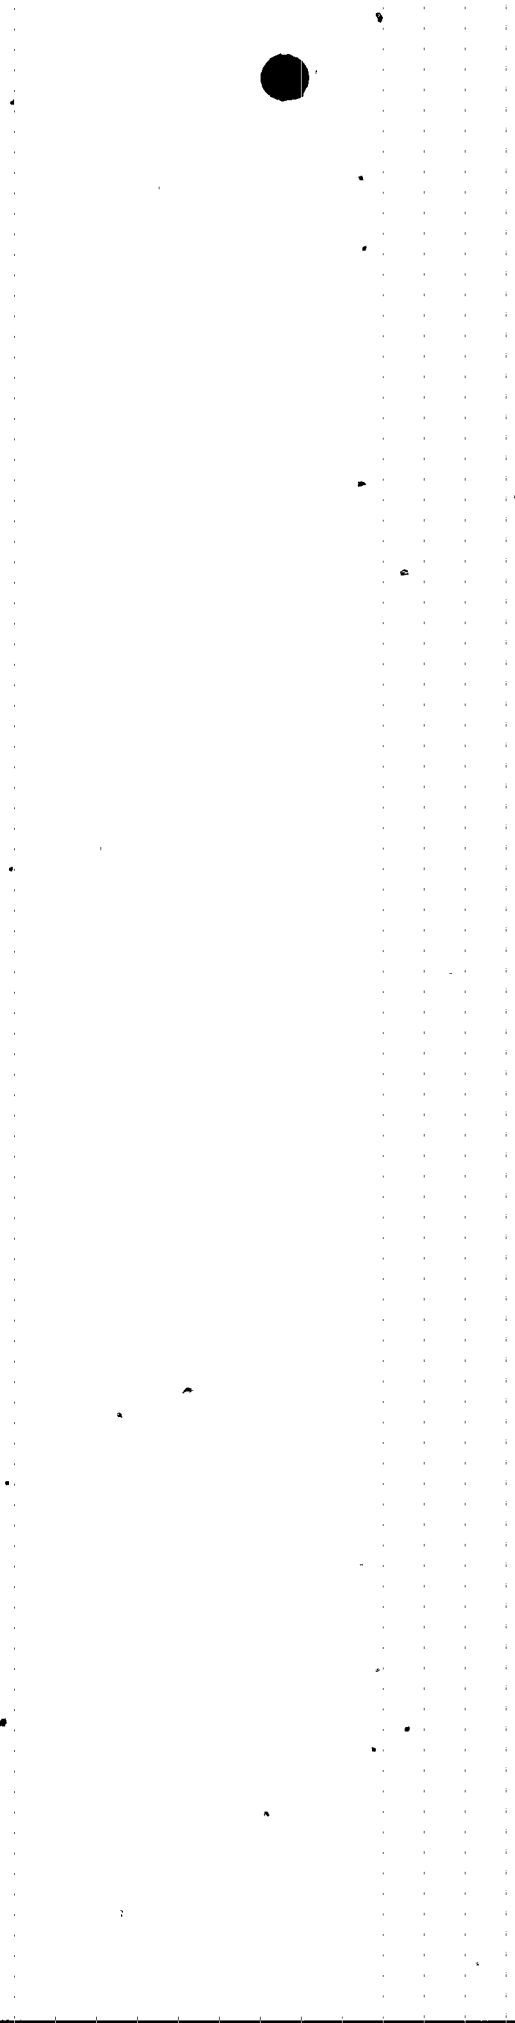



Tennessee Valley Authority, Post Office Box 2000, Decatur, Alabama 35609

September 1, 1998

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Gentlemen:

In the Matter of) Docket Nos.	50-260
Tennessee Valley Authority)	50-296

BROWNS FERRY NUCLEAR PLANT (BFN) - UNITS 2 AND 3 TECHNICAL SPECIFICATION (TS) NO. 384 - REQUEST FOR LICENSE AMENDMENT FOR POWER UPRATE OPERATION, PROPOSED OPERATING LICENSE CONDITIONS (TAC NOS. M99711 AND M99712)

On March 30, 1998, NRC requested that TVA provide additional information concerning operator training with regard to the power uprate license amendment request. NRC requested that TVA propose a license condition and/or commitment that stipulates the following:

- (a) Provide classroom and simulator training on all changes that effect operator performance caused by the power uprate modification. All training and the plant simulator will be modified, as necessary, to incorporate changes identified during the startup testing program.
- (b) Complete simulator changes that are consistent with ANSI/ANS 3.5-1985. Simulator fidelity will be re-validated in accordance with ANSI/ANS 3.5-1985, Section 5.4.1, "Simulator Performance Testing." Simulator revalidation will include comparison of individual simulated systems and components and

9809100270 980901
PDR ADDCK 05000260
V PDR

1/0
D030



simulated integrated plant steady state and transient performance with reference plant responses using similar startup test procedures.


- (c) Complete all control room and plant process computer system changes as a result of the power uprate.
- (d) Modify operator training and the plant simulator, as required, to address all related issues and discrepancies that are identified during the startup testing program.

By letter dated April 28, 1998, TVA provided additional information requested by NRC. Enclosure 2 to the April 28, 1998, letter provided the commitments requested by NRC.

Based on an August 28, 1998, telephone conversation regarding operator training with the NRC BFN Project Manager, TVA proposes the following license condition for Units 2 and 3 power uprate:

"Classroom and simulator training on all power uprate related changes that affect operator performance will be conducted prior to operating at uprated conditions. Simulator changes that are consistent with power uprate conditions will be made and simulator fidelity will be validated in accordance with ANSI/ANS 3.5-1985. Training and the plant simulator will be modified, as necessary to incorporate changes identified during startup testing."

TVA notes that changes to the plant simulator control room and simulator process computer have been completed.



4 0


U. S. Nuclear Regulatory Commission

Page 3

September 1, 1998

If you have any questions about this change, please telephone me at (256) 729-2636.

Sincerely,

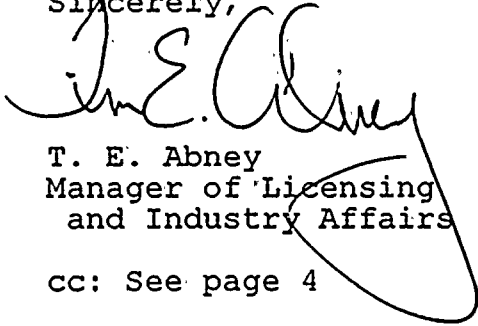A handwritten signature in black ink, appearing to read "T. E. Abney". The signature is written in a cursive style and is positioned above the typed name and title.

T. E. Abney
Manager of Licensing
and Industry Affairs

cc: See page 4



U. S. Nuclear Regulatory Commission
Page 4
September 1, 1998

cc: Harold O. Christensen, Branch Chief
U.S. Nuclear Regulatory Commission
Region II
61 Forsyth Street, S. W.
Suite 23T85
Atlanta, Georgia 30303

NRC Resident Inspector
Browns Ferry Nuclear Plant
10833 Shaw Road
Athens, Alabama 35611

Mr. Albert W. De Agazio, Project Manager
U.S. Nuclear Regulatory Commission
One White Flint, North
11555 Rockville Pike
Rockville, Maryland 20852

Mr. L. Raghaván, Project Manager
U.S. Nuclear Regulatory Commission
One White Flint, North
11555 Rockville Pike
Rockville, Maryland 20852



42