


EXTRACTORS  
109-CBE-8X  
TYP 2 PLCS.

928-127-20

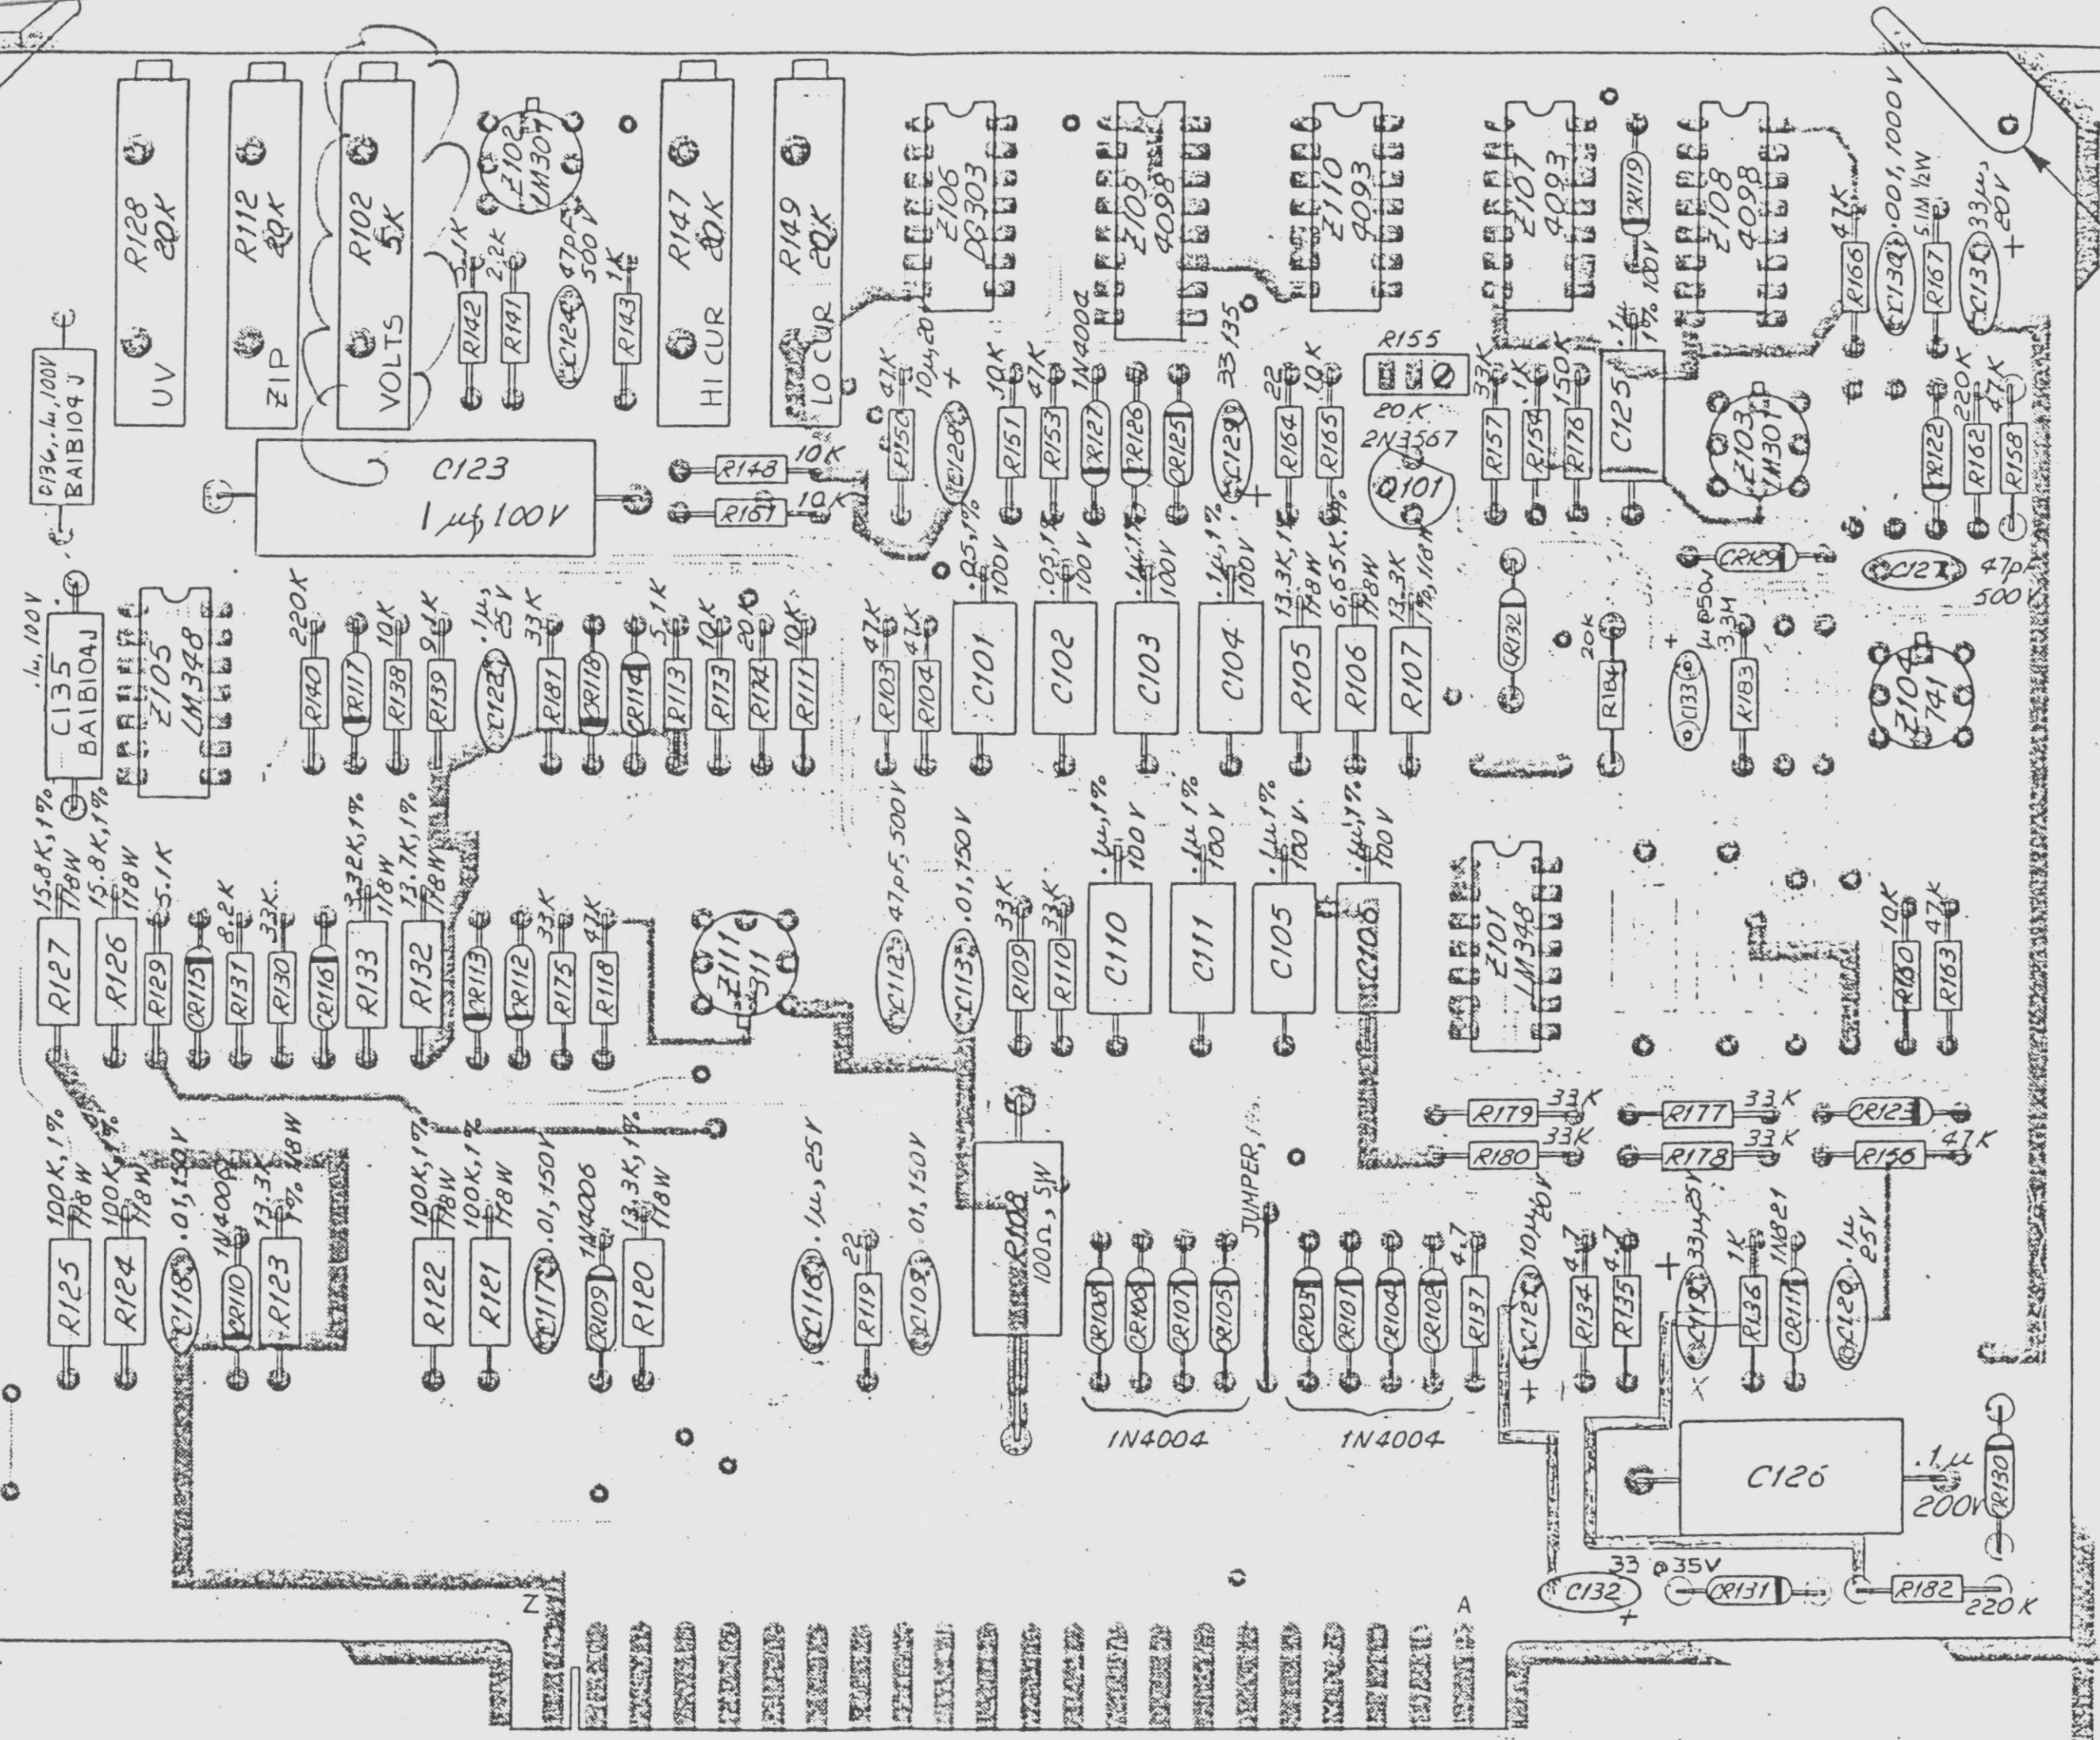

SI  
APERTURE  
CARD

50-410  
9111070103  
10/31/91

**NUCLEAR SAFETY RELATED**

FOR PARTS LIST SEE PL

- NOTES: UNLESS OTHERWISE SPECIFIED.
1. ALL DIODES ARE 1N914
  2. ALL RESISTORS ARE 1/4 W, 5%.
  3. CAPACITOR VALUES ARE IN MICROFARADS.
  4. CONFORMAL COAT PER ELGAR SPEC 1005029
  5. FOR SCHEMATIC SEE DWG 628-127-6X.
  6. IDENTIFY APPLICABLE DASH NO & REV.

FOR INFORMATION ONLY

CONTRACT NO. 510 A093-2	
FIRST MADE FOR:	
APPROVAL:	DATE
DRAWN DIETTER	6-15-82
CHECKED SCAR	6-17-82
PROJ ENG SCAR	6-17-82
QA-REL	6/23/82

**ELGAR CORPORATION**  
SAN DIEGO, CALIFORNIA

PAGE 14

PWM, ANALOG LOGIC  
UPS 103-1-176

SIZE	CODE IDENT. NO.	DRAWING NO.	REV.
C	25965	644-014-40	B

9305070222

07-703-91  
D