



This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, nor used except in the limited way and private use permitted by any written consent given by the lender to the borrower.

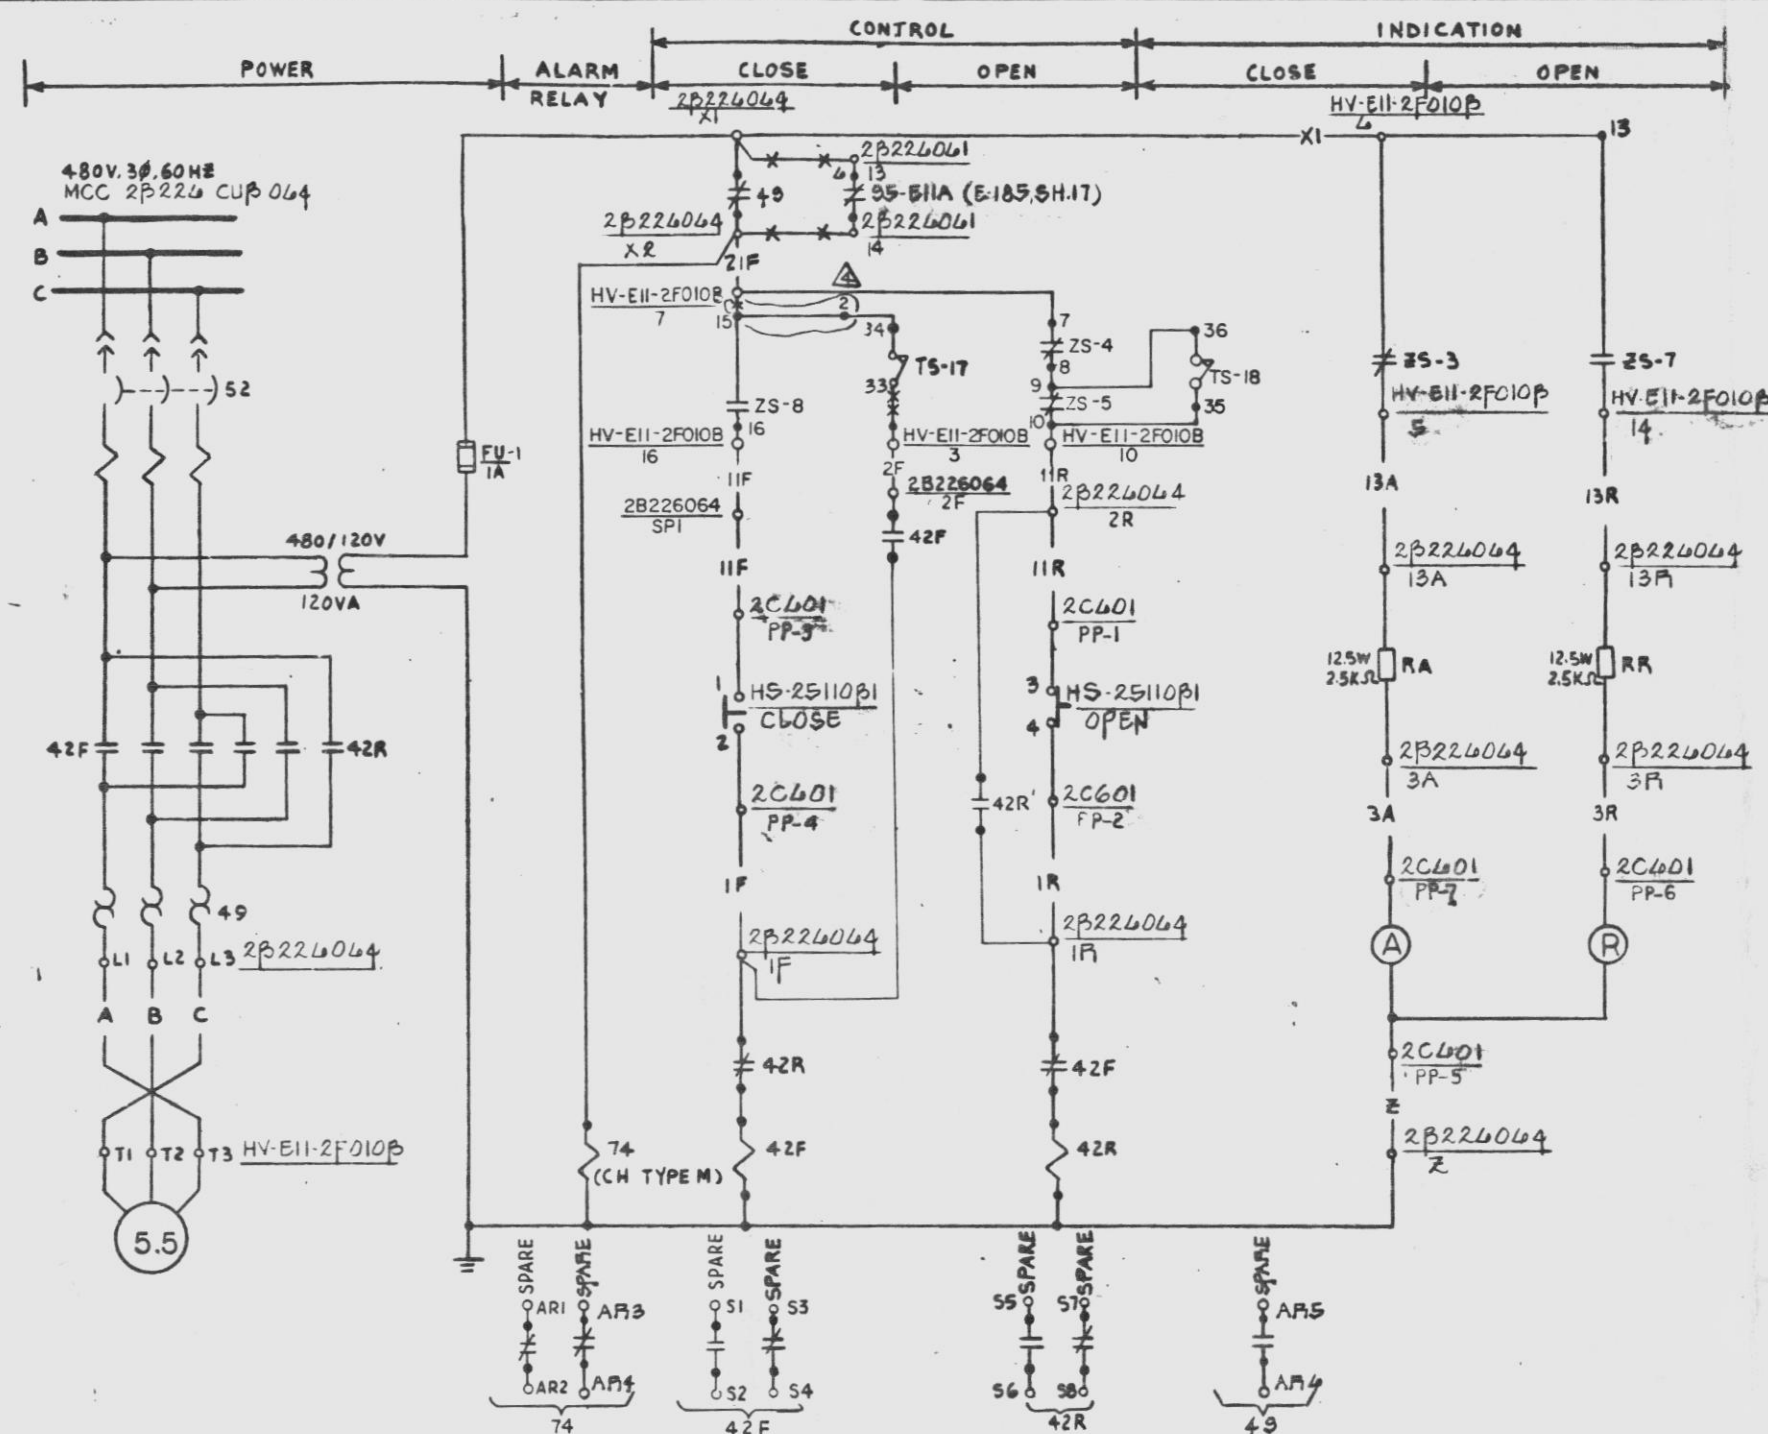

RHR CROSS HEADER SHUTOFF VALVE HV-E11-2F010B II

SCHEME No. 2A3021
REV. SH.13

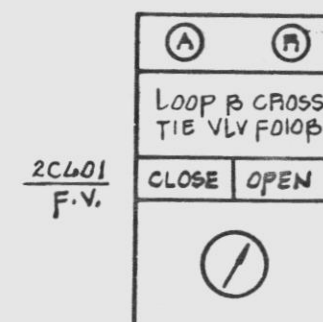

BLOCK No.	CONTACT No.	POSITION	DRAWING No.
TOP	10-02 F	X	THIS SH
BTM	30-04 B	X	THIS SH
	50-06 F	X	SPARE
	70-08 B	X	E-324 SH36

CONTROL SWITCH: HS-25110P1
GENERAL ELECTRIC TYPE CR2940
MAINTAINED CONTACTS; KEY REMOVABLE
IN OPEN.

VALVE LIMIT SWITCH DEVELOPMENT			
CONTACTS	100% OPEN	INTERMEDIATE	100% CONTACT CLOSED
TS-1 10-11-08			SPARE
TS-2 10-11-04			SPARE
TS-3 10-11-06			THIS SH
TS-4 70-11-08			THIS SH
TS-5 90-11-10			THIS SH
TS-6 110-11-08			SPARE
TS-7 190-11-04			THIS SH
TS-8 150-11-06			THIS SH
TS-9 170-11-08			SPARE
TS-10 190-11-08			SPARE
TS-11 110-11-08			SPARE
TS-12 190-11-08			SPARE
TS-13 190-11-08			SPARE
TS-14 170-11-08			SPARE
TS-15 190-11-08			SPARE
TS-16 110-11-08			SPARE
TS-17 190-11-08			THIS SH
TS-18 190-11-08			SPARE
CONTACT CLOSED			

HV-E11-2F010B

NOTES

- FOR STANDARD SYMBOLS FOR ELECTRICAL DIAGRAMS SEE DWG E-42.
- ALL DEVICE NOS TO BE SUFFIXED BY STARTER LOCATION NO. UNLESS NOTED OTHERWISE.
- DESIGN BASED ON GE/APED ELEMENTARY T91E418AE (V/P 8856-MI-E11-29J).
- FIELD TO DISCONNECT VENDOR JUMPER BETWEEN VALVE TERMINAL 1 & TERMINAL 33.
- FOR SPACE HEATER POWER SUPPLY, SEE DWG. E-241 SH.13.

Docket # 50-387
Control # 8303090234 (167)
Date 3/1/85 of Document
REGULATORY DOCKET FILE

REFERENCE DWG'S	
BECHTEL NO.	PL. NO.
E-42	A-107191
8856-MI-EH-29	FF 124510
E-185	D-107334

PRC
APERTURE
CARD

POOR ORIGINAL

UNCONTROLLED DOCUMENT
FOR REFERENCE ONLY

REVISION	DATE	BY	CHKD	APPD
1/1/85				
2/1/85				
3/1/85				
4/1/85				
5/1/85				
6/1/85				
7/1/85				
8/1/85				
9/1/85				
10/1/85				
11/1/85				
12/1/85				
13/1/85				
14/1/85				
15/1/85				
16/1/85				
17/1/85				
18/1/85				
19/1/85				
20/1/85				
21/1/85				
22/1/85				
23/1/85				
24/1/85				
25/1/85				
26/1/85				
27/1/85				
28/1/85				
29/1/85				
30/1/85				
31/1/85				
32/1/85				
33/1/85				
34/1/85				
35/1/85				
36/1/85				
37/1/85				
38/1/85				
39/1/85				
40/1/85				
41/1/85				
42/1/85				
43/1/85				
44/1/85				
45/1/85				
46/1/85				
47/1/85				
48/1/85				
49/1/85				
50/1/85				
51/1/85				
52/1/85				
53/1/85				
54/1/85				
55/1/85				
56/1/85				
57/1/85				
58/1/85				
59/1/85				
60/1/85				
61/1/85				
62/1/85				
63/1/85				
64/1/85				
65/1/85				
66/1/85				
67/1/85				
68/1/85				
69/1/85				
70/1/85				
71/1/85				
72/1/85				
73/1/85				
74/1/85				
75/1/85				
76/1/85				
77/1/85				
78/1/85				
79/1/85				
80/1/85				
81/1/85				
82/1/85				
83/1/85				
84/1/85				
85/1/85				
86/1/85				
87/1/85				
88/1/85				
89/1/85				
90/1/85				
91/1/85				
92/1/85				
93/1/85				
94/1/85				
95/1/85				
96/1/85				
97/1/85				
98/1/85				
99/1/85				
100/1/85				

PENNSYLVANIA POWER & LIGHT COMPANY

ALLENTOWN, PENNSYLVANIA
SUSQUEHANNA STEAM ELECTRIC STATION - UNIT 1, UNIT 2

BECHTEL - SAN FRANCISCO

SCHEMATIC DIAGRAM
RHR CROSS HEADER SHUTOFF VALVE
UNIT 2

JOB No.	DRAWING No.	REV.
8856	E-153 SH 103	4

D-107302 SH103

24X

I certify that the microfilm image contained on this microform were made in the normal and regular course of business. This is a true, full, correct and complete reproduction and replacement for and/or in lieu of original documents generated by the Bechtel group of companies.

Signature: P.C. AKIN Date: 1/18/85 Camera Type: MRG 1

D