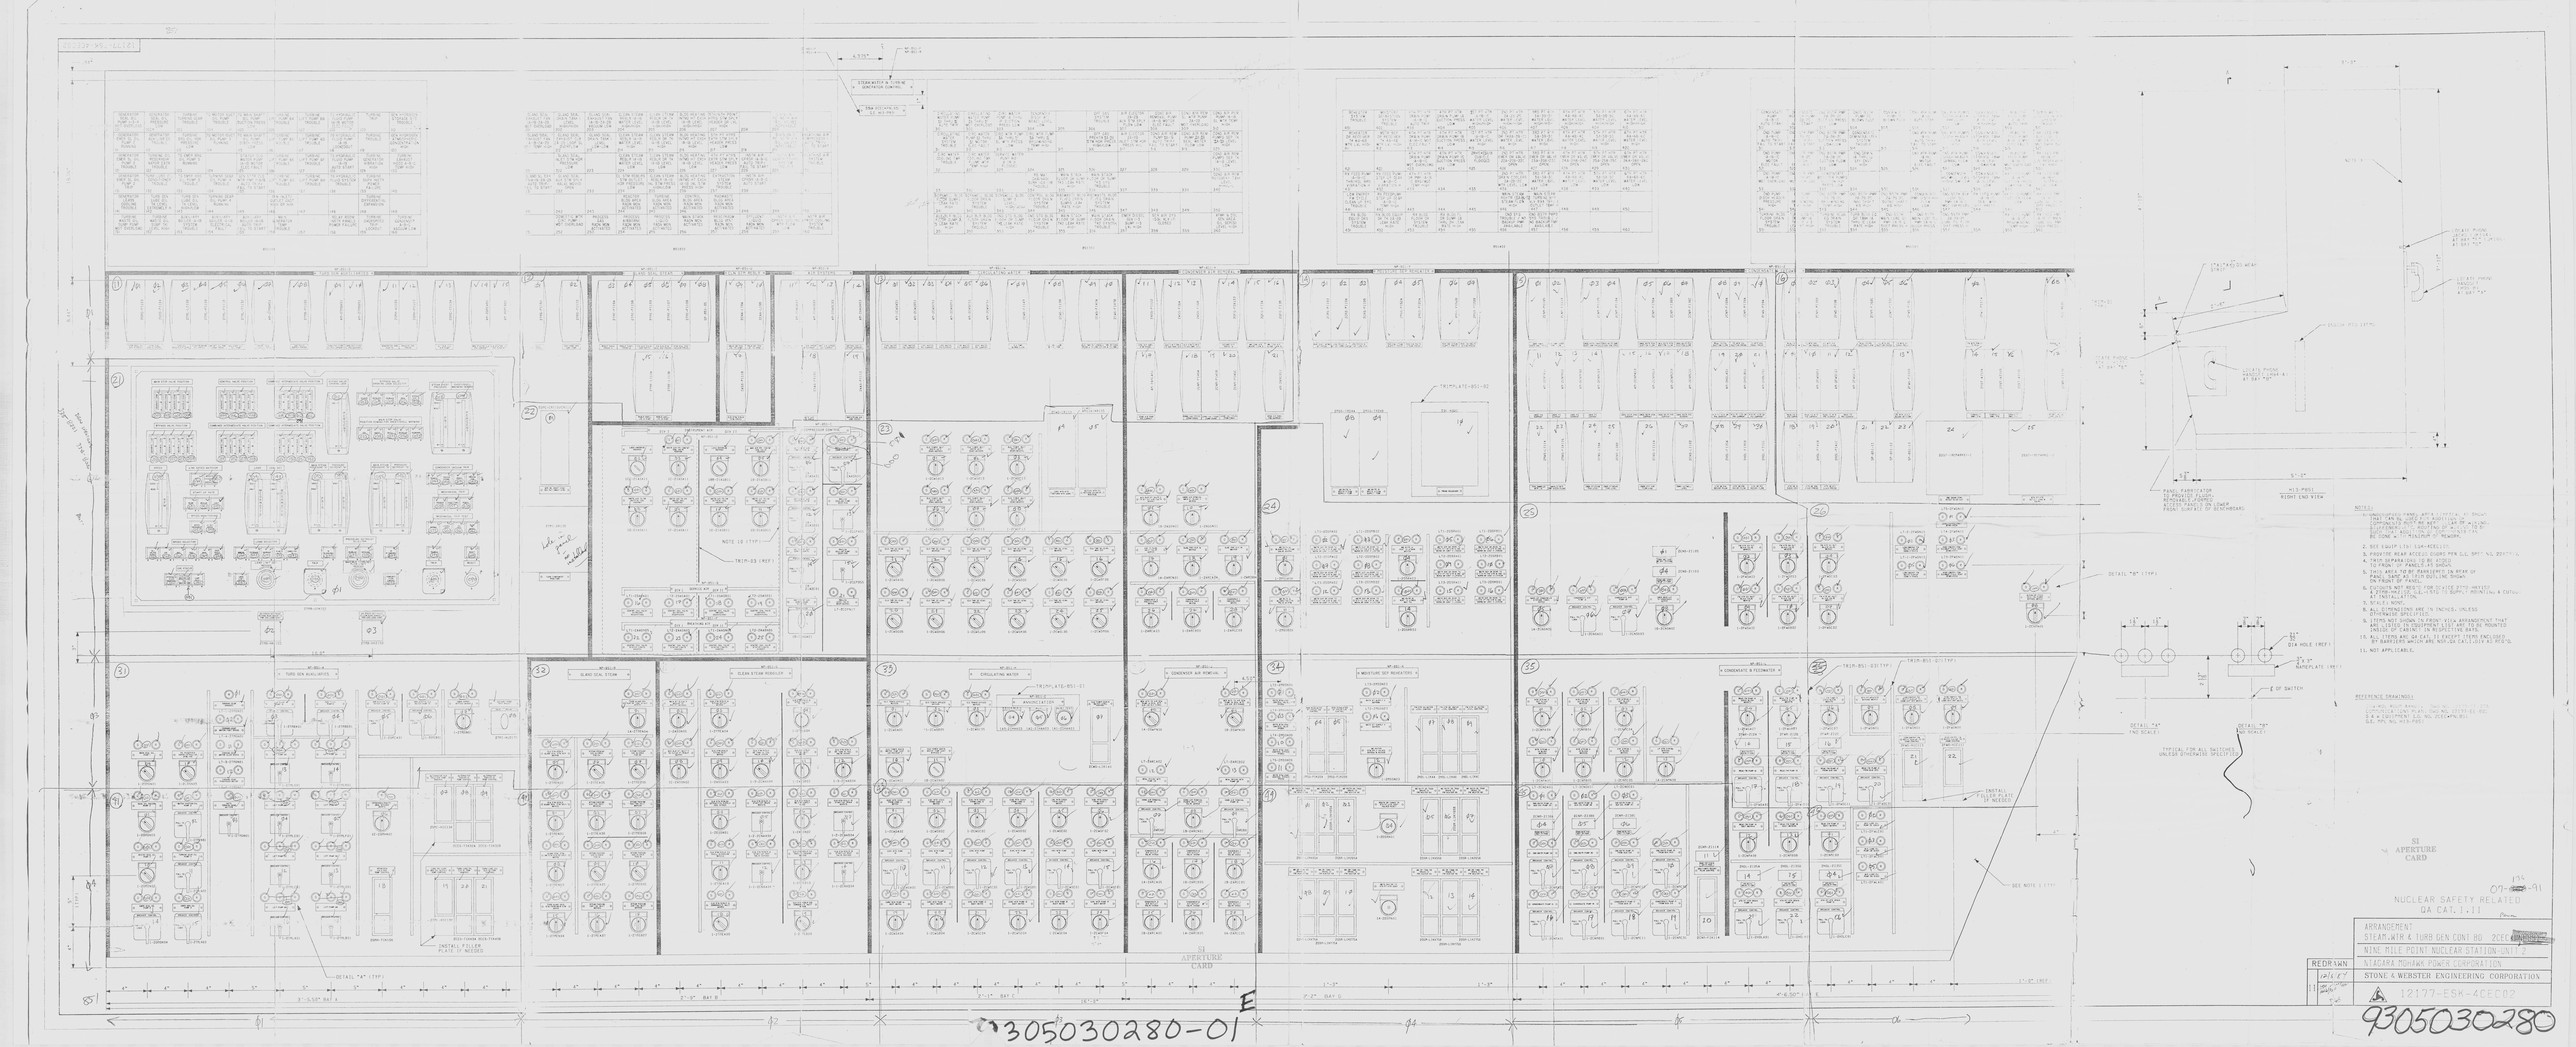
NOTES:
1. SEE EQUIPLIST 12A-4CEC01.
2. PROVIDE REAR ACCESS DOORS PER S.L. SPEC. NO. 2207-N.
3. THIS AREA TO BE PANELBOARDS BY OTHERS.
4. THIS AREA TO BE PANELBOARDS IN REAR OF PANEL. SEE M-1E OUTLINE DIAGRAM FOR DETAILS.
5. DEVICES NOT BOXED FOR DISTANCE BETWEEN CENTERLINES (C.L.) OF DEVICES, MOUNTING & CUTOUT ARE IDENTICAL.
6. SCALE: 1" = 1'-0"
7. DIMENSIONS ARE IN INCHES, UNLESS OTHERWISE SPECIFIED.
8. ITEMS NOT SHOWN IN FRONT VIEW ARRANGEMENT THAT ARE SHOWN IN SIDE VIEW ARE TO BE SURFACE MOUNTED ON BACK PLATE UNLESS OTHERWISE NOTED.
9. ALL ITEMS ARE QA CAT. II EXCEPT ITEMS ENCLOSED BY BARRELED WHICH ARE NON-QA CAT. I, II, OR III.
10. NOT APPLICABLE.
REFERENCE DRAWINGS:
SI APERTURE CARD
07-91
NUCLEAR SAFETY RELATED
QA CAT. I, II
ARRANGEMENT
STEAM AND TURB GEN CONT BD 2CEC02
NINE MILE POINT NUCLEAR STATION UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-4CEC02
REORDRAWN
9305030280-01 E
9305030280